


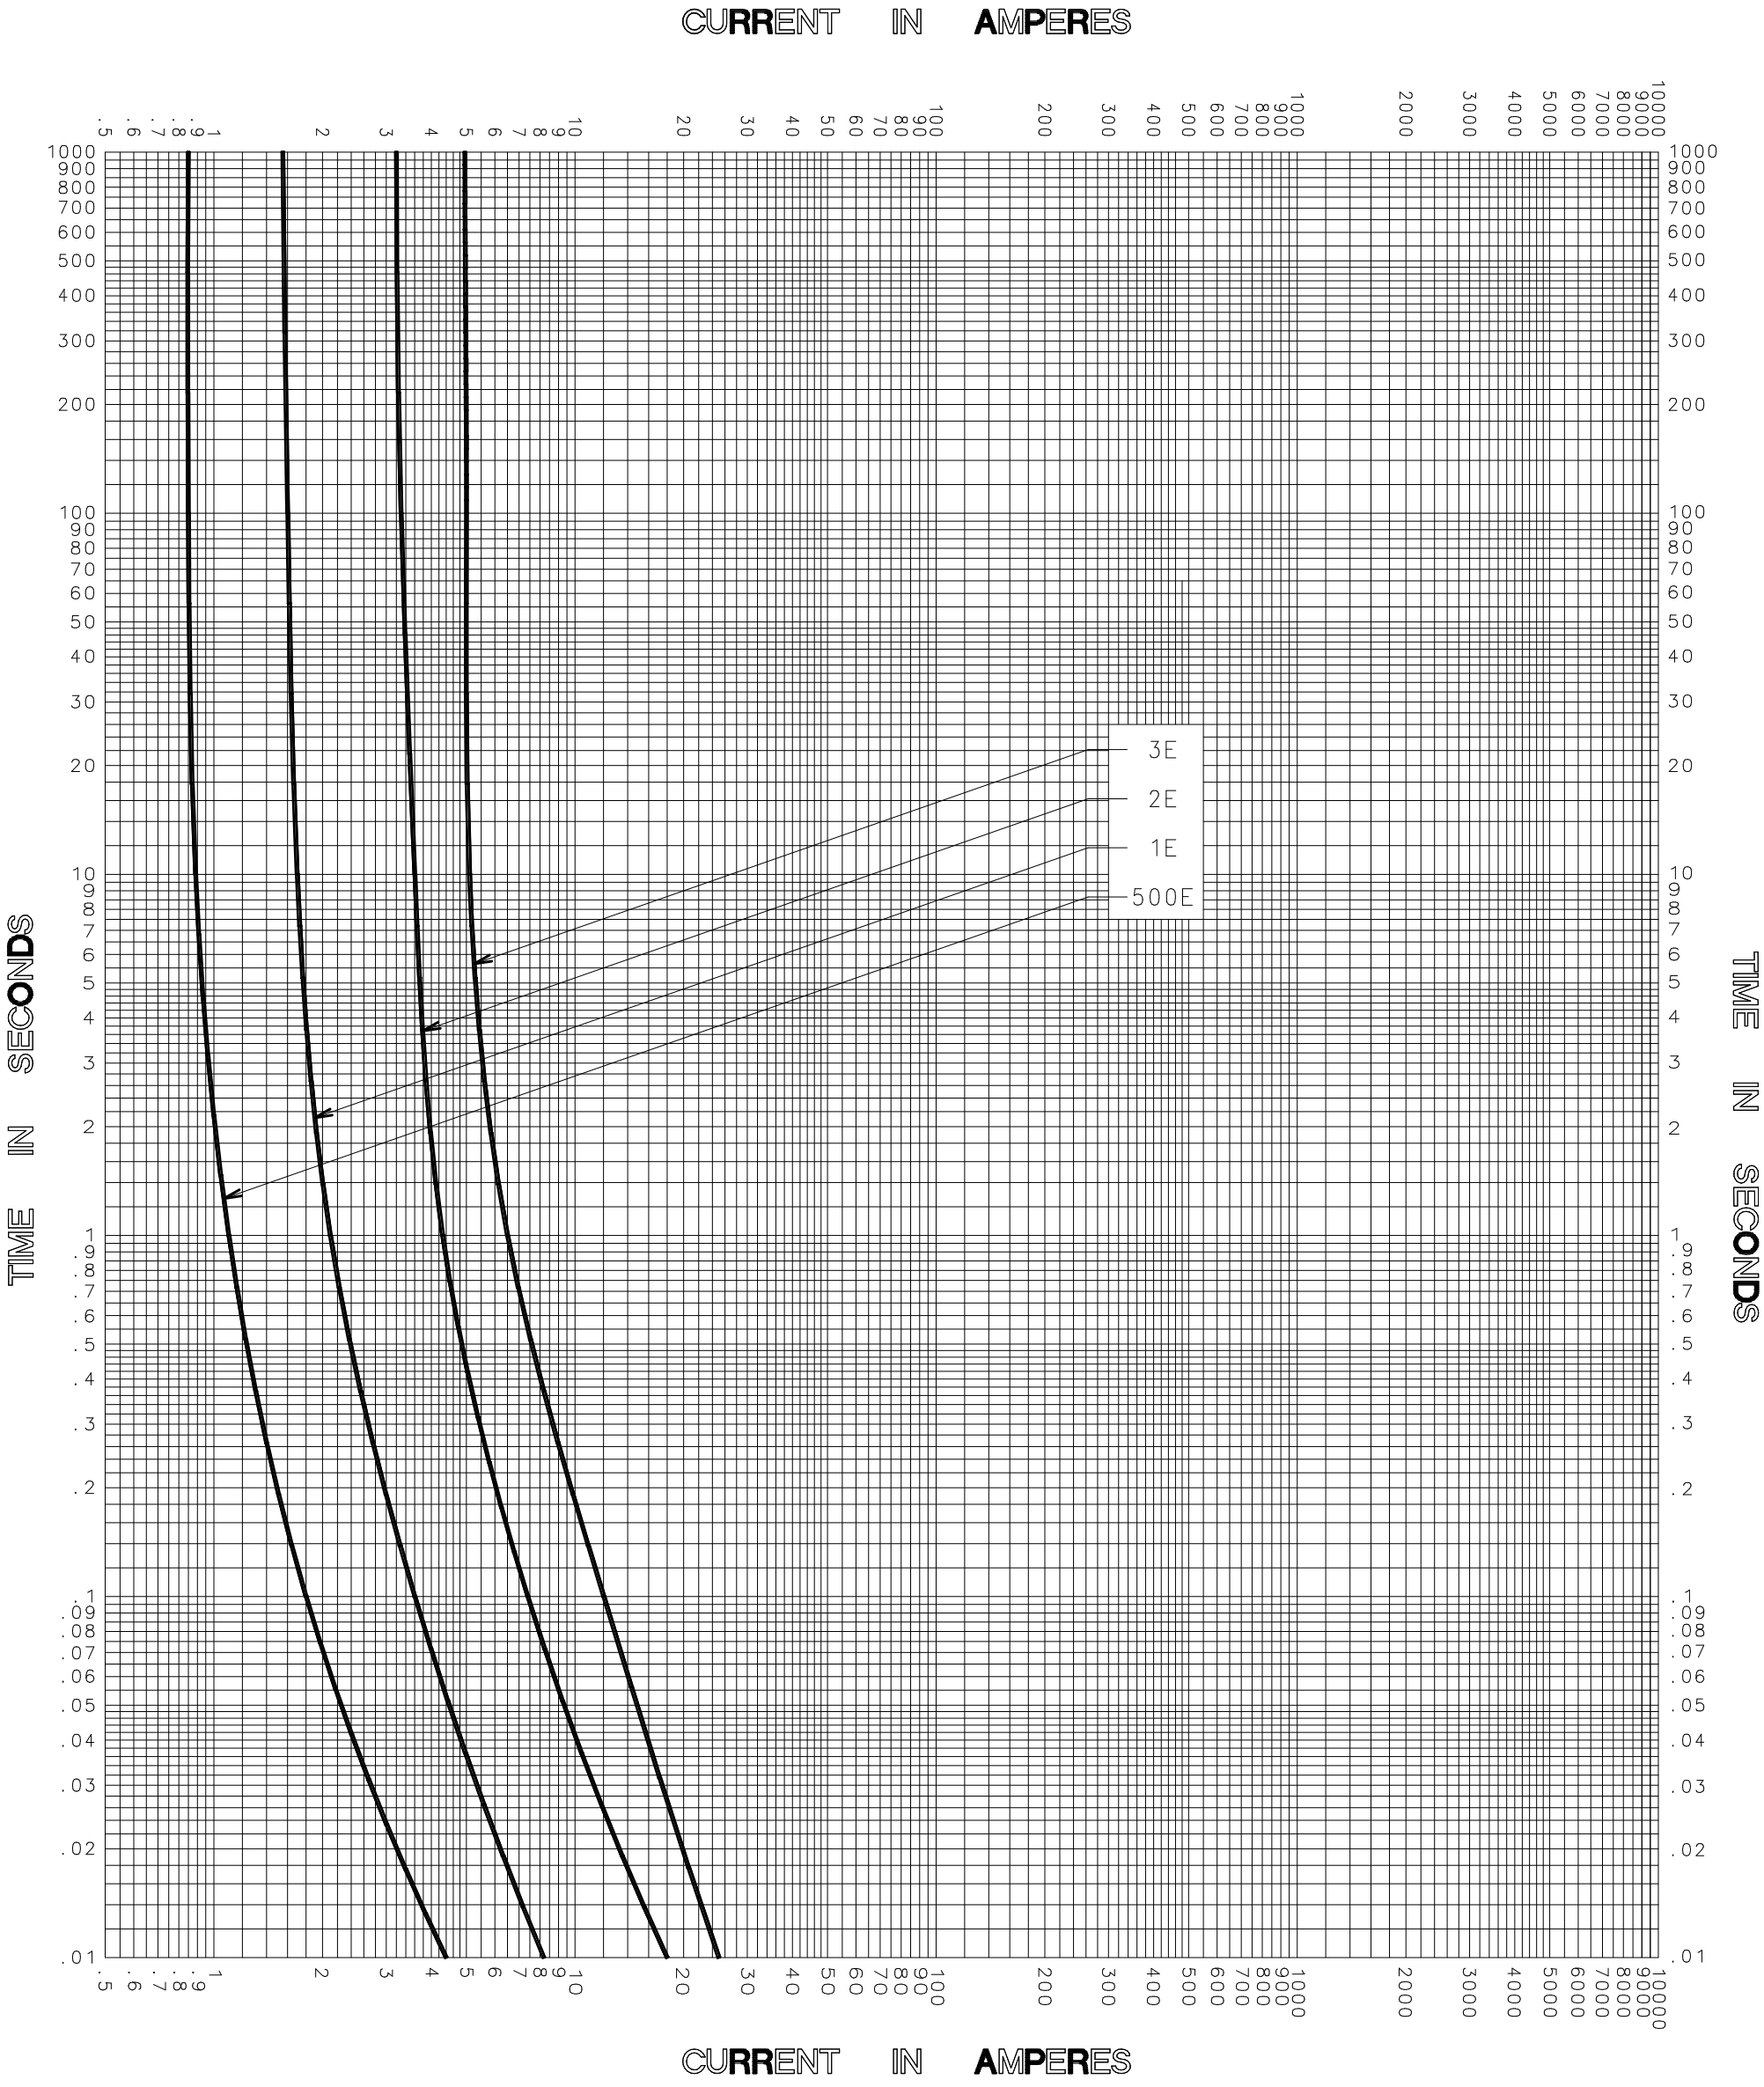

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	500E-8PT-8.25 thru 3E-8PT-8.25

 DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u> DATE <u>10/17/05</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A FCC01-8PT-8.25P-0001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT