



MELTING (PRE-ARCING) TIME IN SECONDS

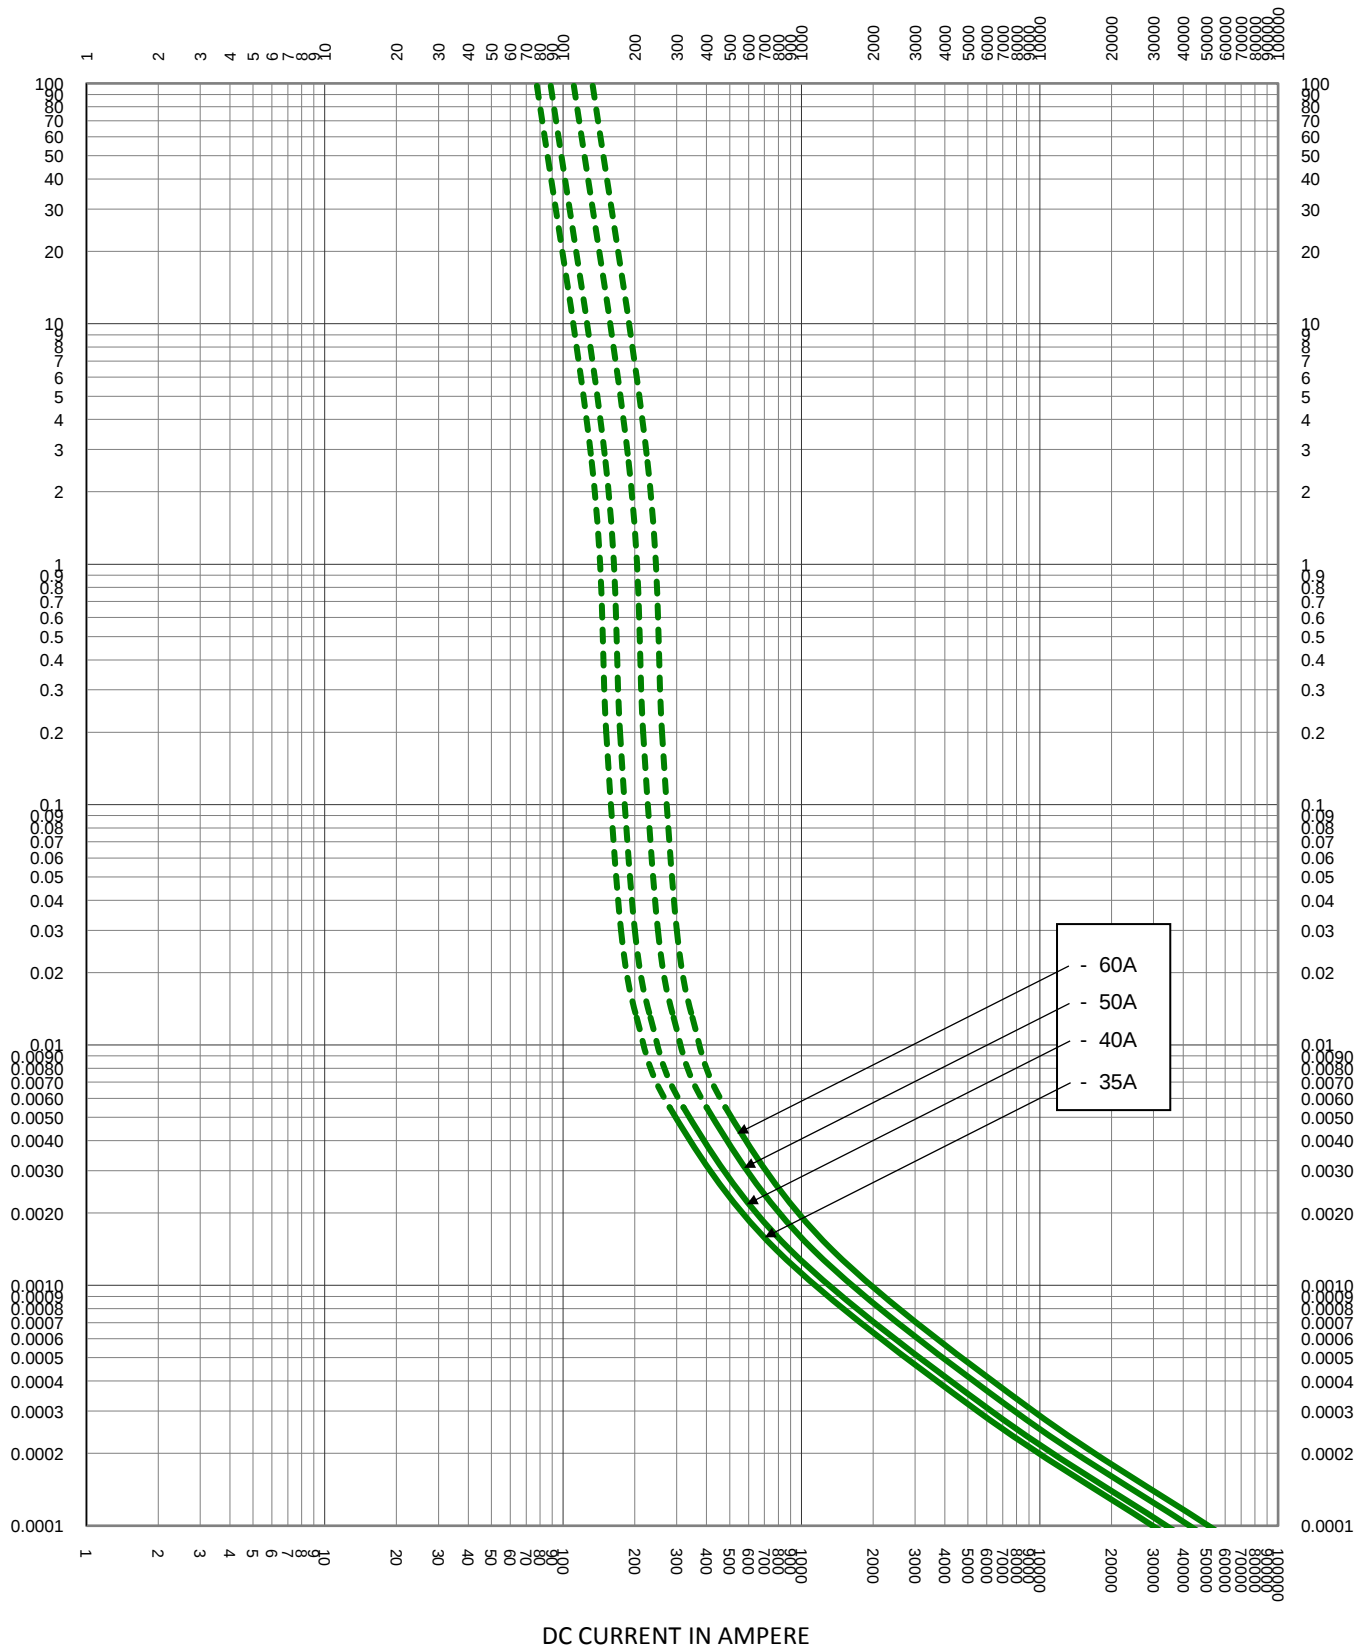


DC CURRENT IN AMPERE

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L75QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 04/13/2018 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-L75QS DC SHEET 2 OF 7

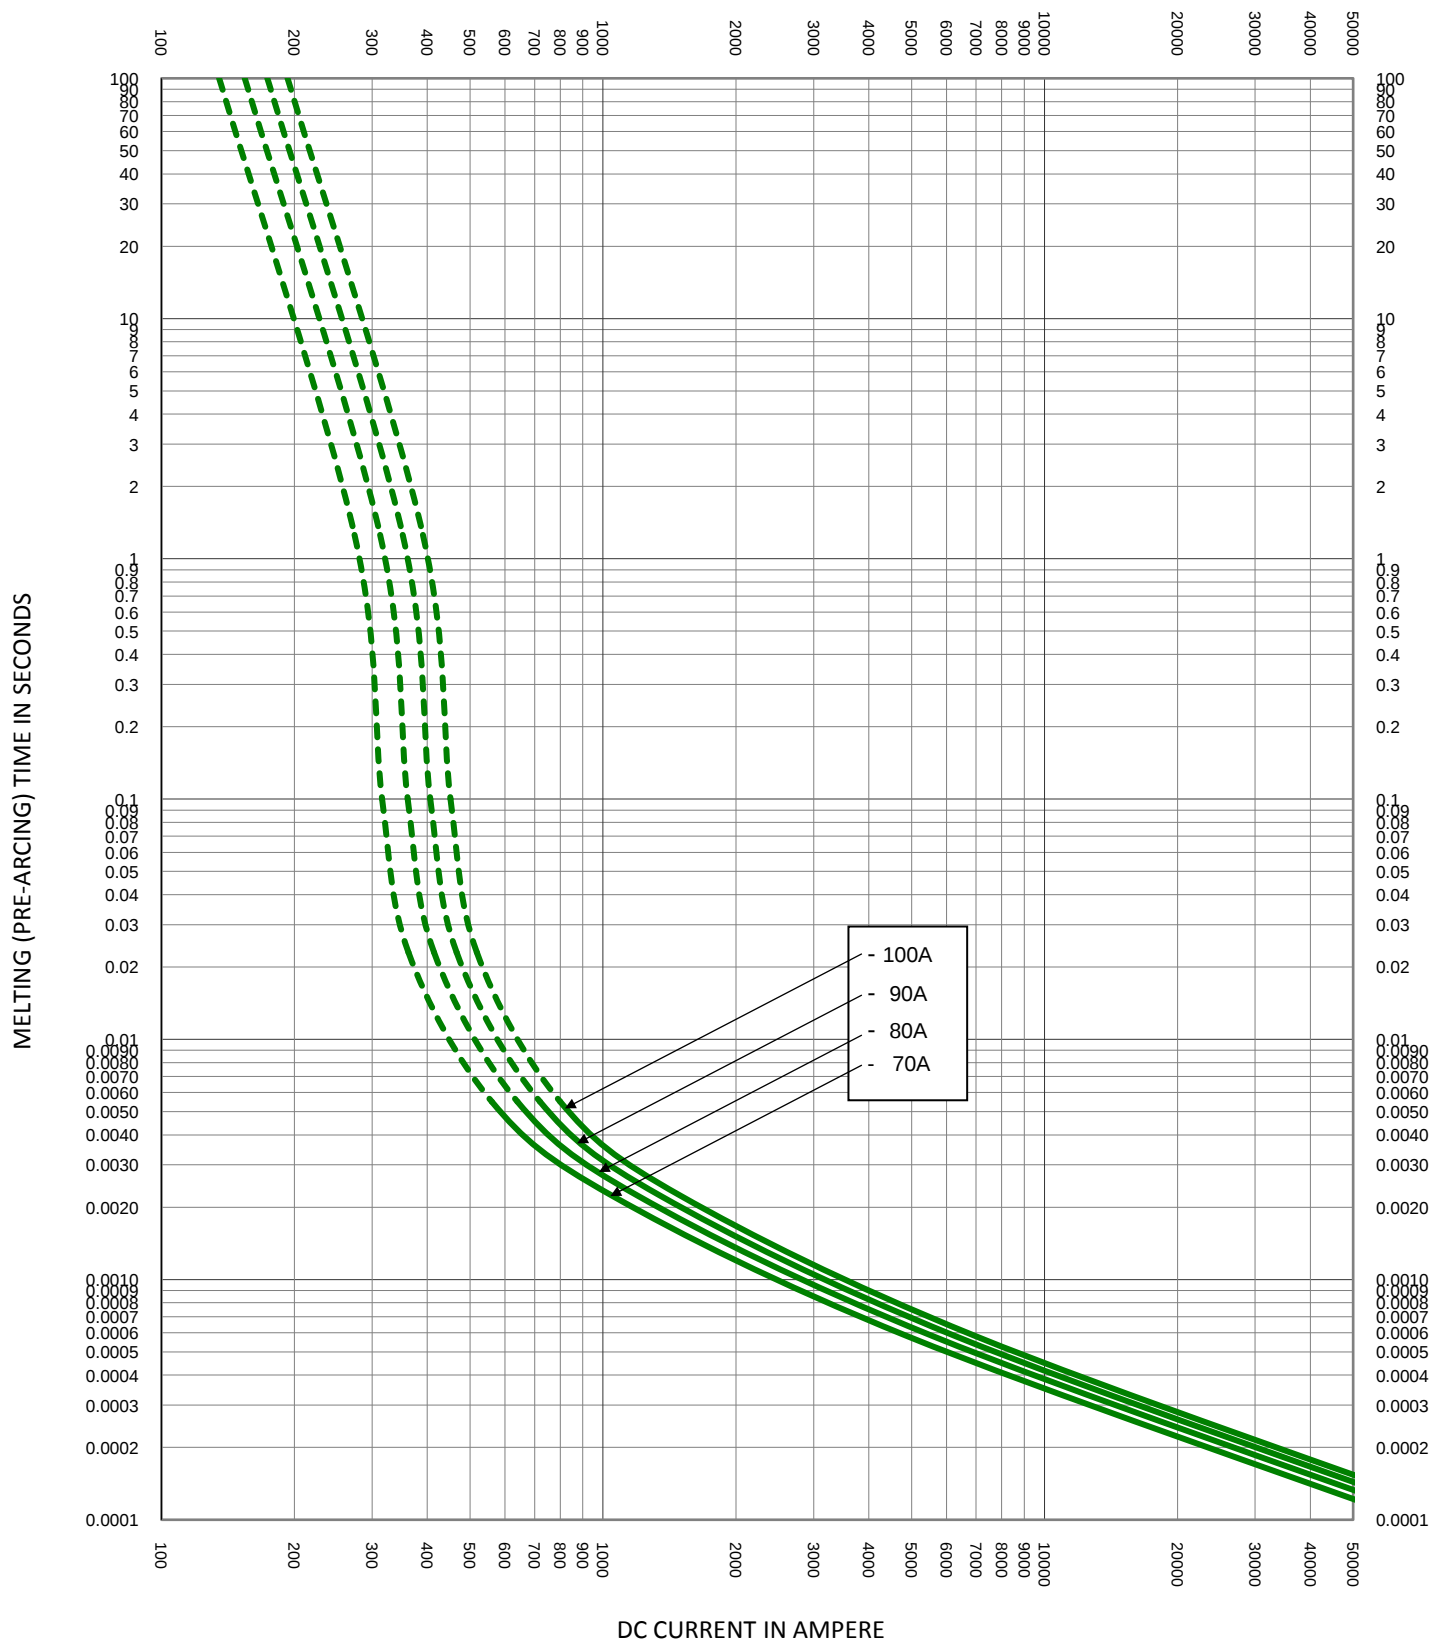


TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L75QS 35A - 800A	
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 04/13/2018	
TIME CURRENT CHARACTERISTIC CURVES		REVISION: A	
		DRAWING NO.: FCC01-L75QS DC	
		SHEET 3 OF 7	

MELTING (PRE-ARCING) TIME IN SECONDS

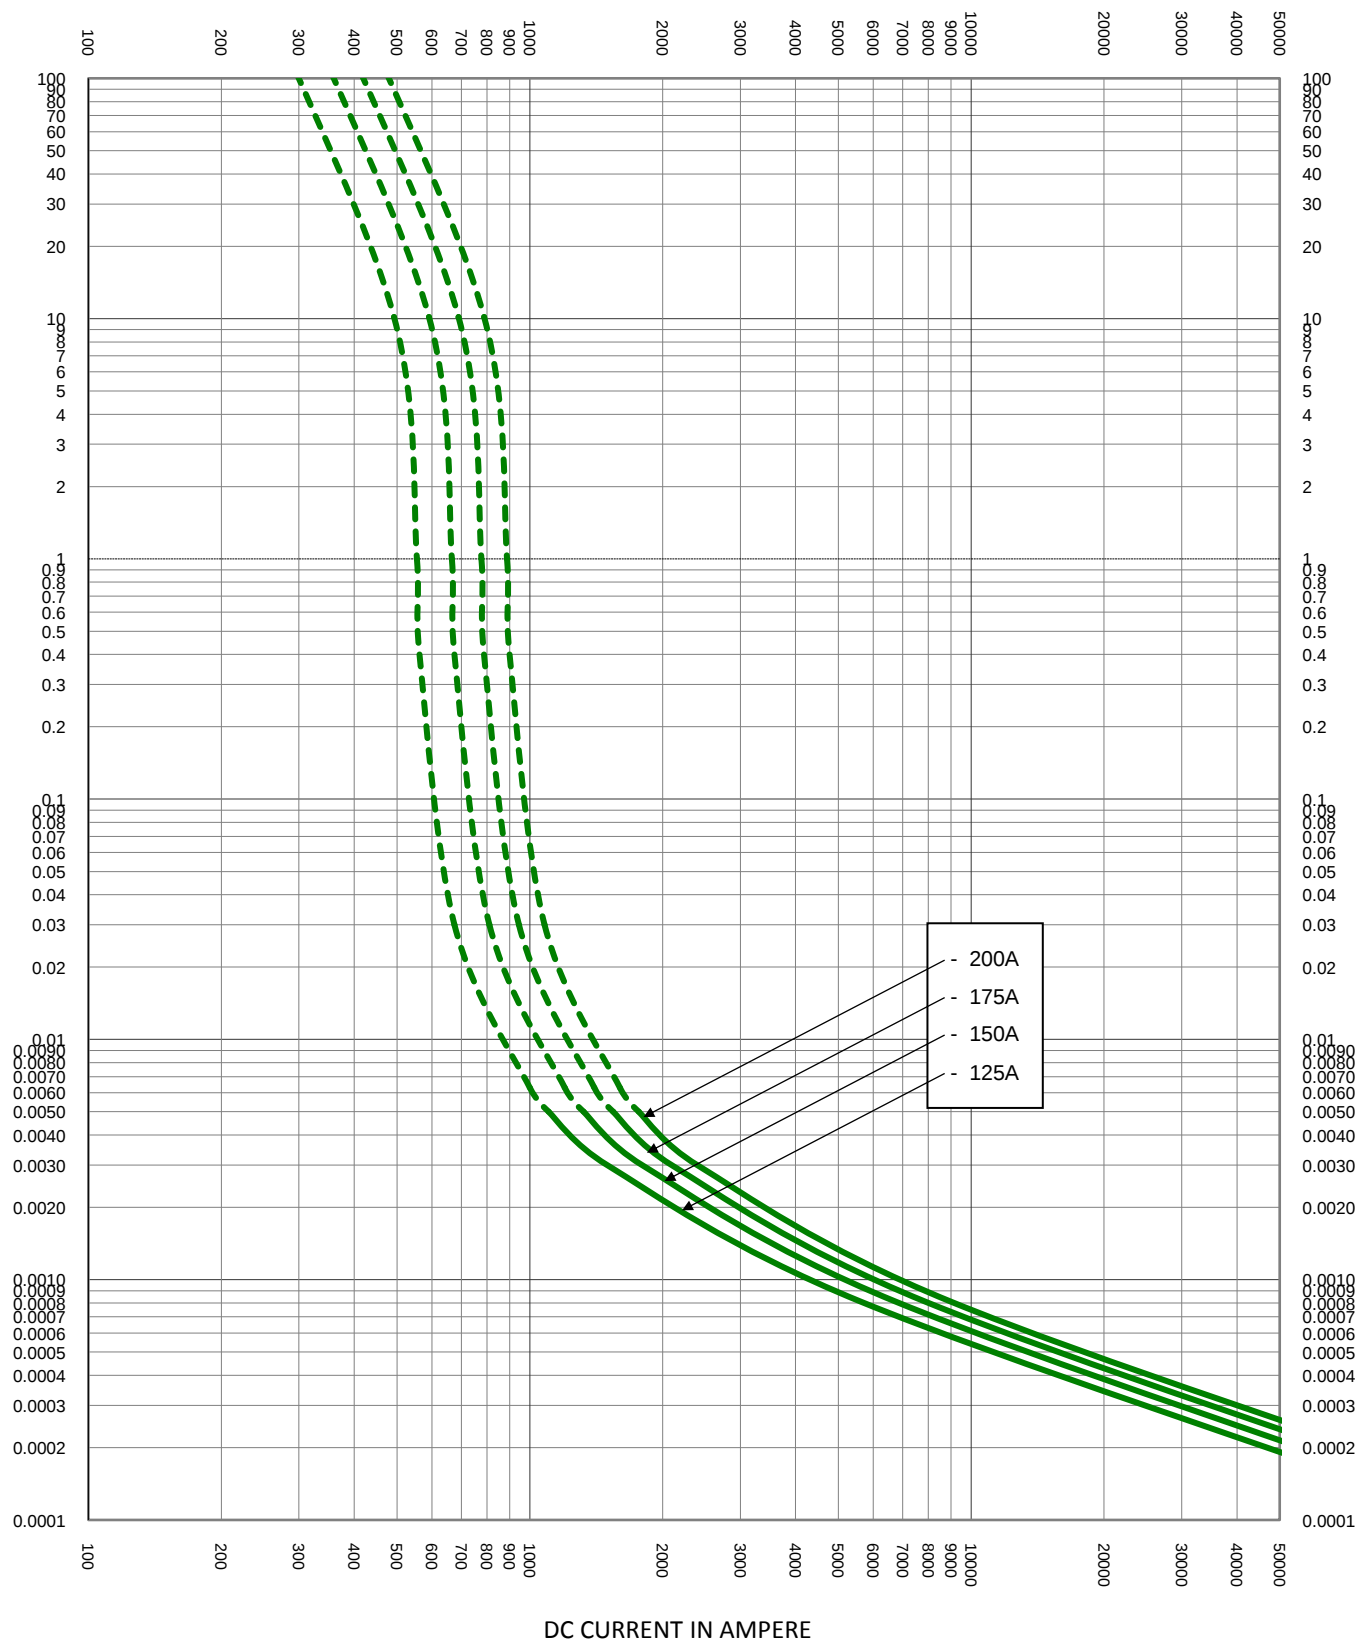


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L75QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 04/13/2018 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-L75QS DC SHEET 4 OF 7

MELTING (PRE-ARCING) TIME IN SECONDS

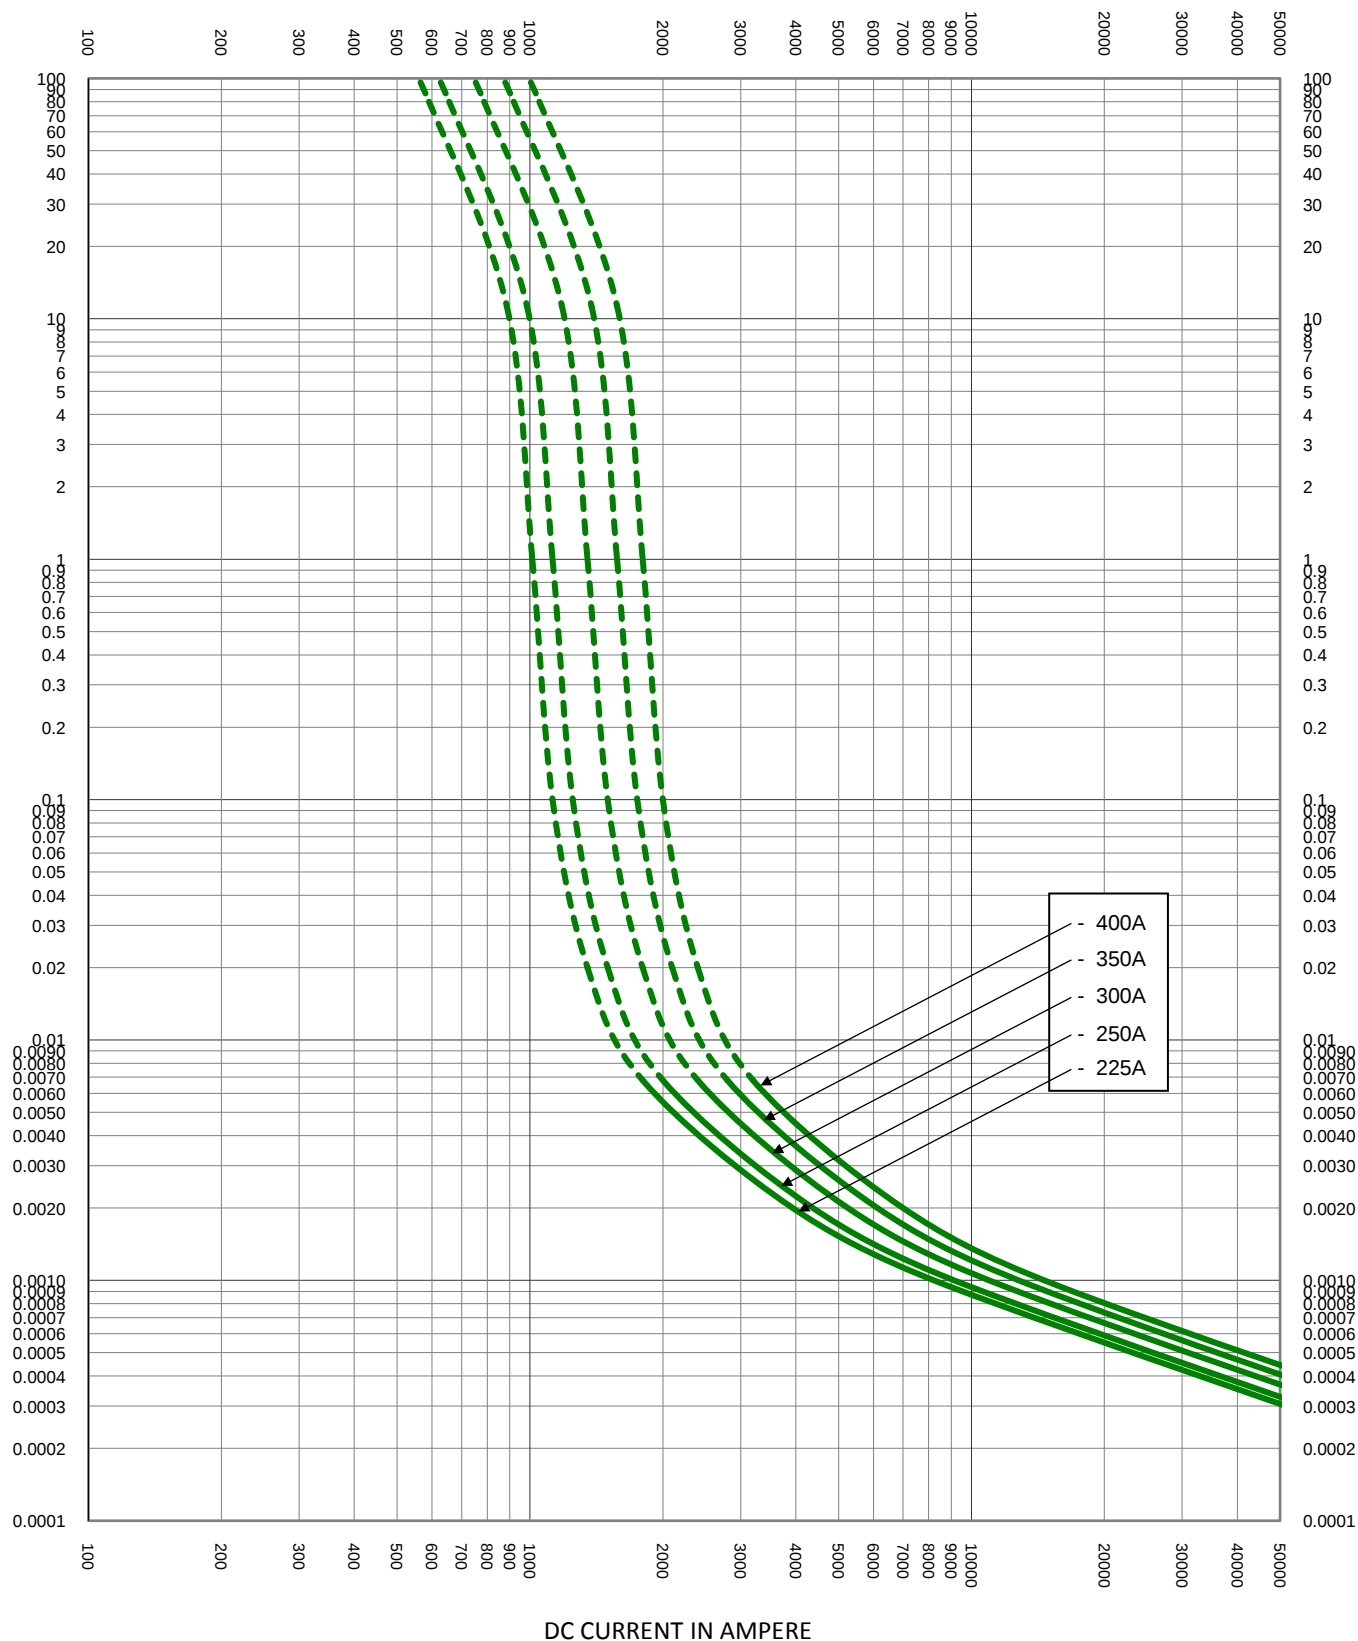


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L75QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 04/13/2018 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-L75QS DC SHEET 5 OF 7

MELTING (PRE-ARCING) TIME IN SECONDS

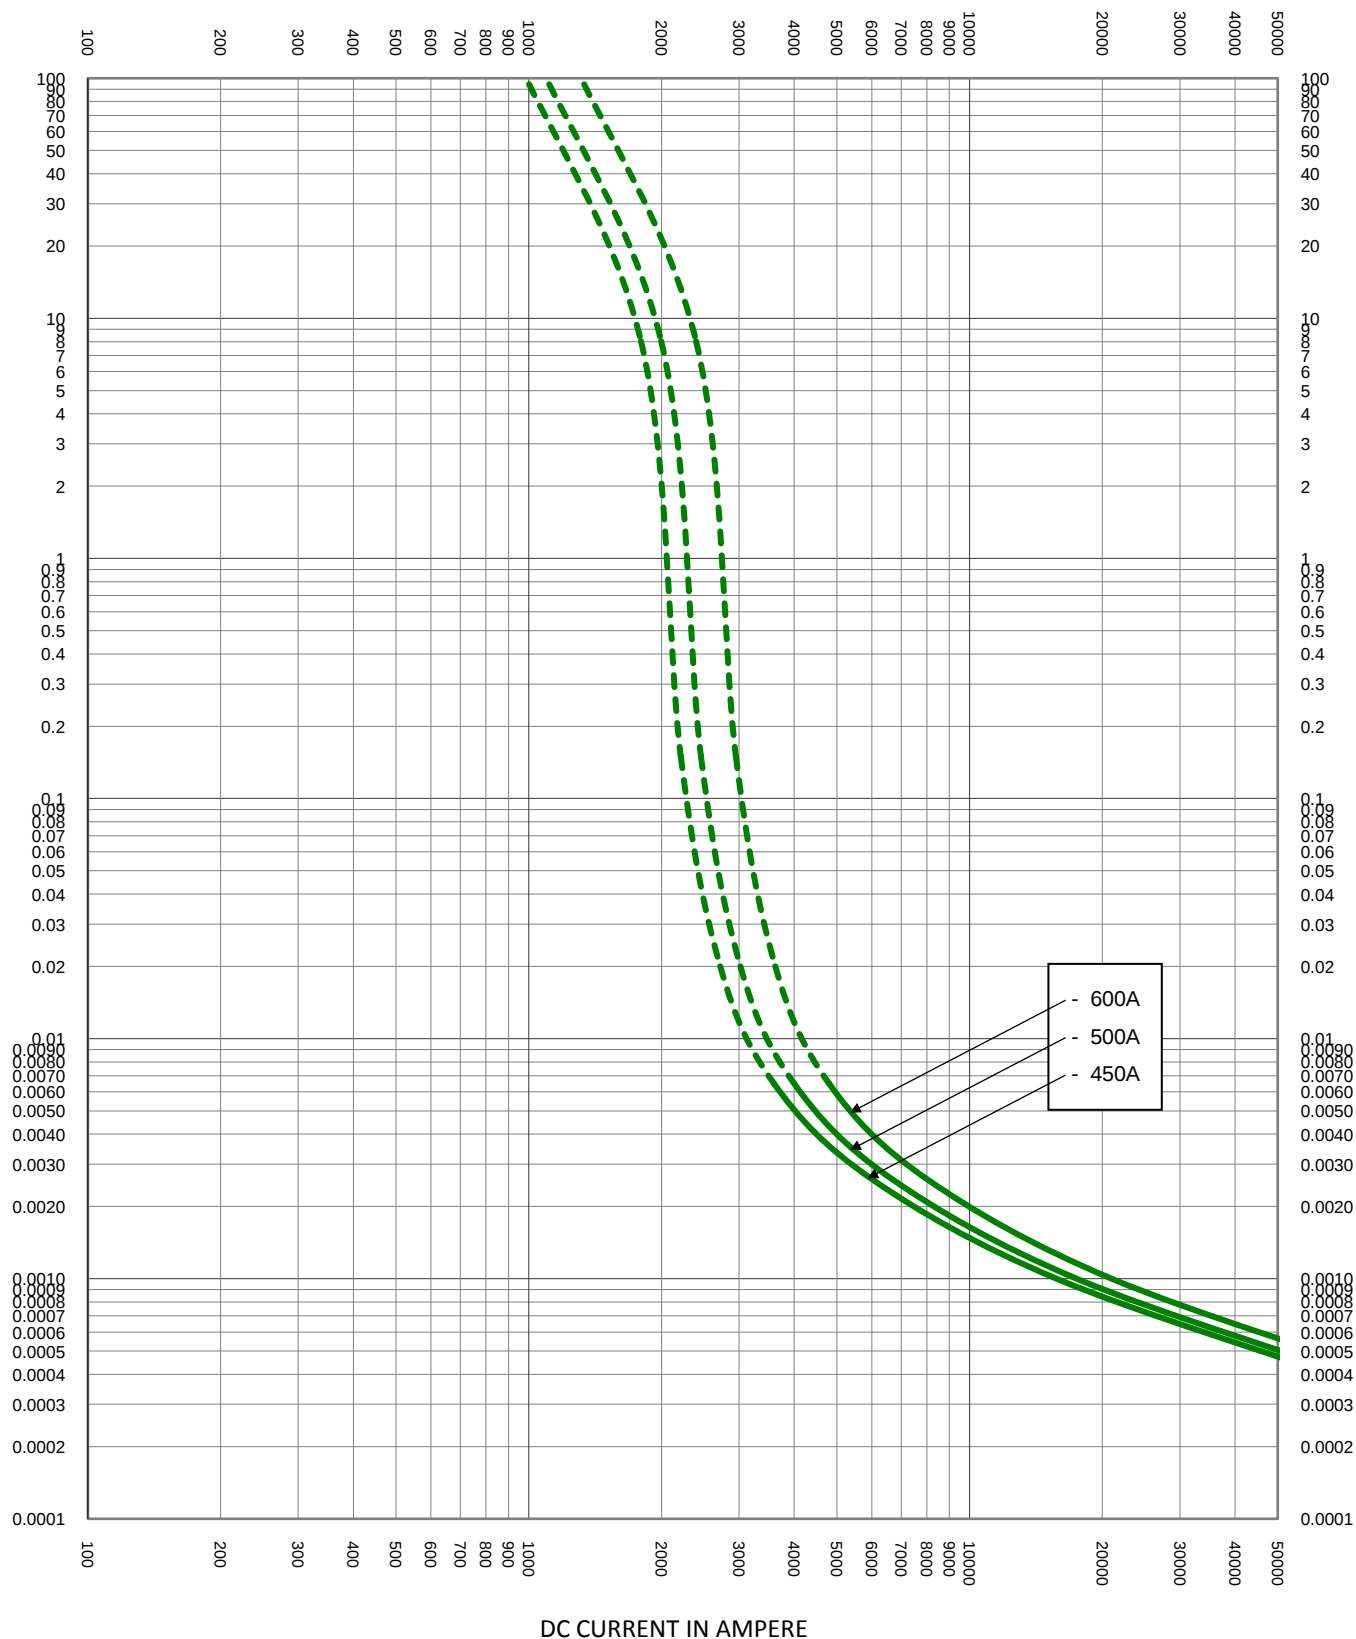

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L75QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 04/13/2018 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-L75QS DC SHEET 6 OF 7

MELTING (PRE-ARCING) TIME IN SECONDS

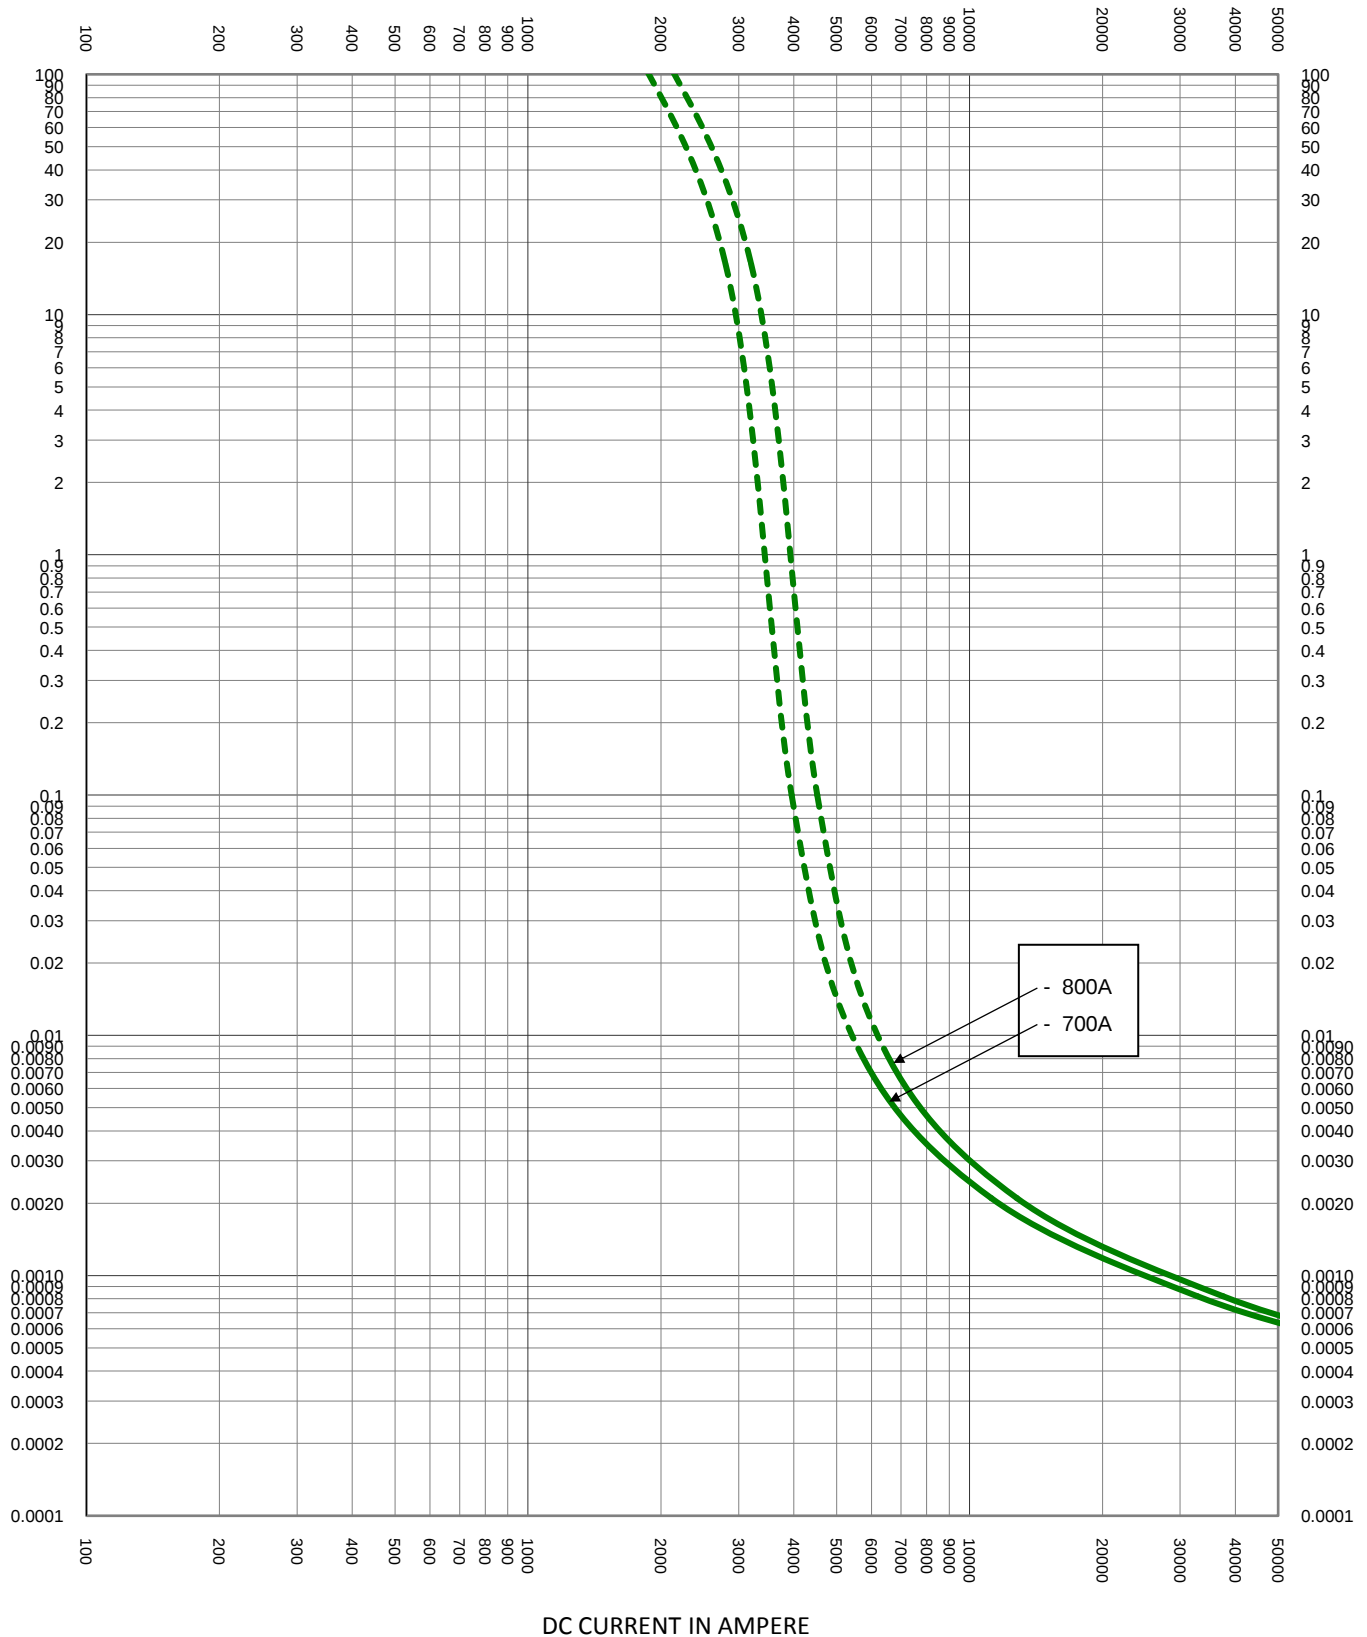

TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L75QS 35A - 800A	
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 04/13/2018	
TIME CURRENT CHARACTERISTIC CURVES		REVISION: A	
		DRAWING NO.: FCC01-L75QS DC	
		SHEET 7 OF 7	