


**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

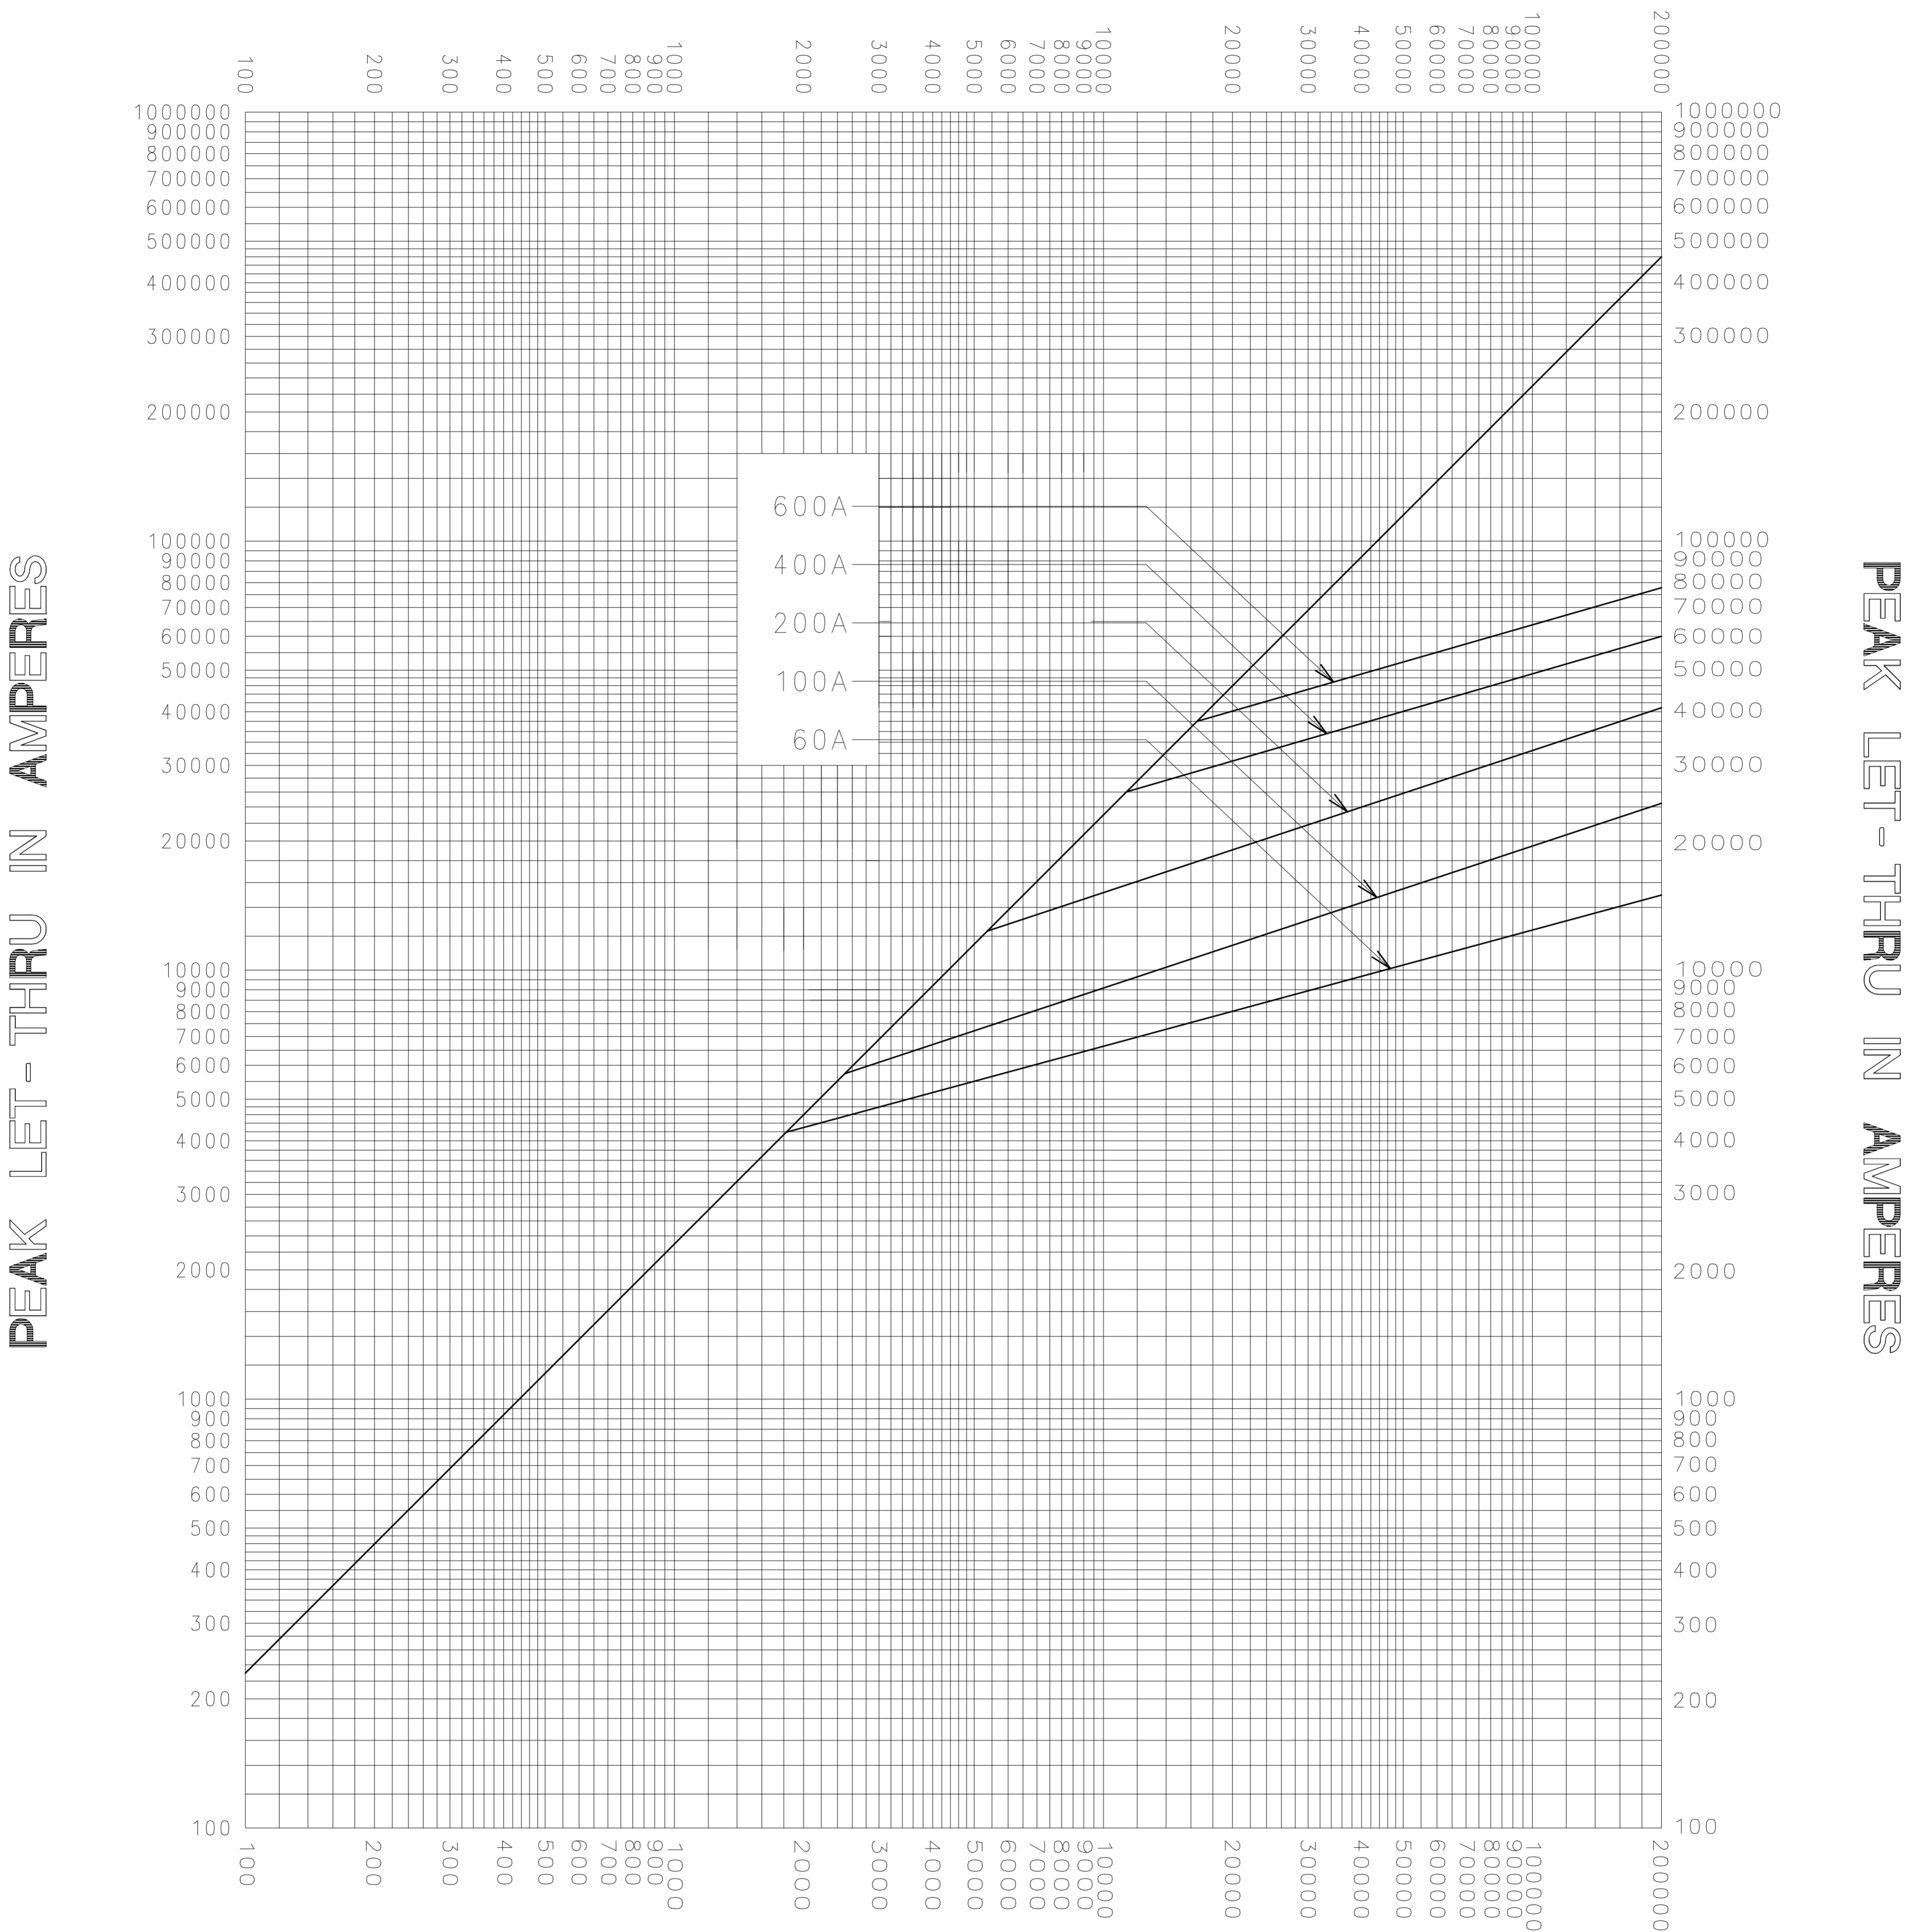

**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER FLNR (60A - 600A) ID _____
---	---

LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>09/06/06</u> CHECKED BY <u>MP</u>
PEAK LET-THRU CHARACTERISTIC CURVES	DRAWING NO. A-FCC05-1001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT