


**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

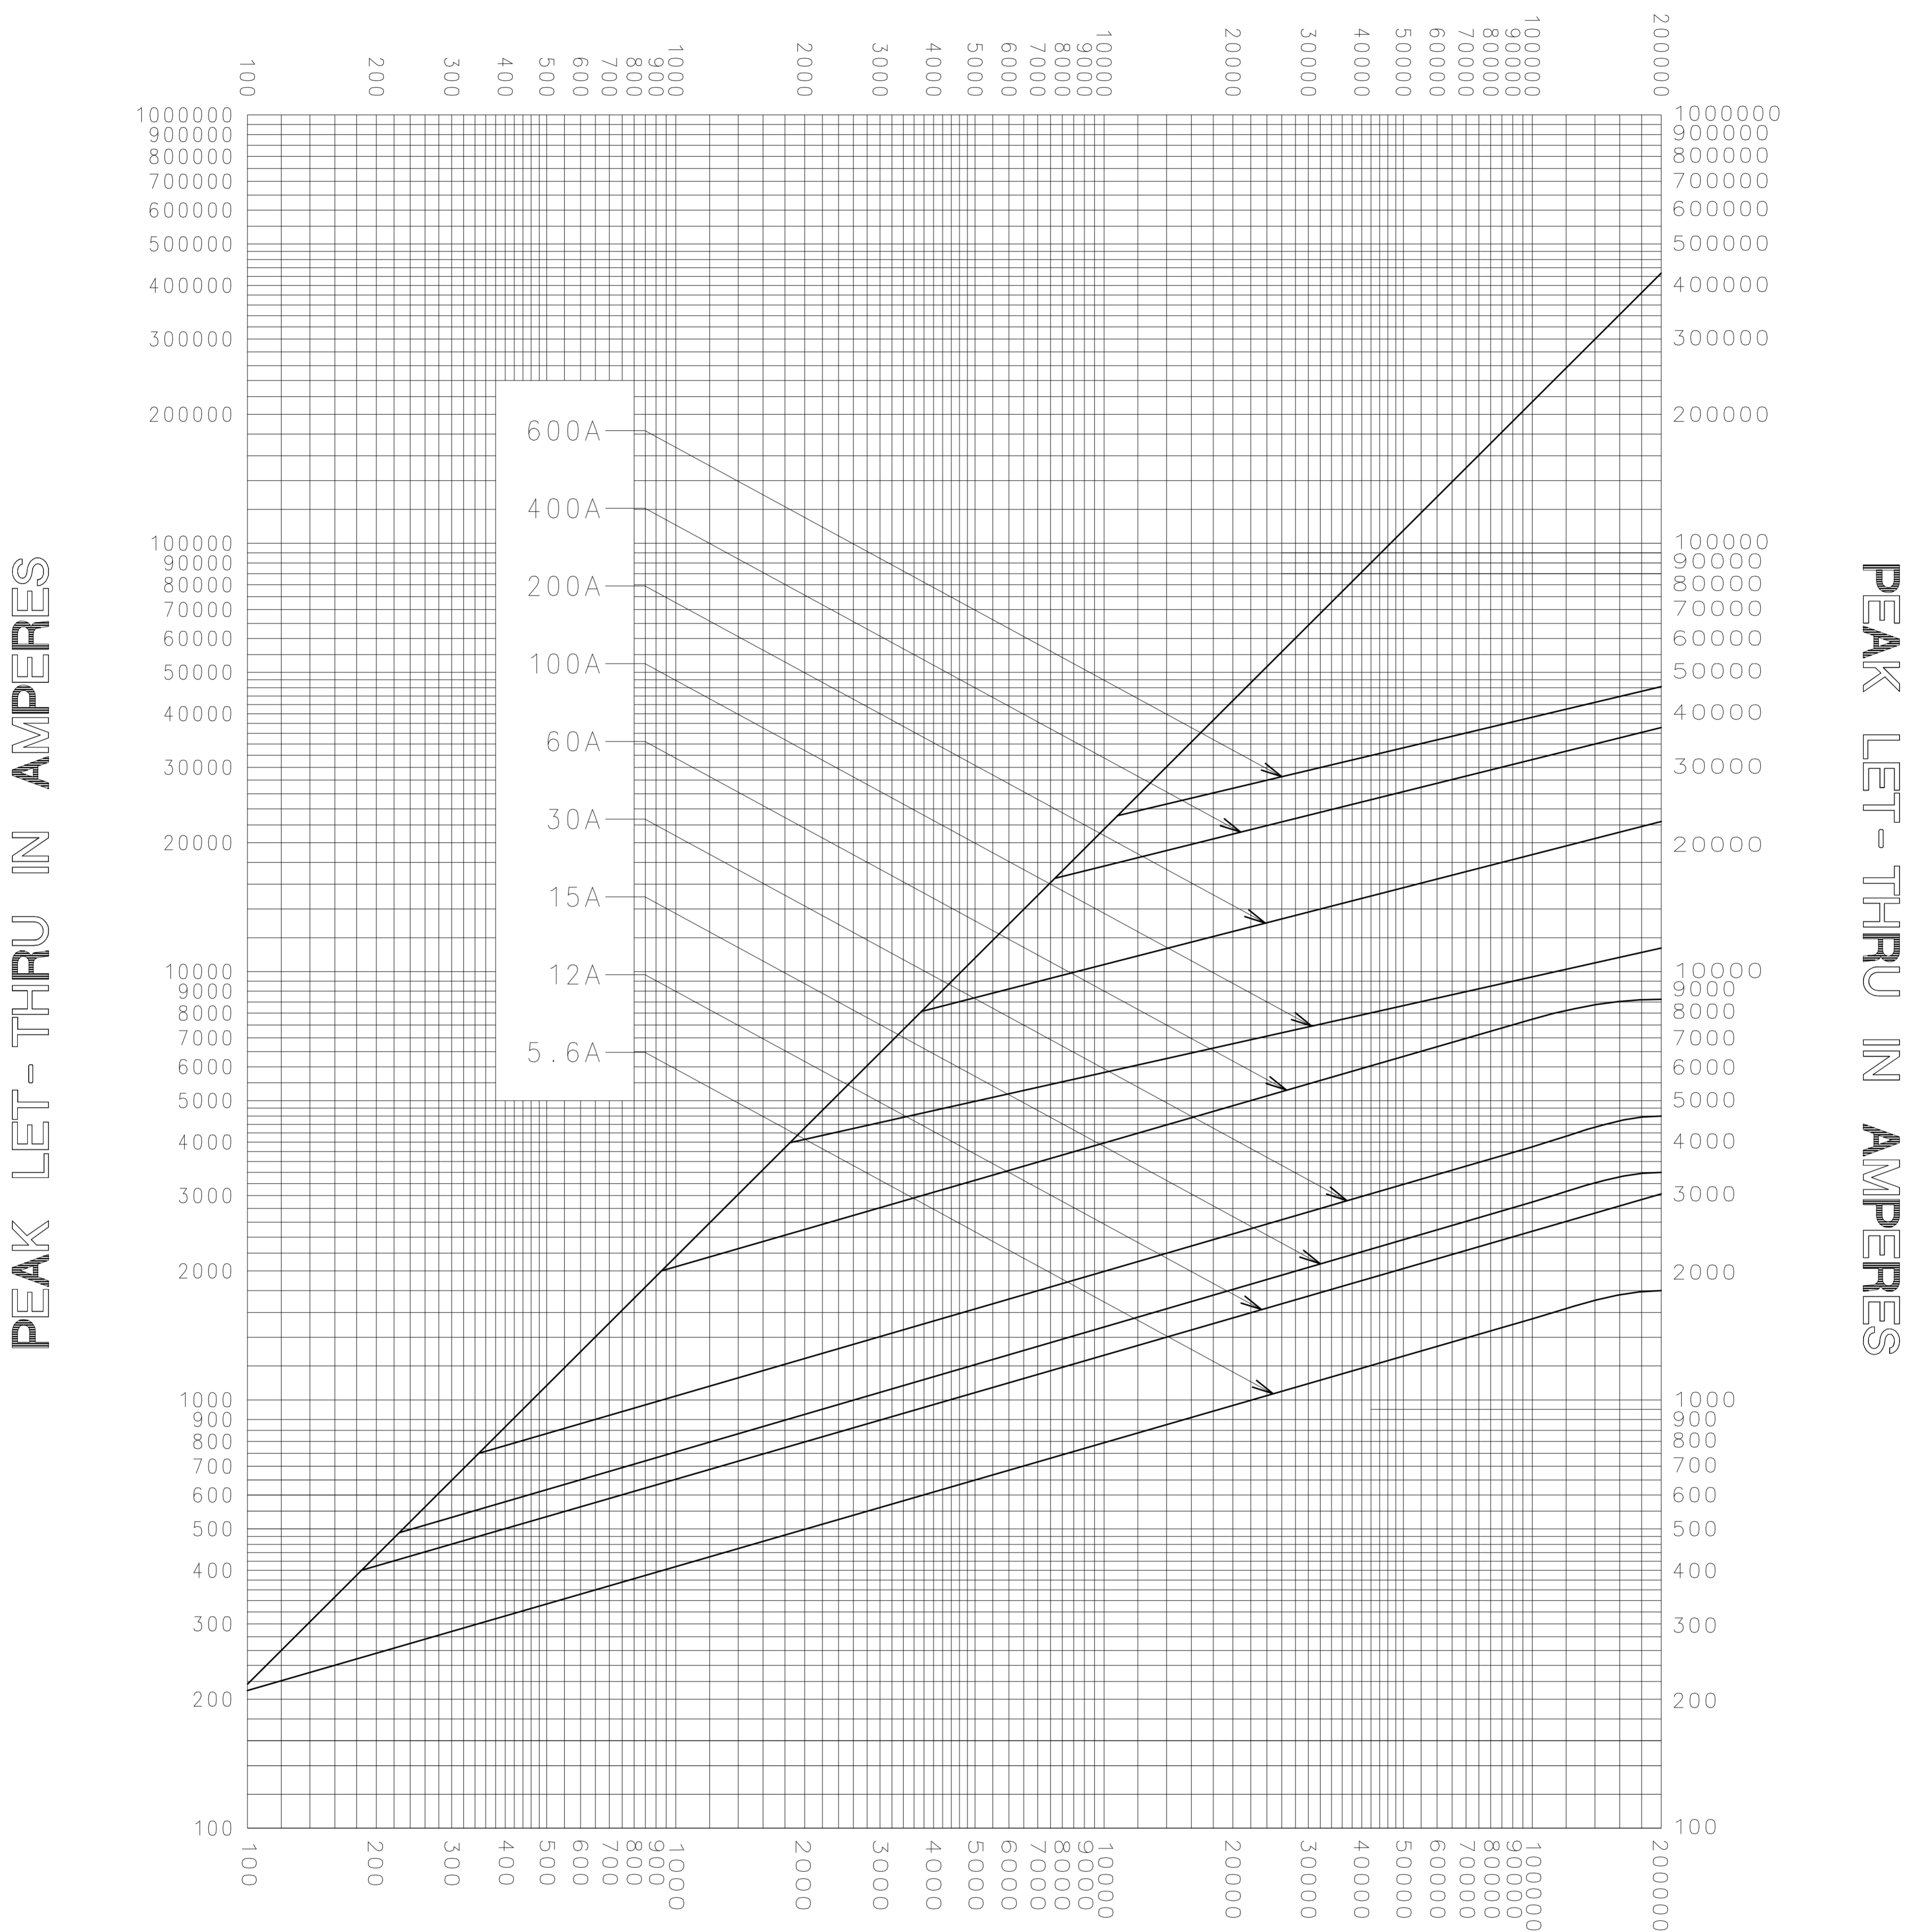

**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	JTD (5.6A - 600A) ID _____

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>09/06/06</u>
PEAK LET-THRU CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC05-01</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT