



AVAILABLE FAULT CURRENT  
 SYMMETRICAL R. M. S. AMPERES

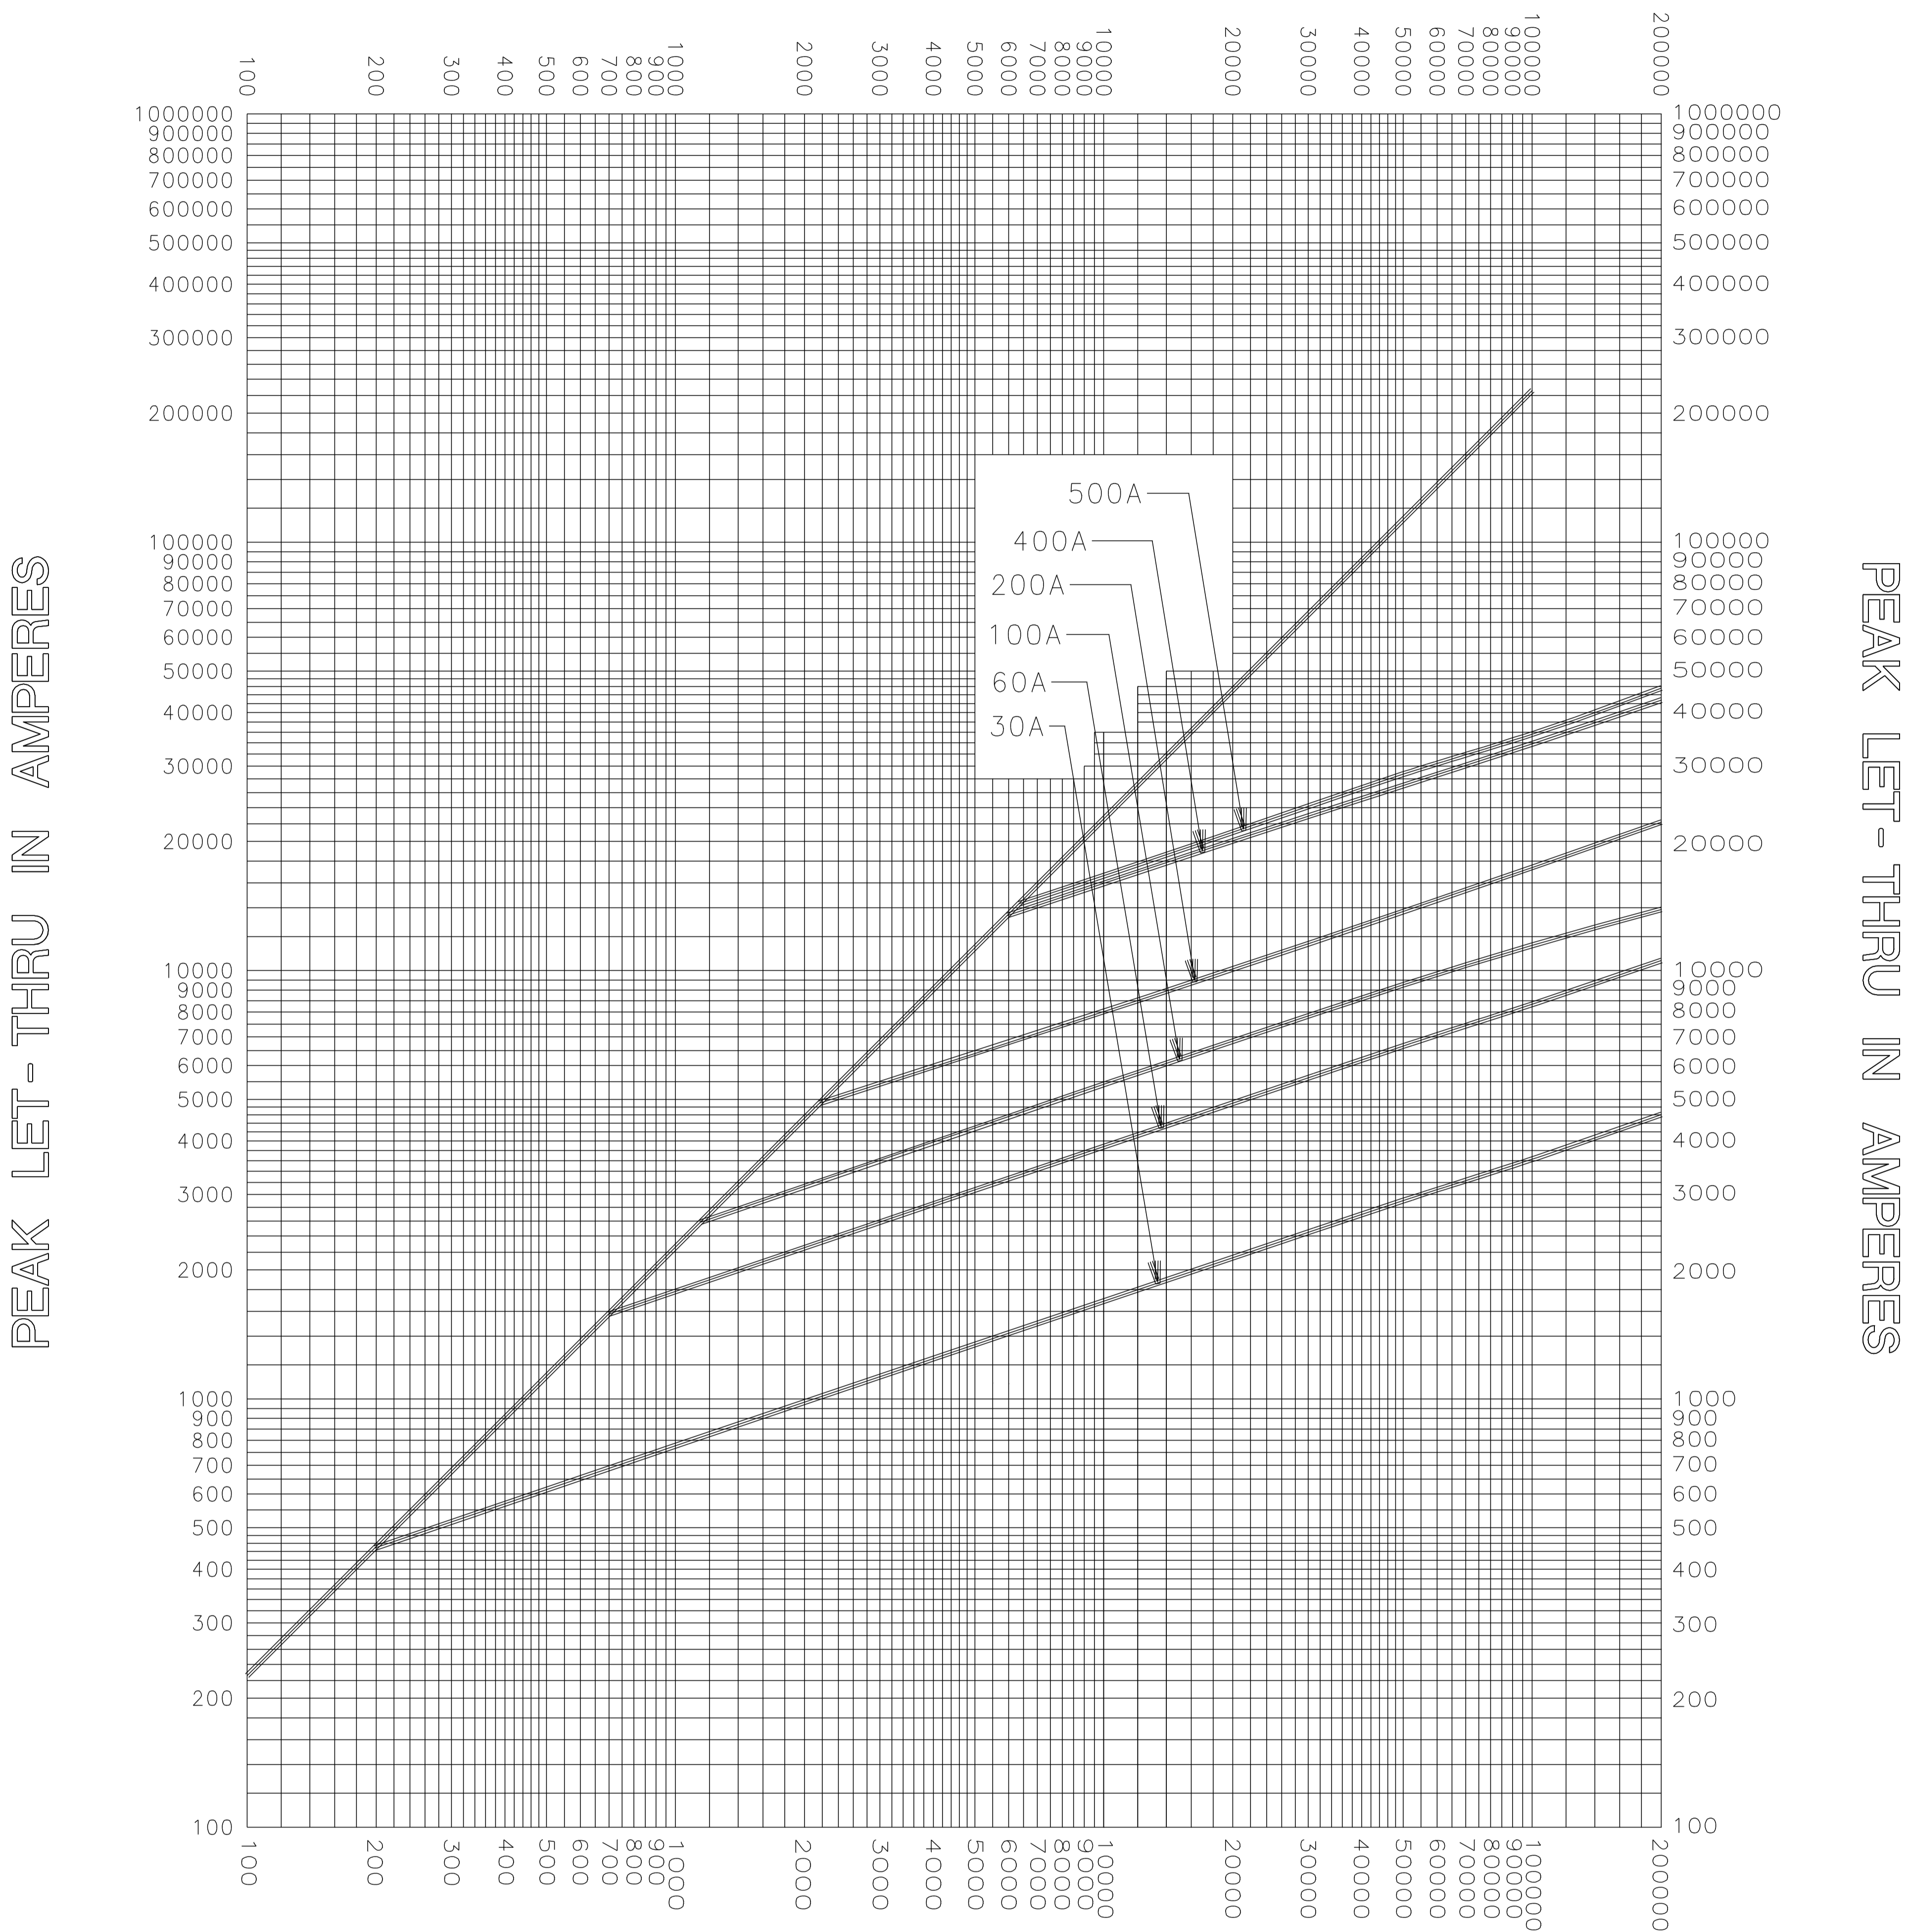

AVAILABLE FAULT CURRENT  
 SYMMETRICAL R. M. S. AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER LLSRK ID (30A, 60A, 100A, 200A, 400A, 500A)
 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>BJJ</u> DATE <u>2/13/01</u> CHECKED BY _____
	DRAWING NO. A-FCC05 SR-003

PEAK LET-THRU CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT