


TIME IN SECONDS



TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLNR (35A - 60A) ID _____

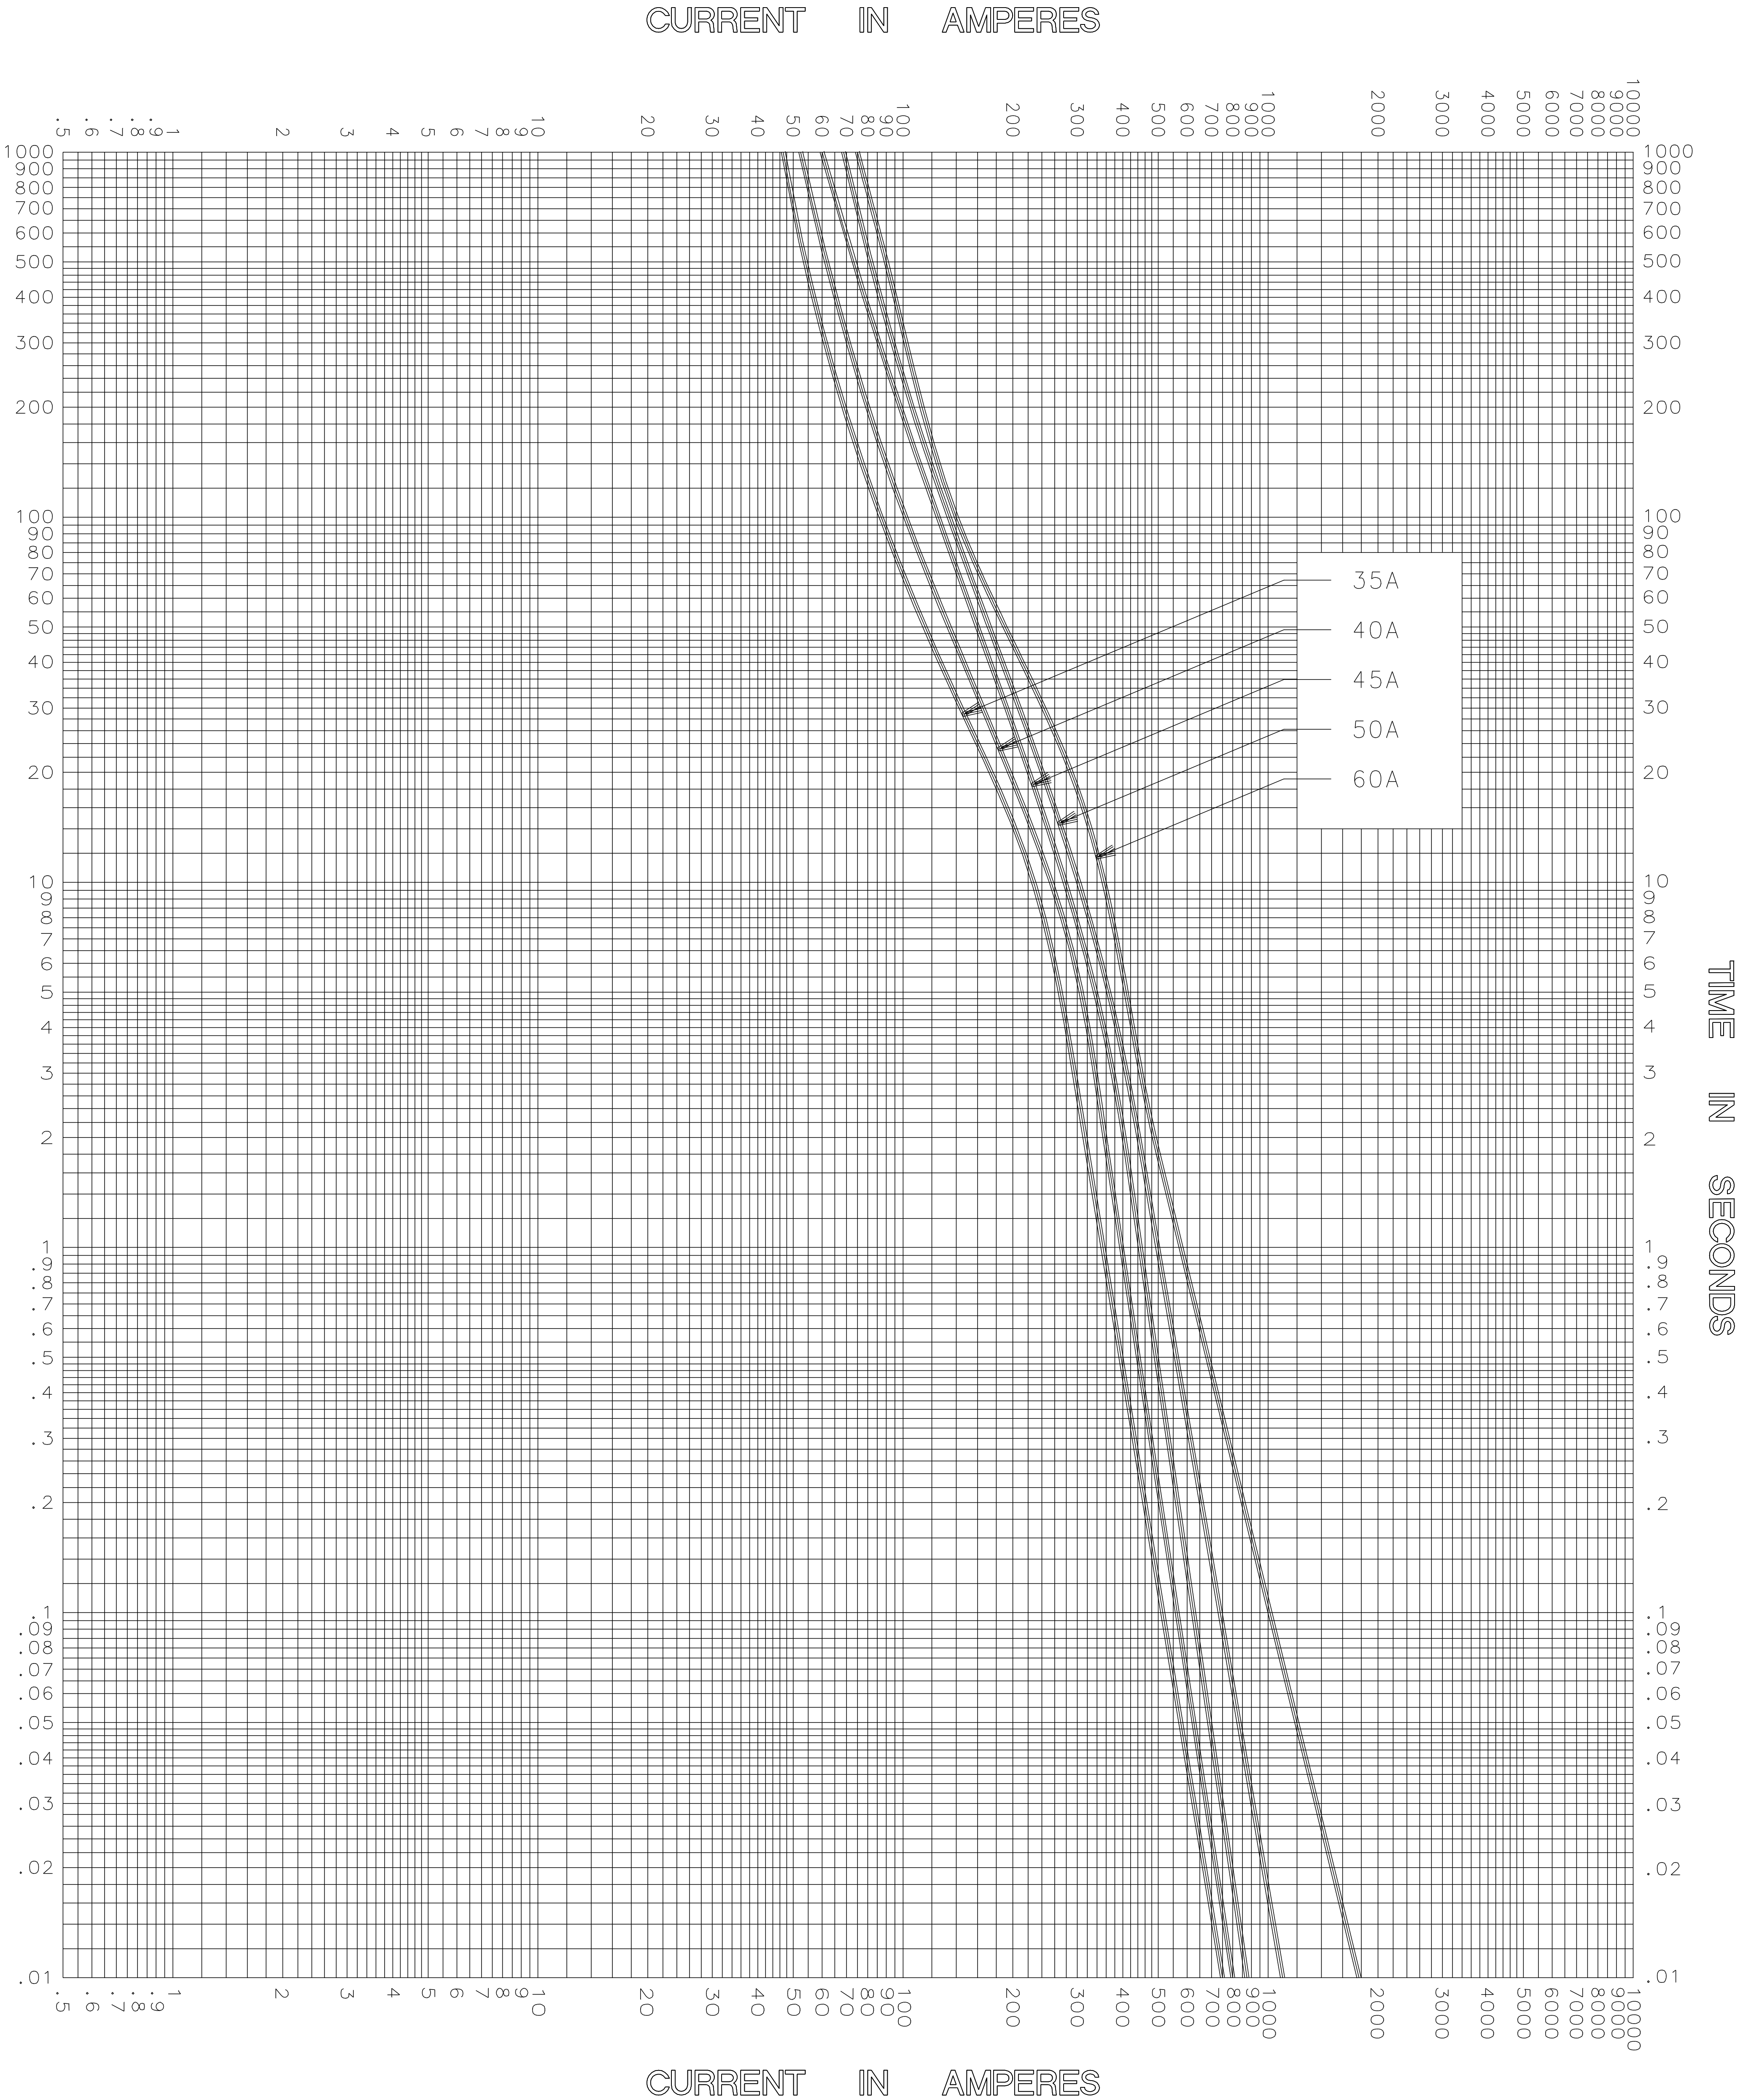

LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 04/11/05
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01 FLNR 0001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

TIME IN SECONDS

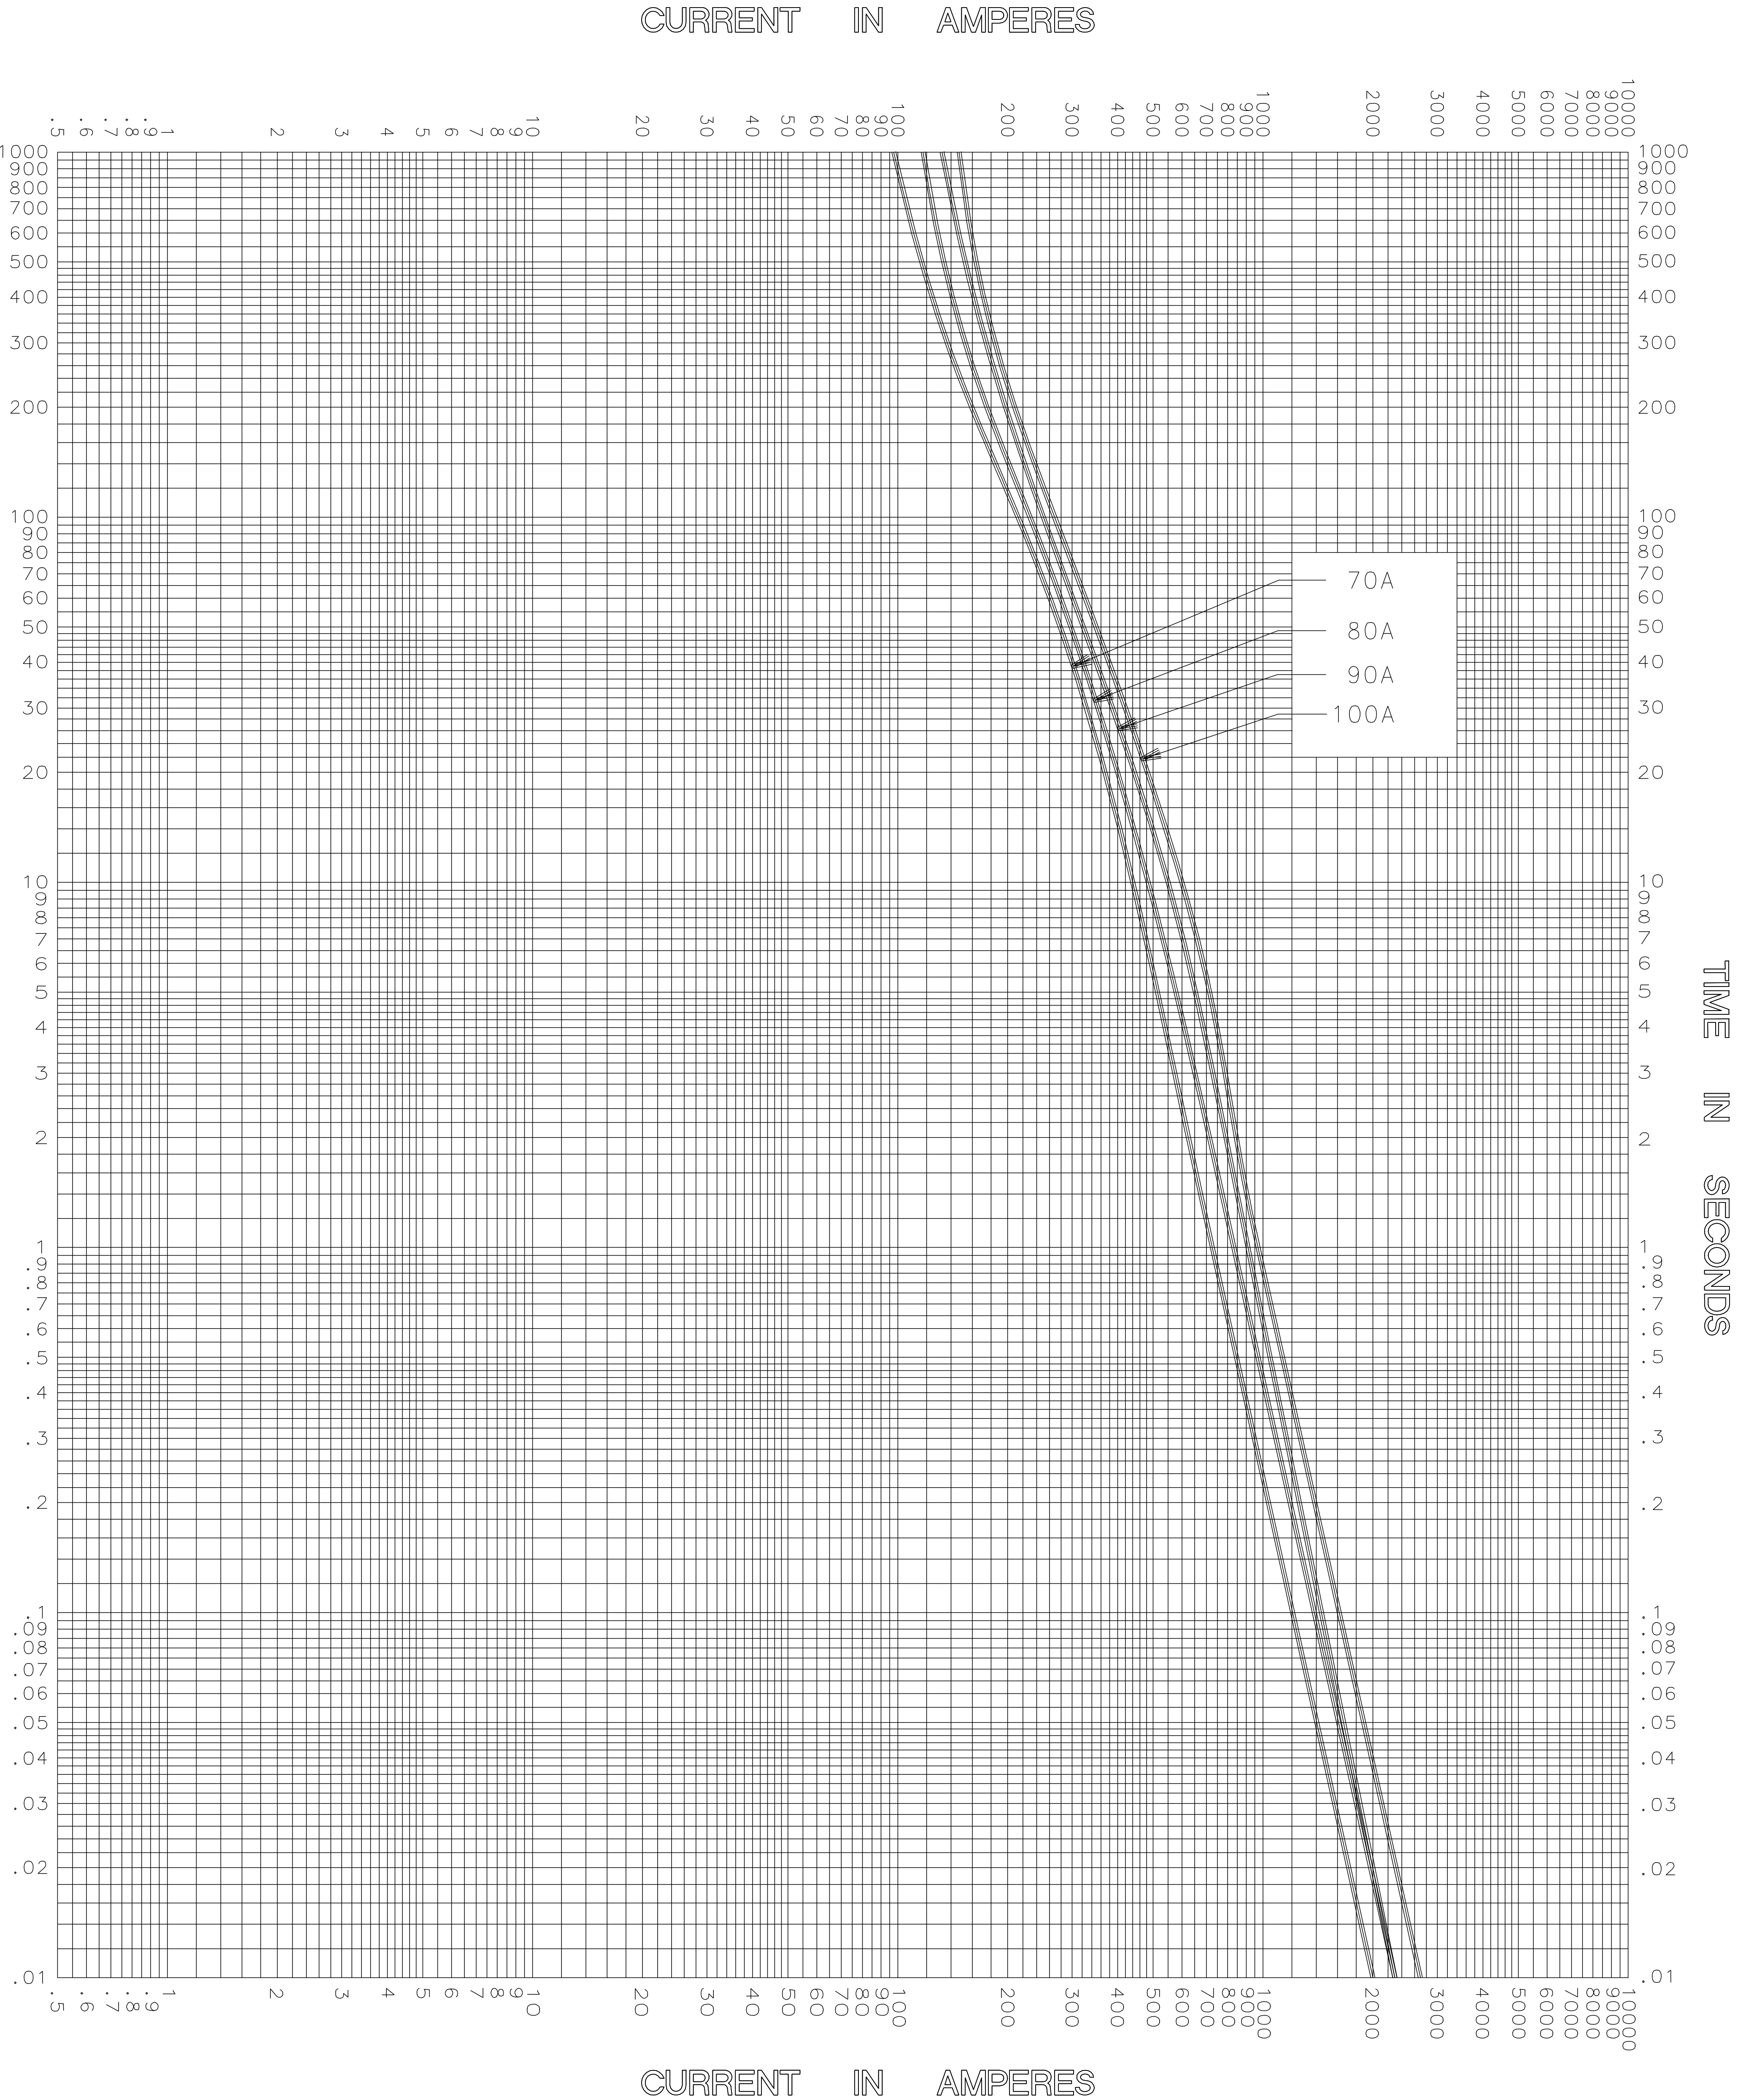


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		FLNR (70A - 100A) ID _____

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>04/11/05</u>
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC01</u> REV <u>002</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

TIME IN SECONDS

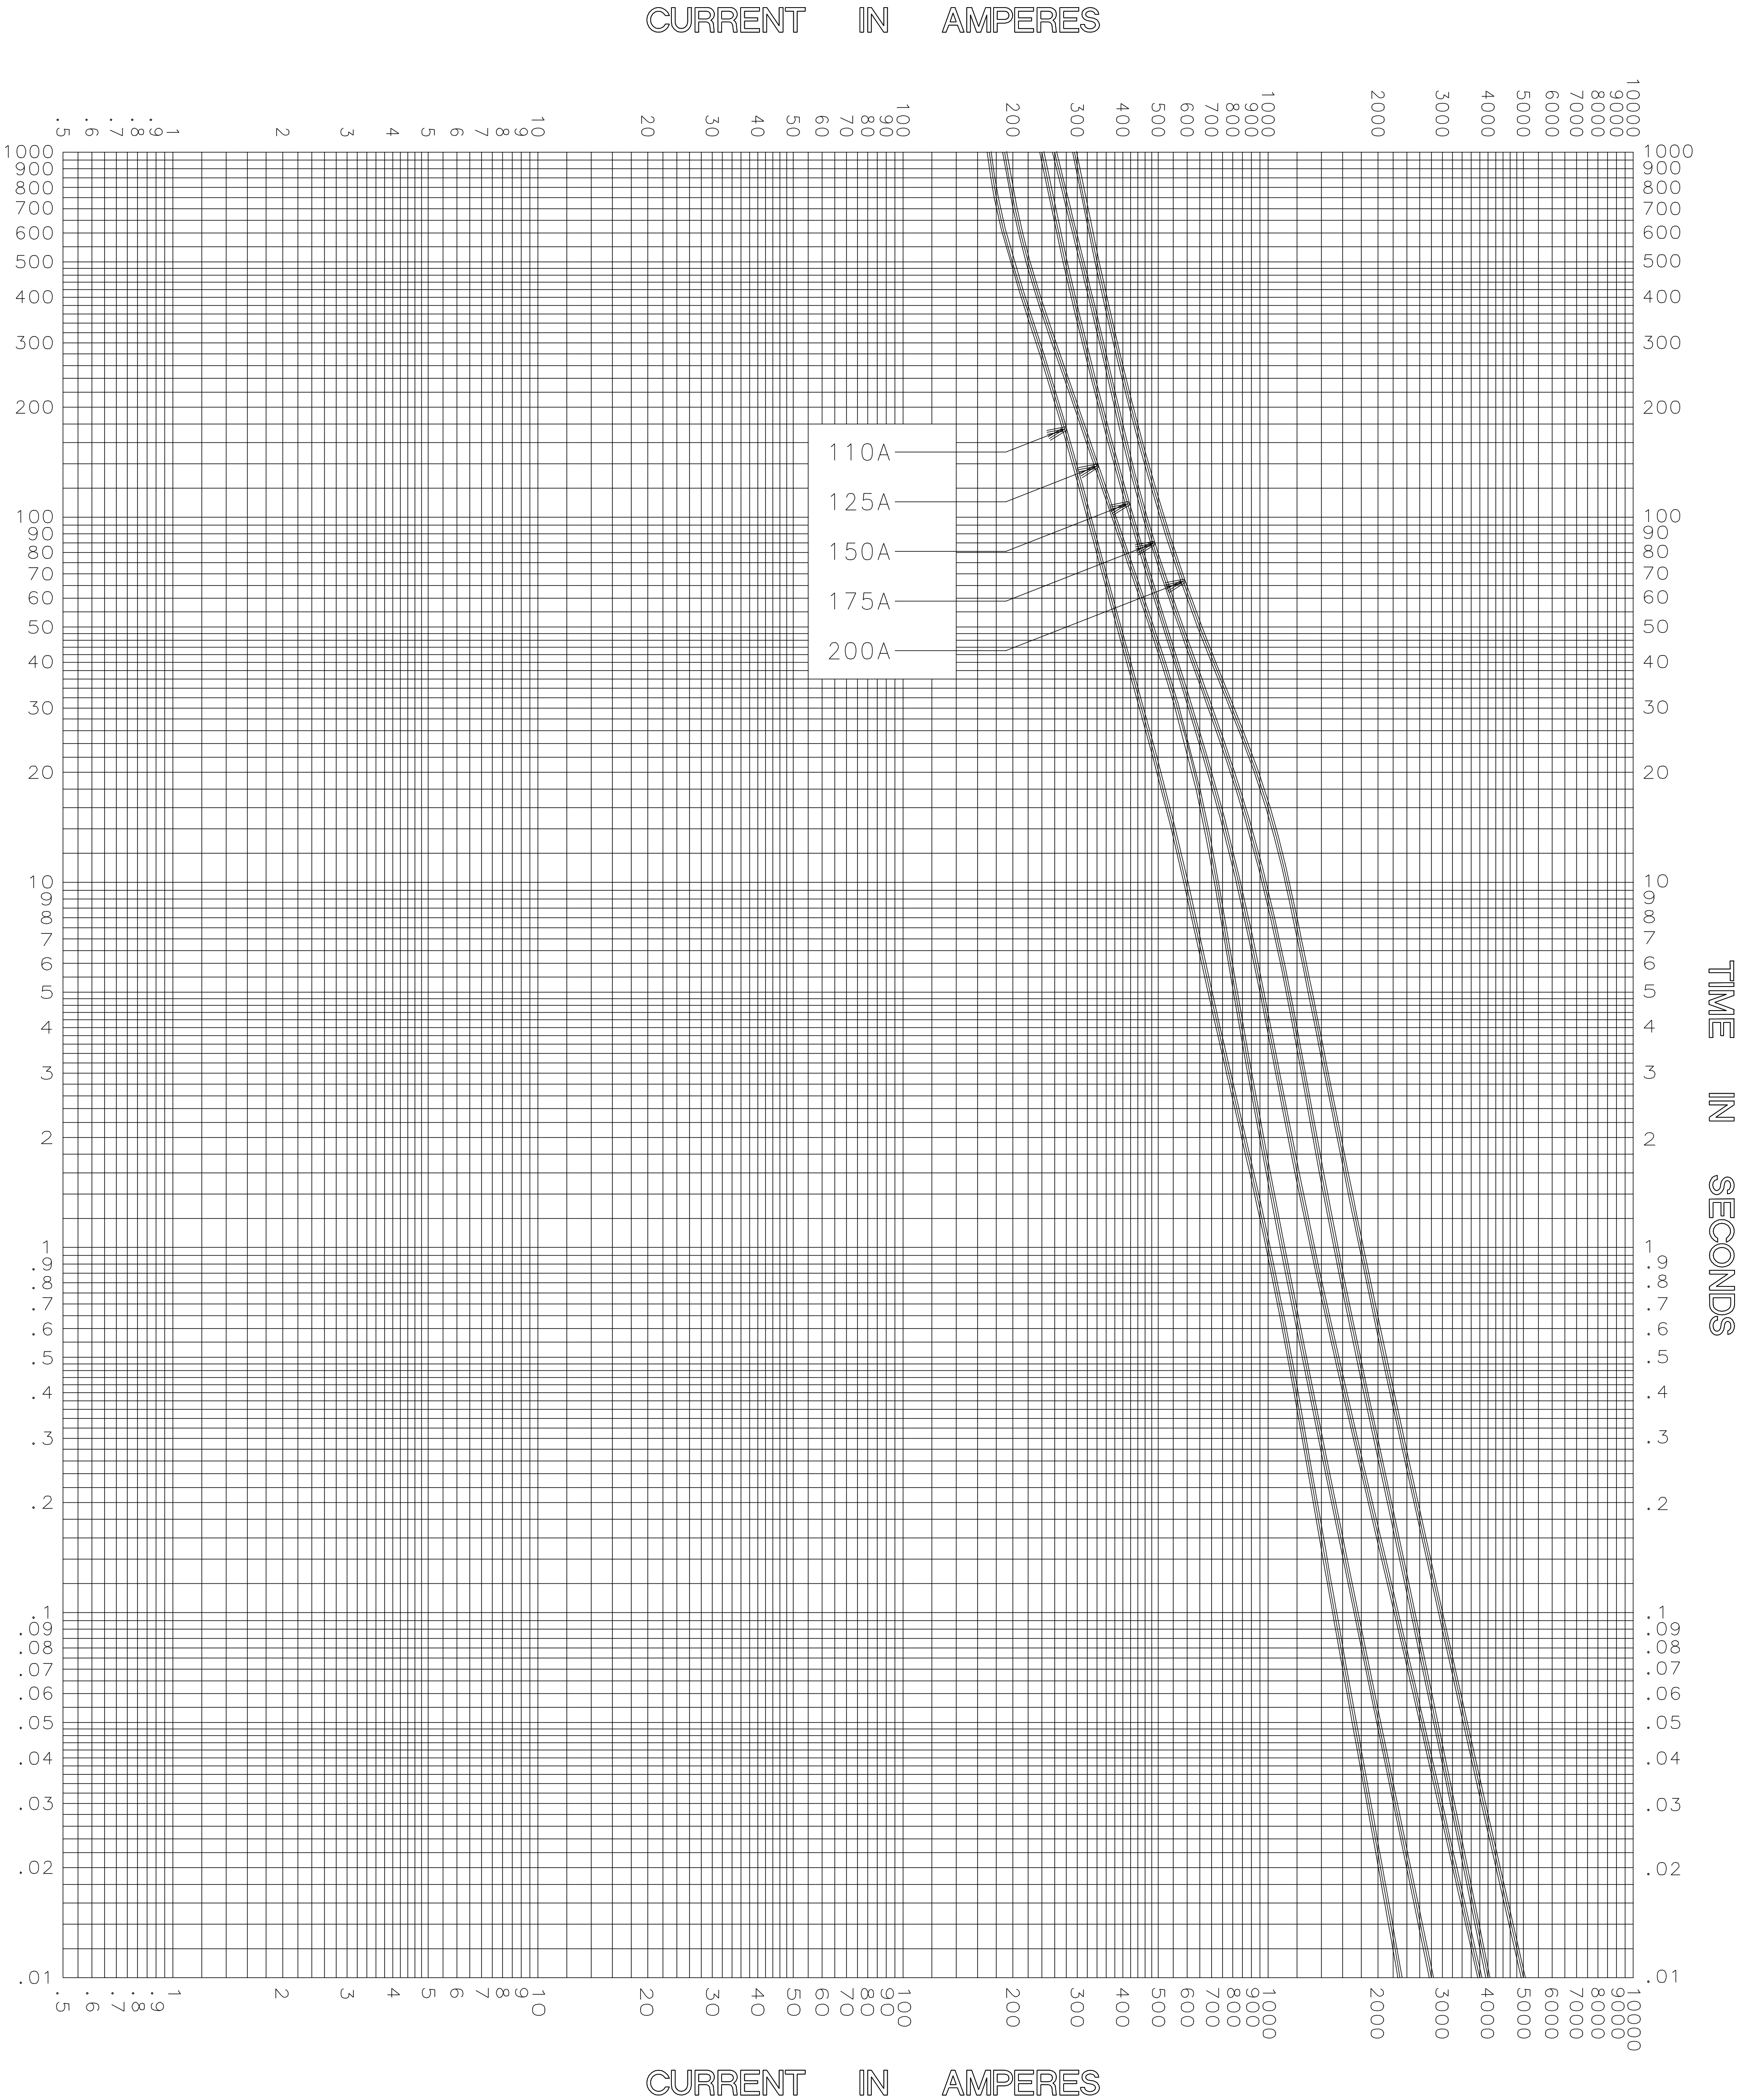

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLNR (110A - 200A) ID _____



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 04/11/05
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-500000003

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

SECONDS IN MIN.

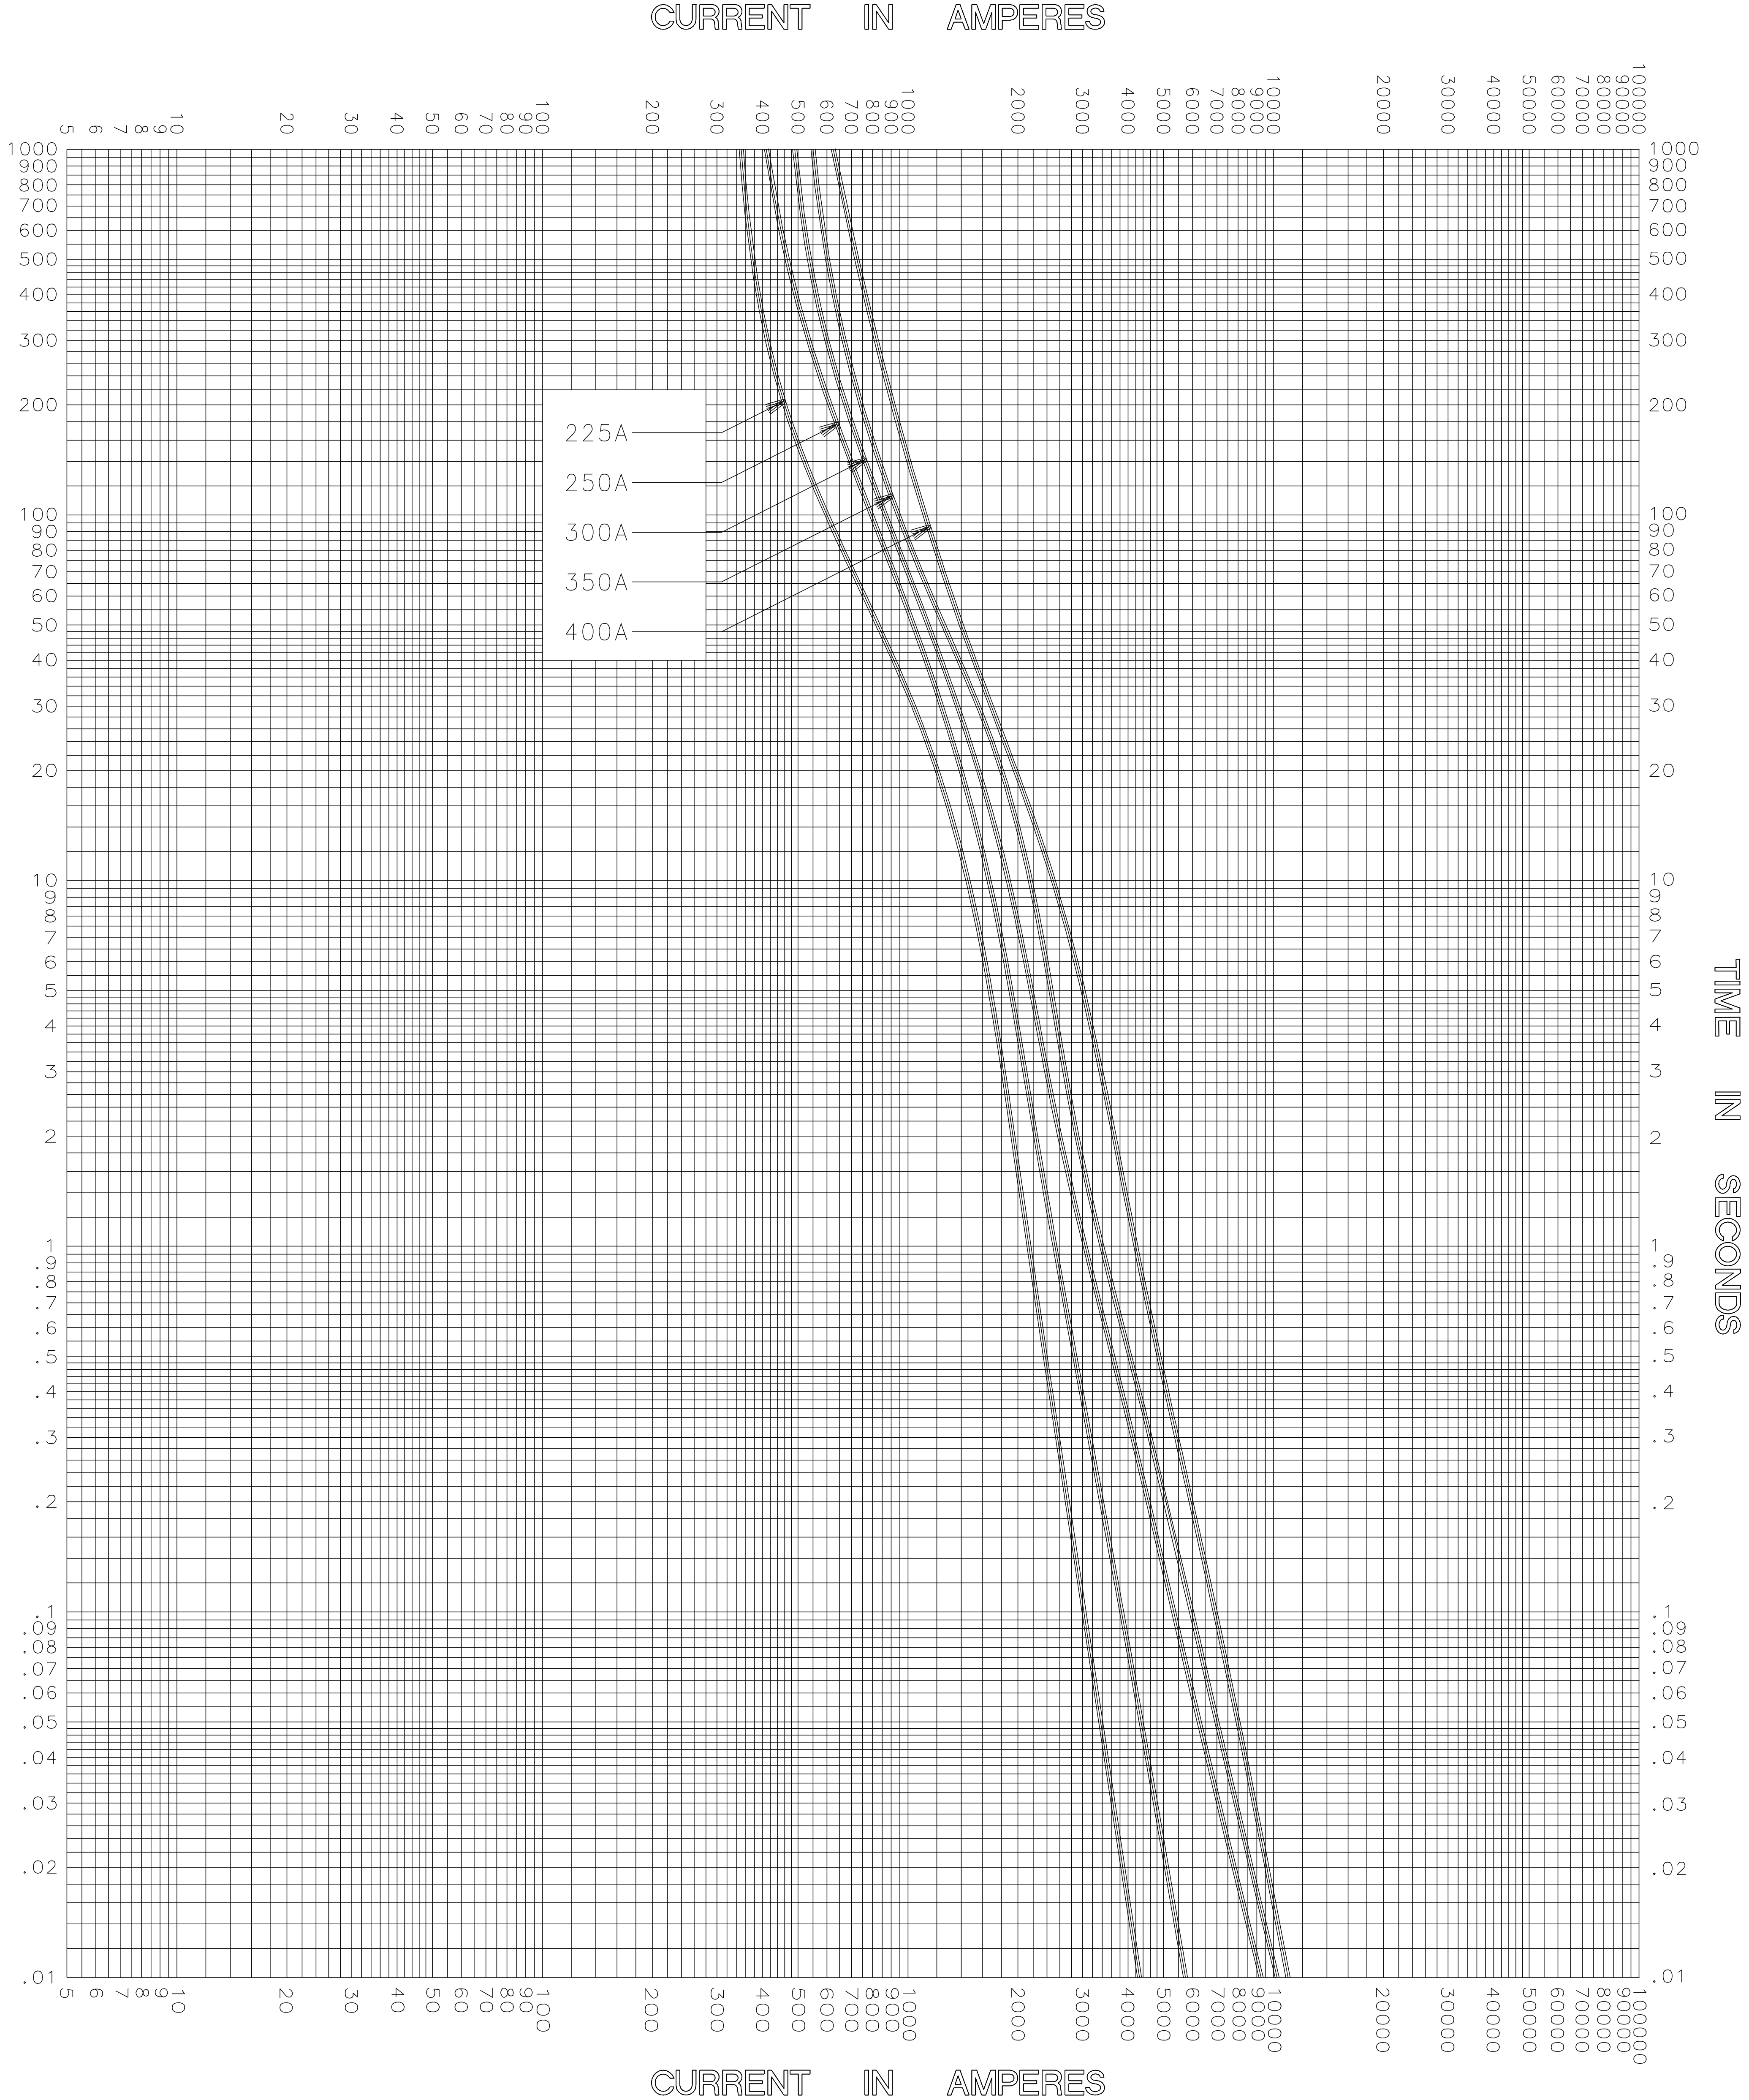

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLNR (225A - 400A) ID _____



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 04/11/05
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-FLNR (225A - 400A) 004

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

SECONDS IN MIN.

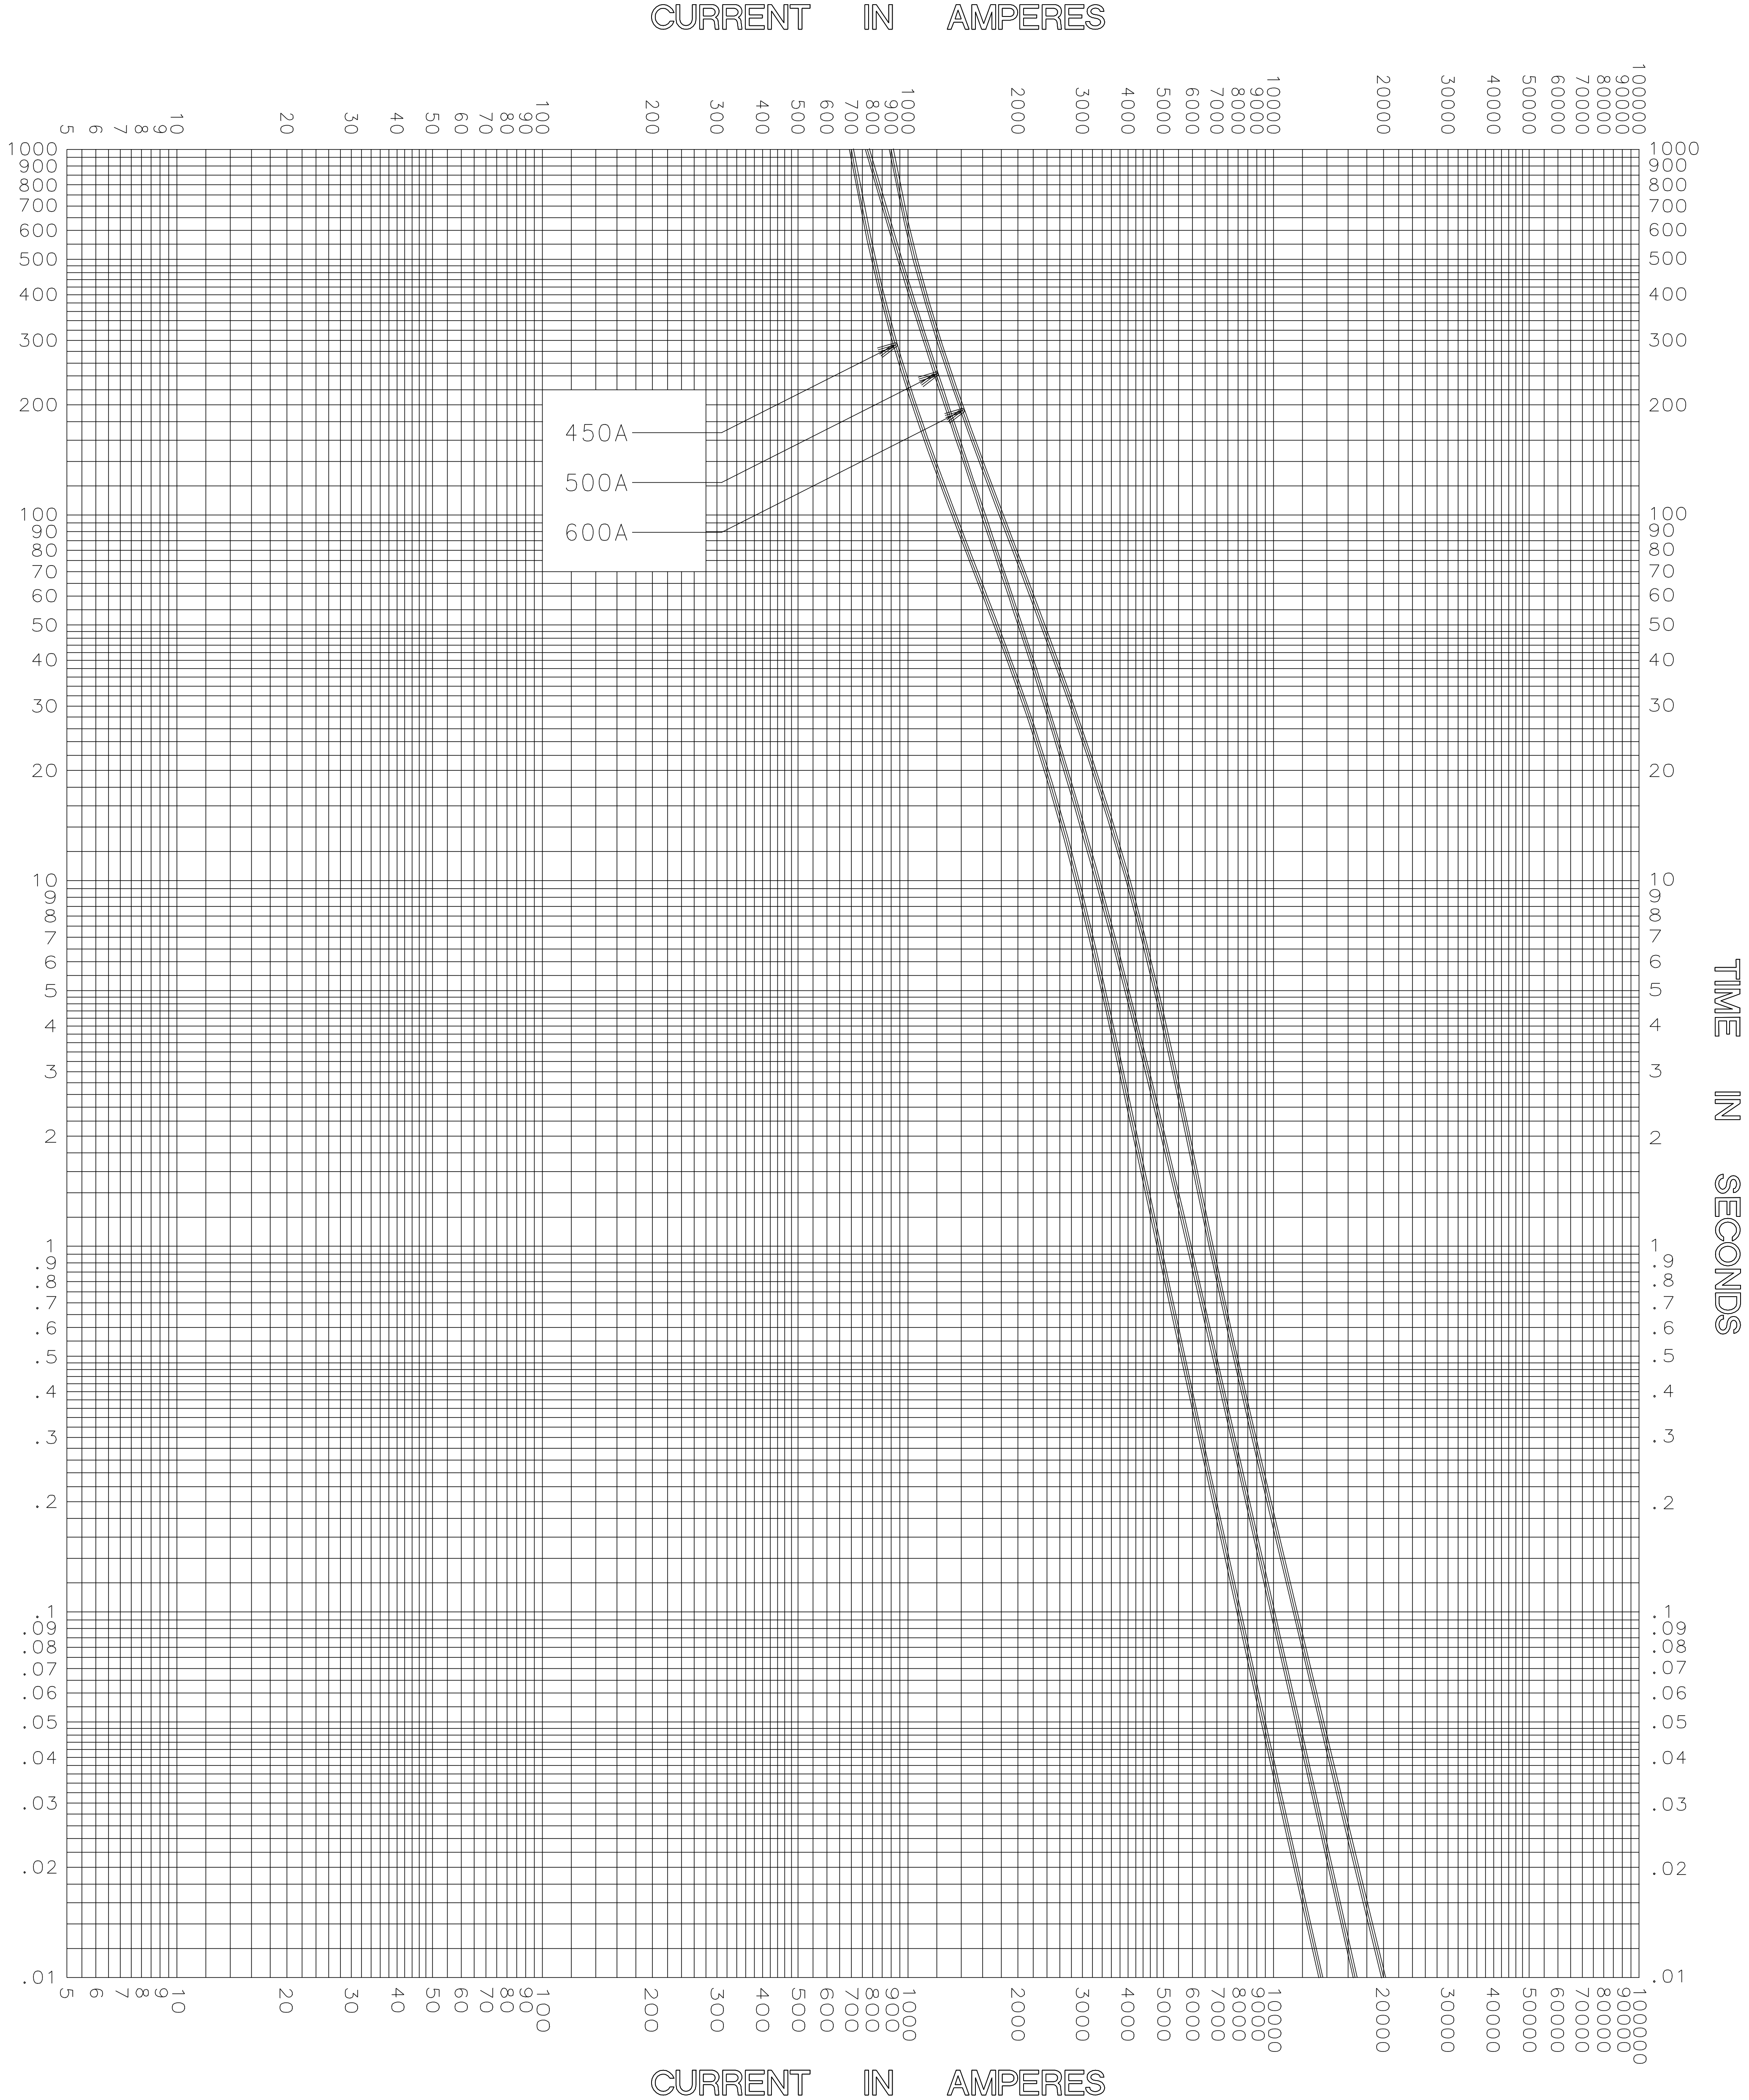

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLNR (450A - 600A) ID _____



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 04/11/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-5 NR 10005

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT