


CURRENT IN AMPERES

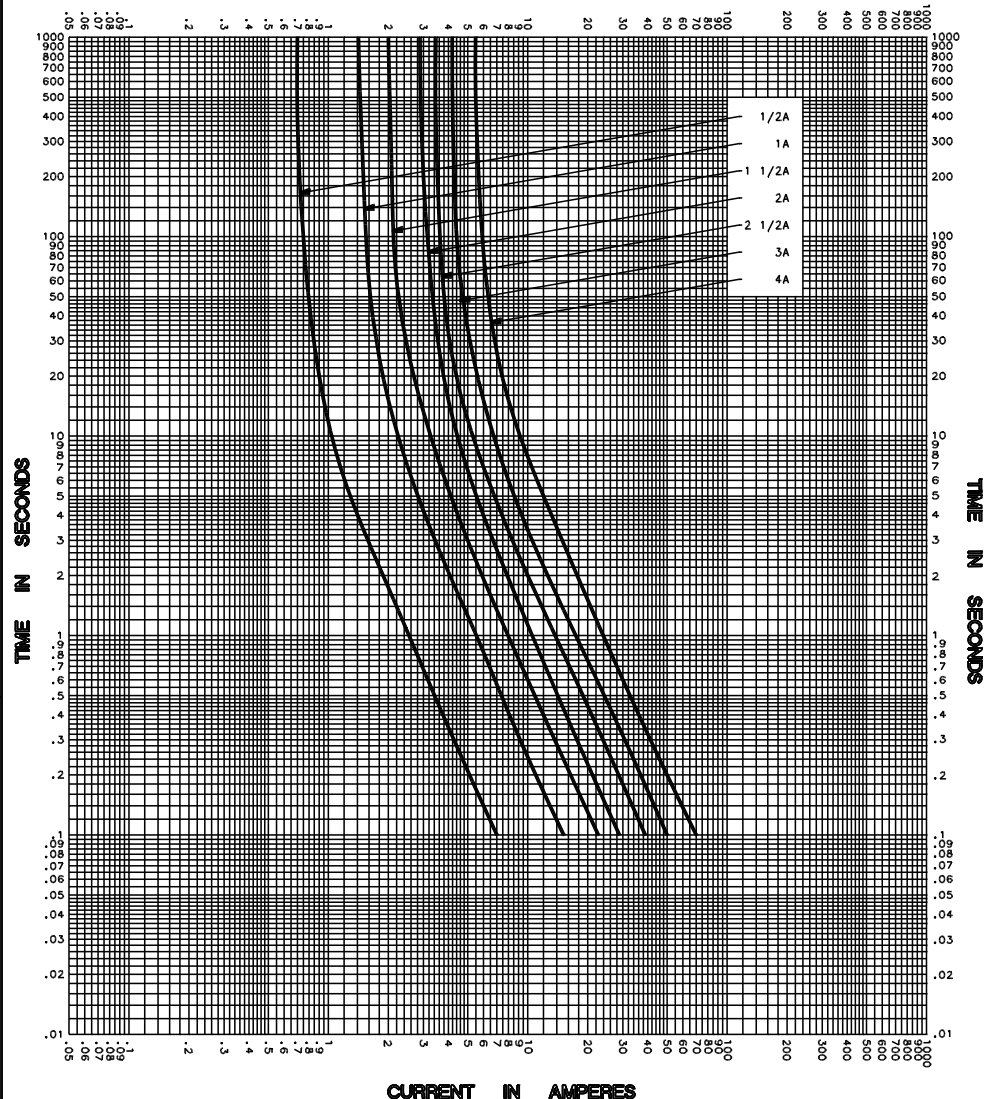

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER _____
BASIS FOR DATA _____		BLF (1/2A - 4A)


 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY MRD
	DATE 02/17/03
	CHECKED BY TN
DRAWING NO. B-FCC001	

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

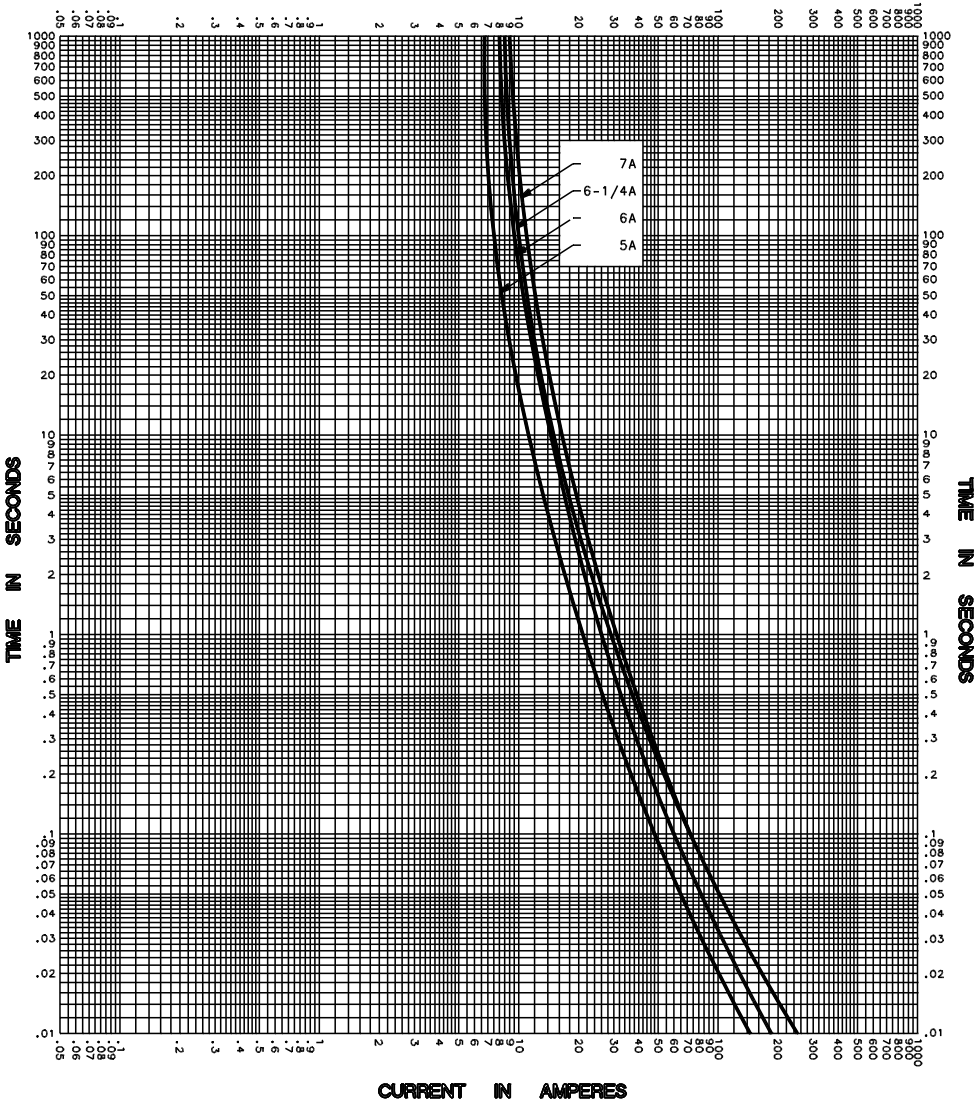


CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	BLF (5A - 7A)
 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 02/10/05
	CHECKED BY MP
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC0172

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

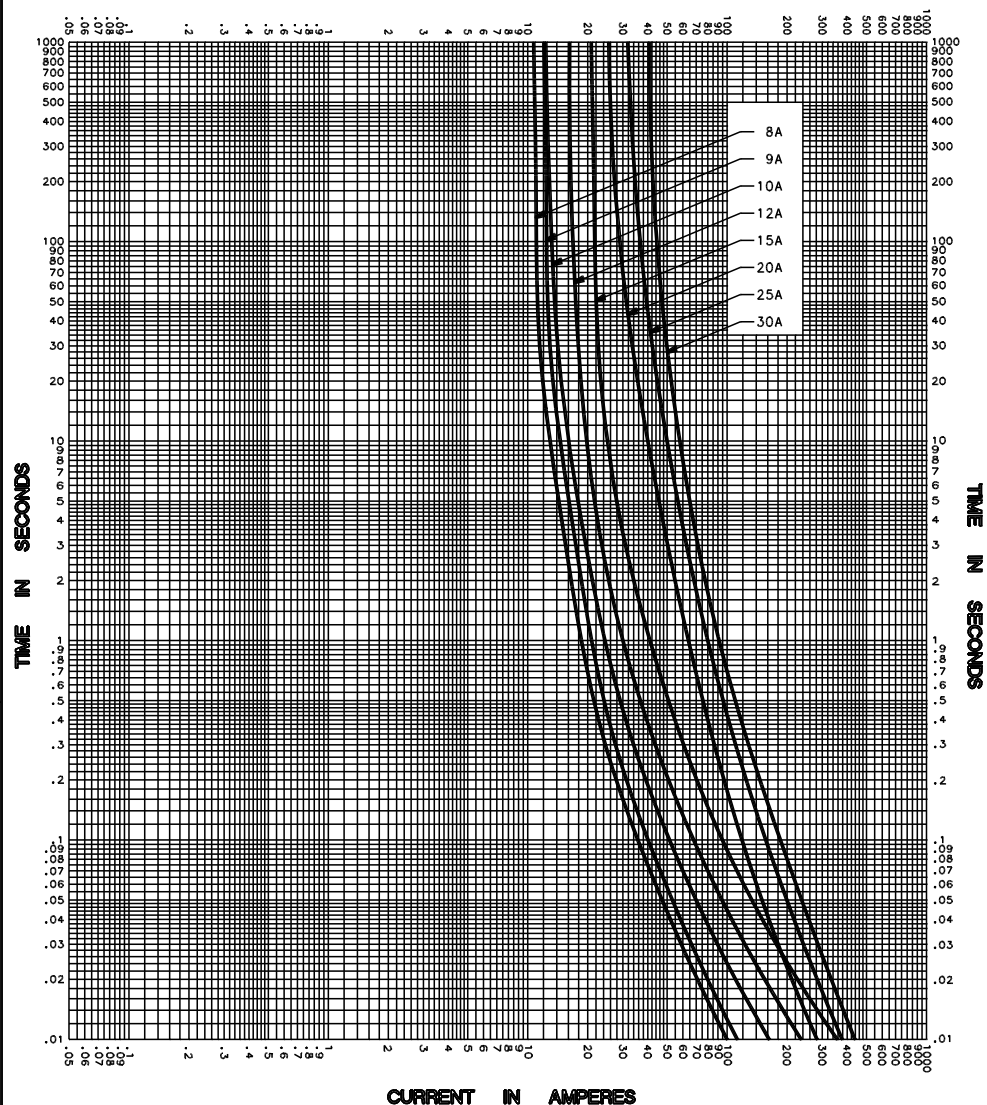

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		BLF (8A - 30A)

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>02/10/05</u> CHECKED BY <u>MP</u>
	TIME CURRENT CHARACTERISTIC CURVES DRAWING NO. <u>A-FCC001</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT