


**AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES**

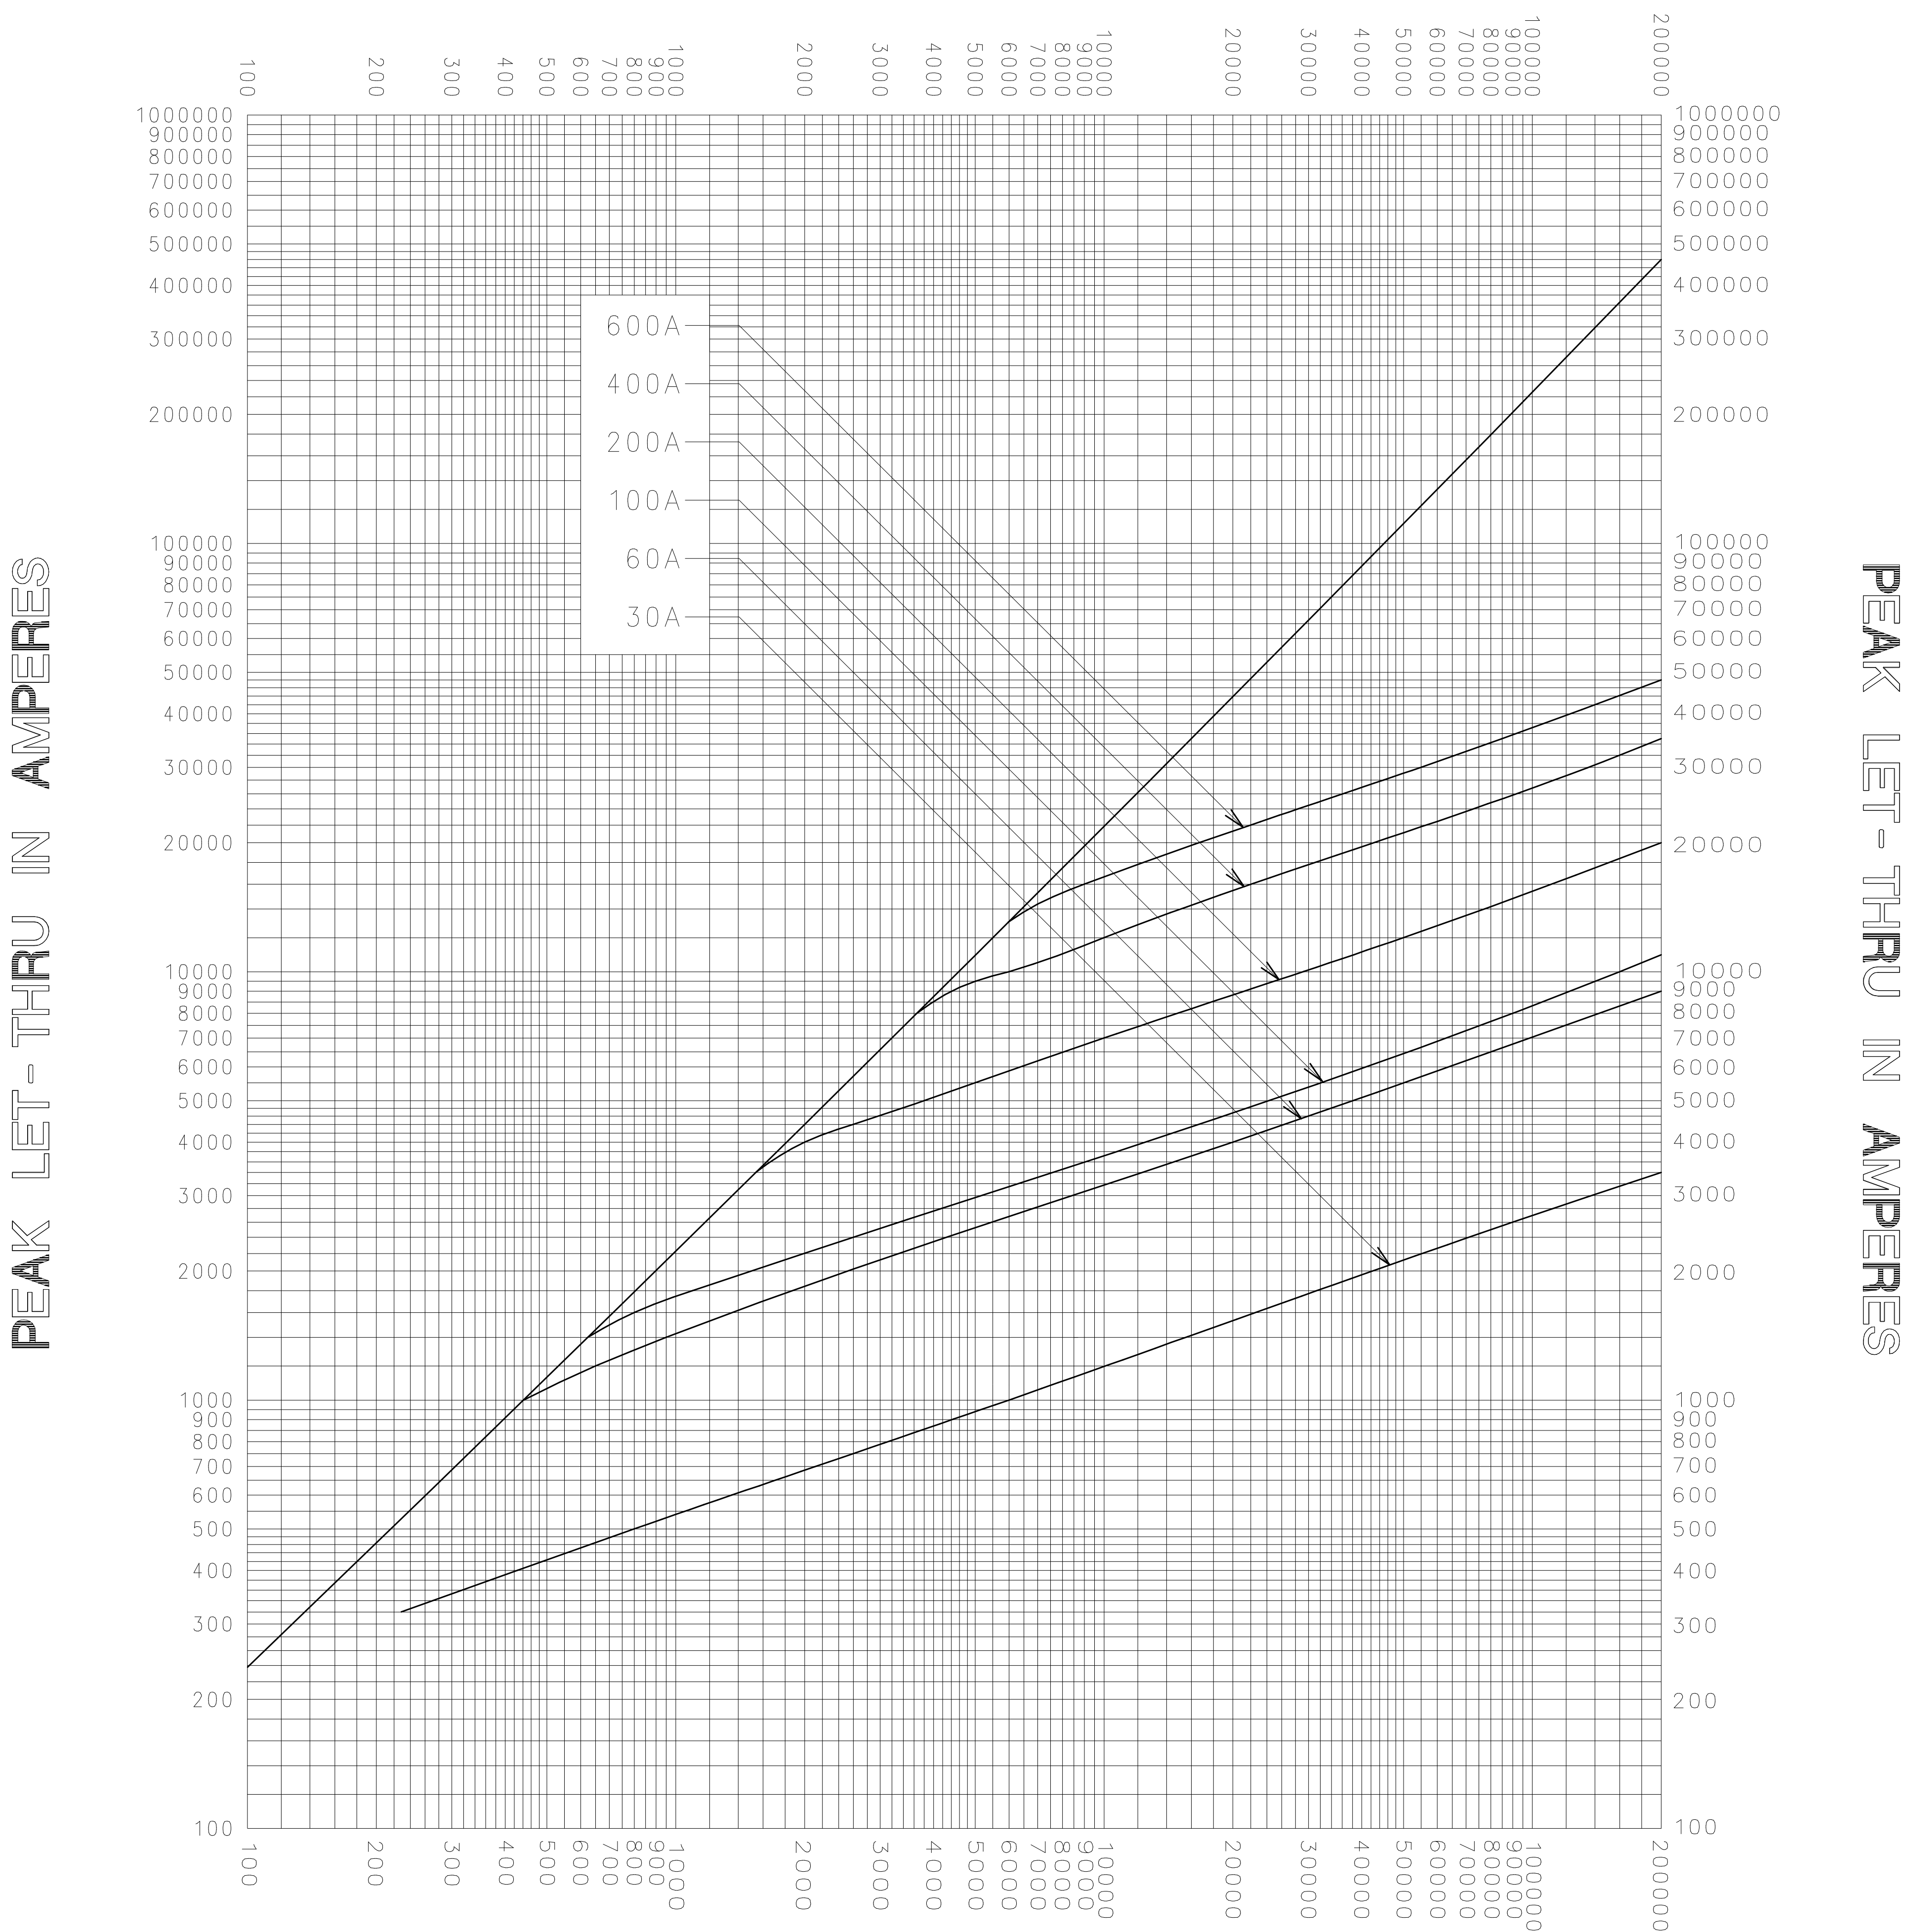

**AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER KLNR (30A - 600A)
---	--

<b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>09/06/06</u> CHECKED BY <u>MP</u>
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>	DRAWING NO. <u>A-FCC05-14001</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT