



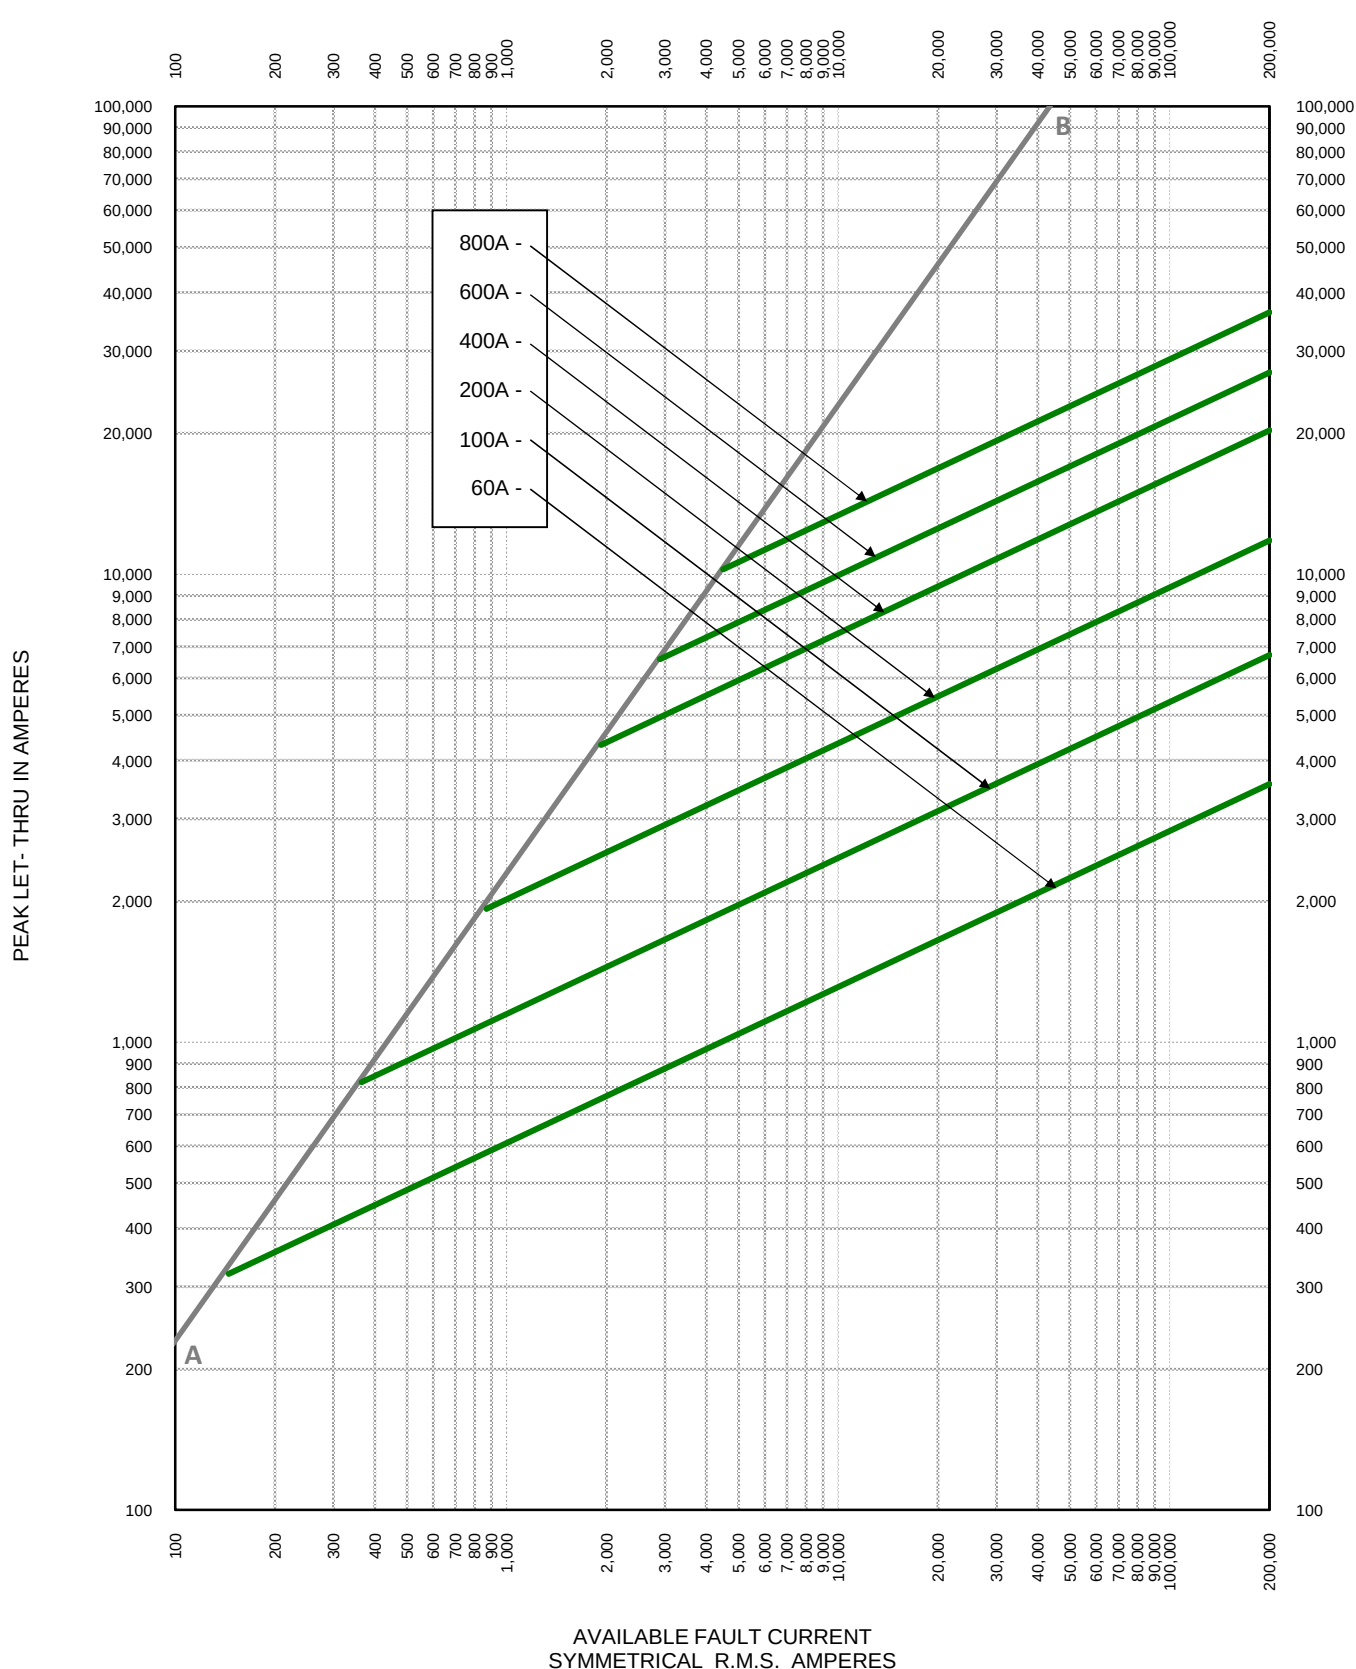

TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor			L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 10/13/2015	
PEAK LET-THRU CHARACTERISTIC CURVES		REVISION: C	
		DRAWING NO.: FCC05-L70QS SHEET 2 OF 8	


PEAK LET- THRU IN AMPERES

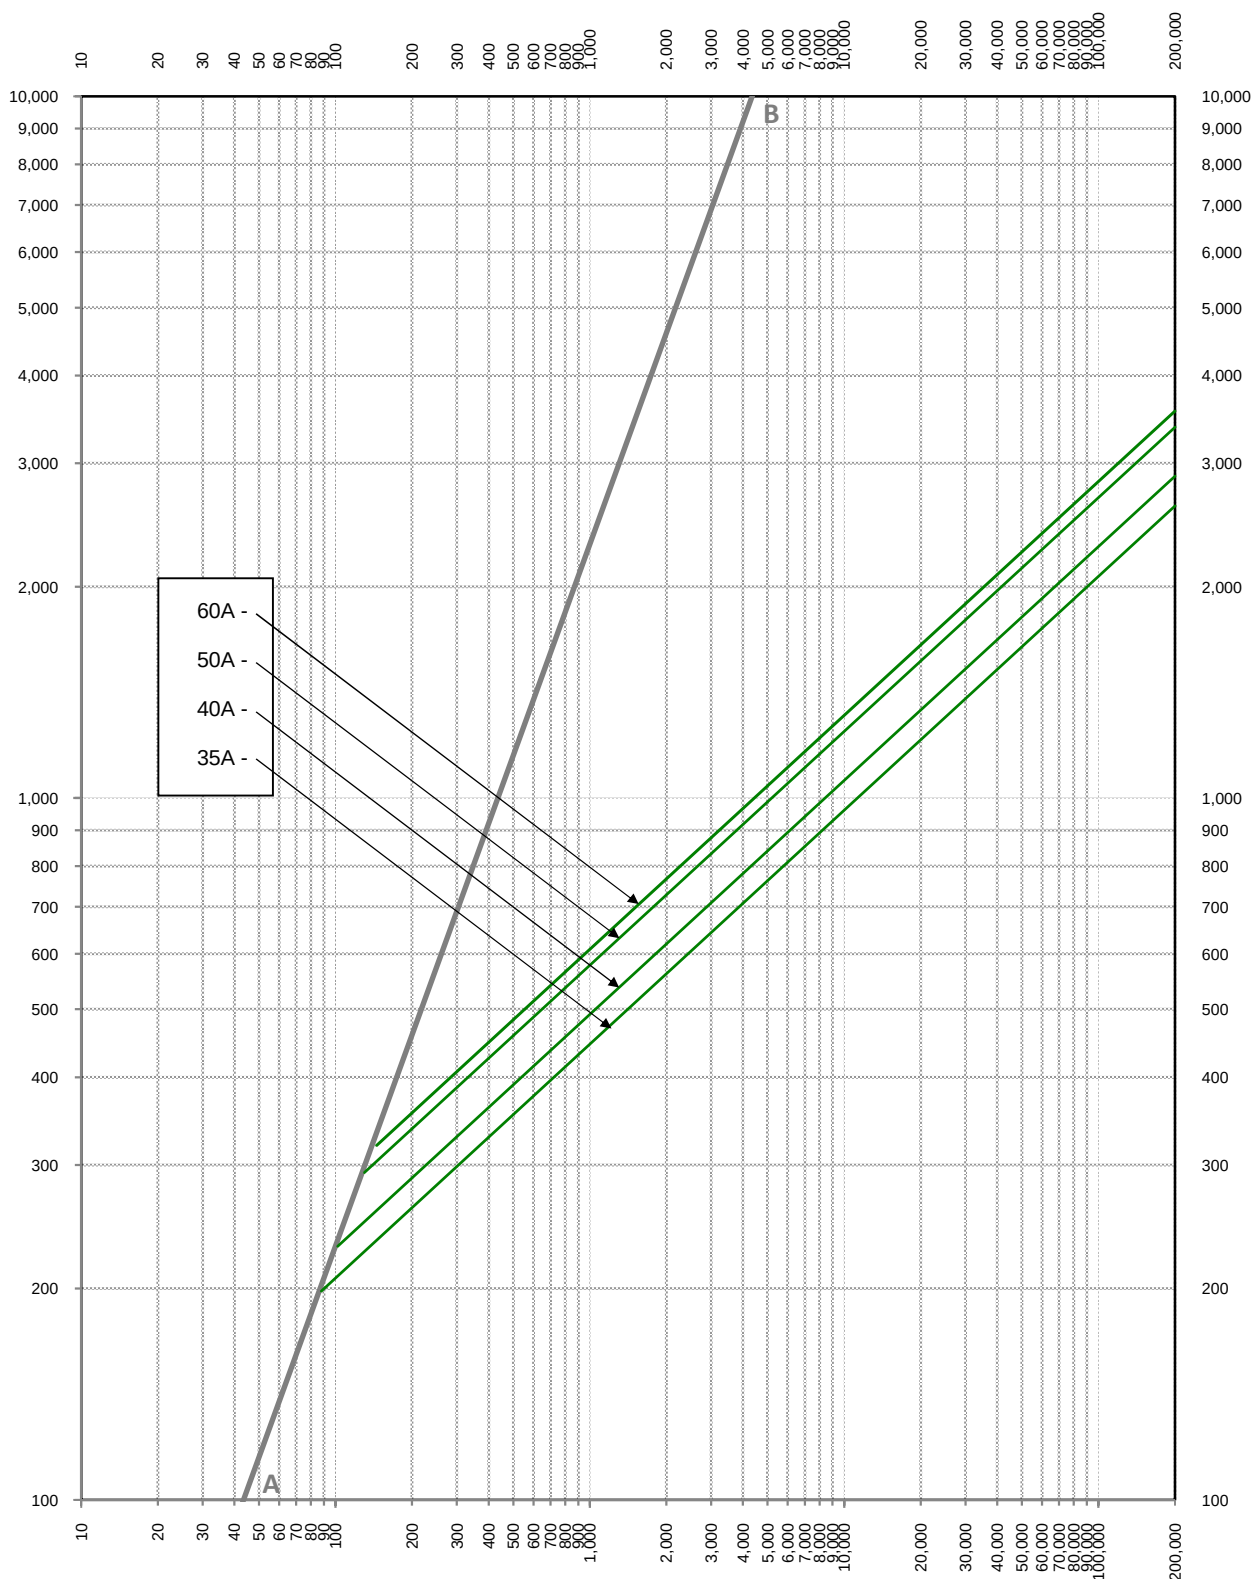

AVAILABLE FAULT CURRENT
SYMMETRICAL R.M.S. AMPERES

TEST VOLTAGE: TIME CONSTANT/POWER FACTOR: BASIS FOR DATA: AB = 15% Power Factor	FUSE CATALOG NUMBER: L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA PEAK LET-THRU CHARACTERISTIC CURVES	DRAWN BY: LLL DATE: 10/13/2015 REVISION: C DRAWING NO.: FCC05-L70QS SHEET 3 OF 8


PEAK LET-THRU IN AMPERES

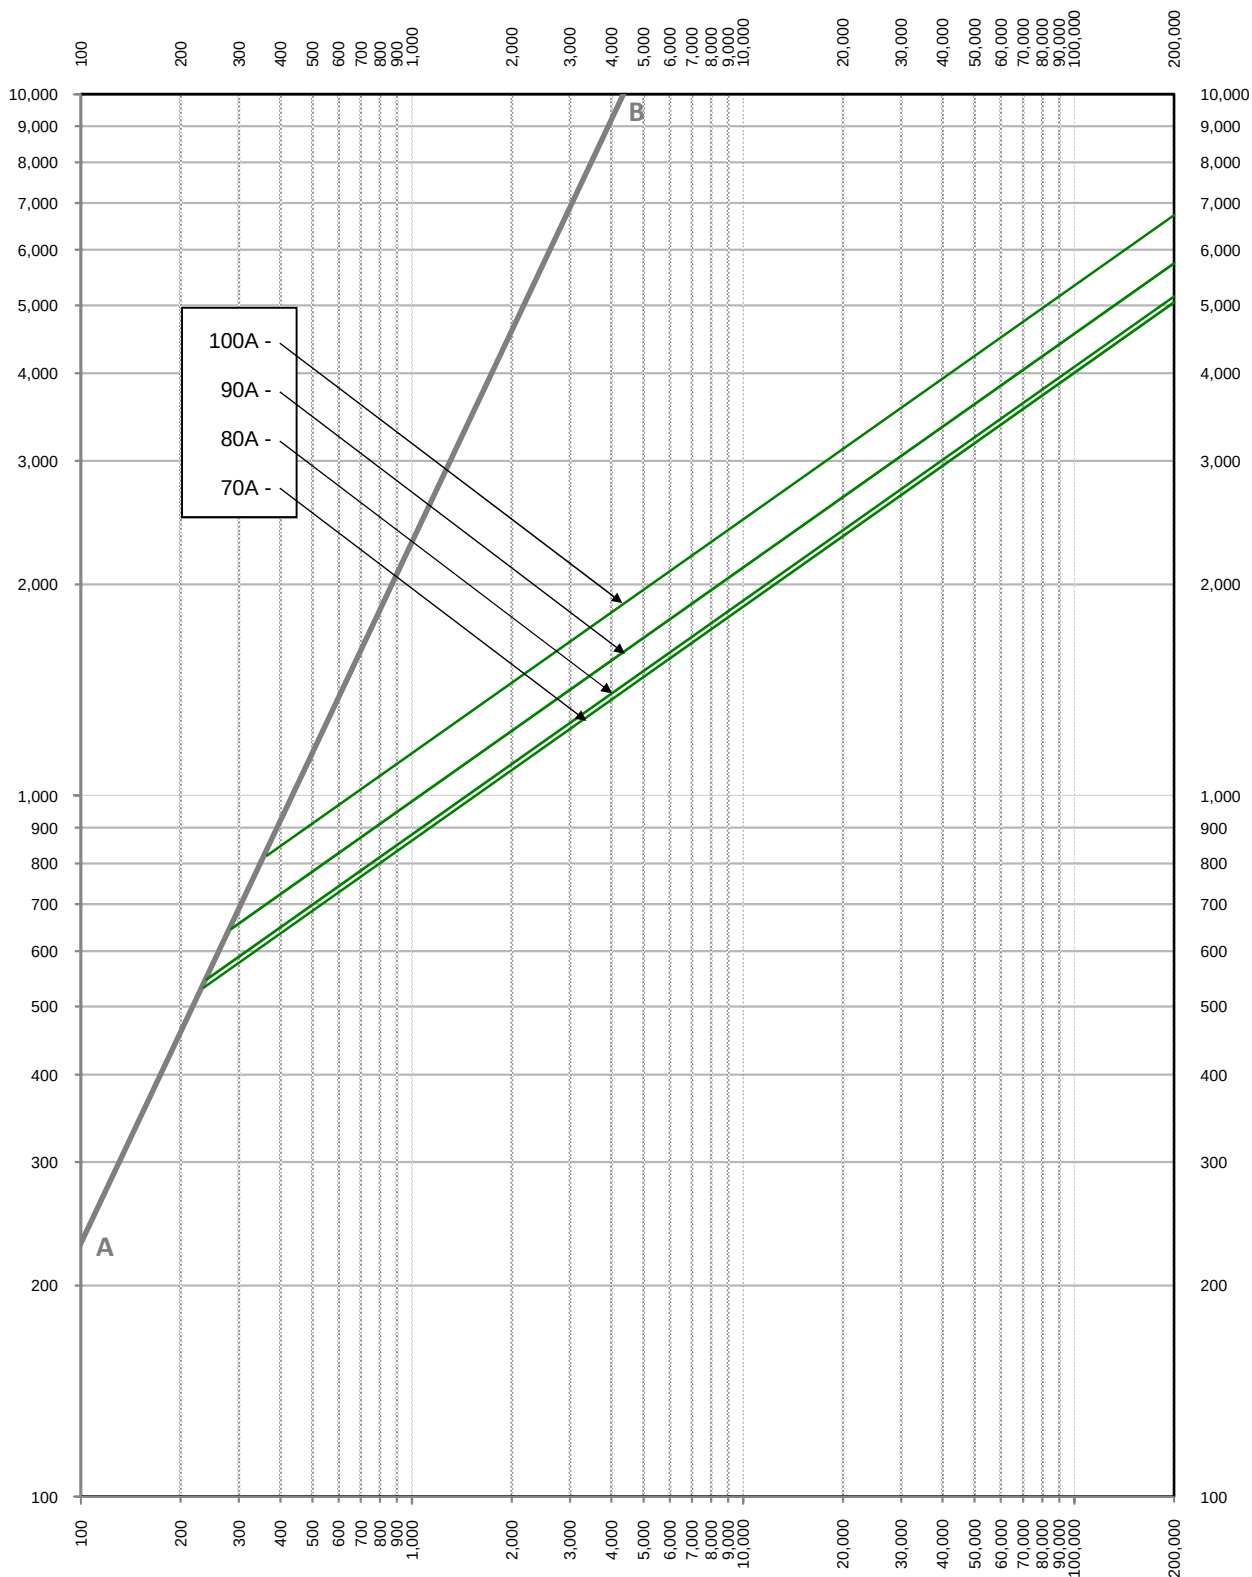

AVAILABLE FAULT CURRENT
SYMMETRICAL R.M.S. AMPERES

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 10/13/2015 REVISION: C
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO.: FCC05-L70QS SHEET 4 OF 8


PEAK LET- THRU IN AMPERES

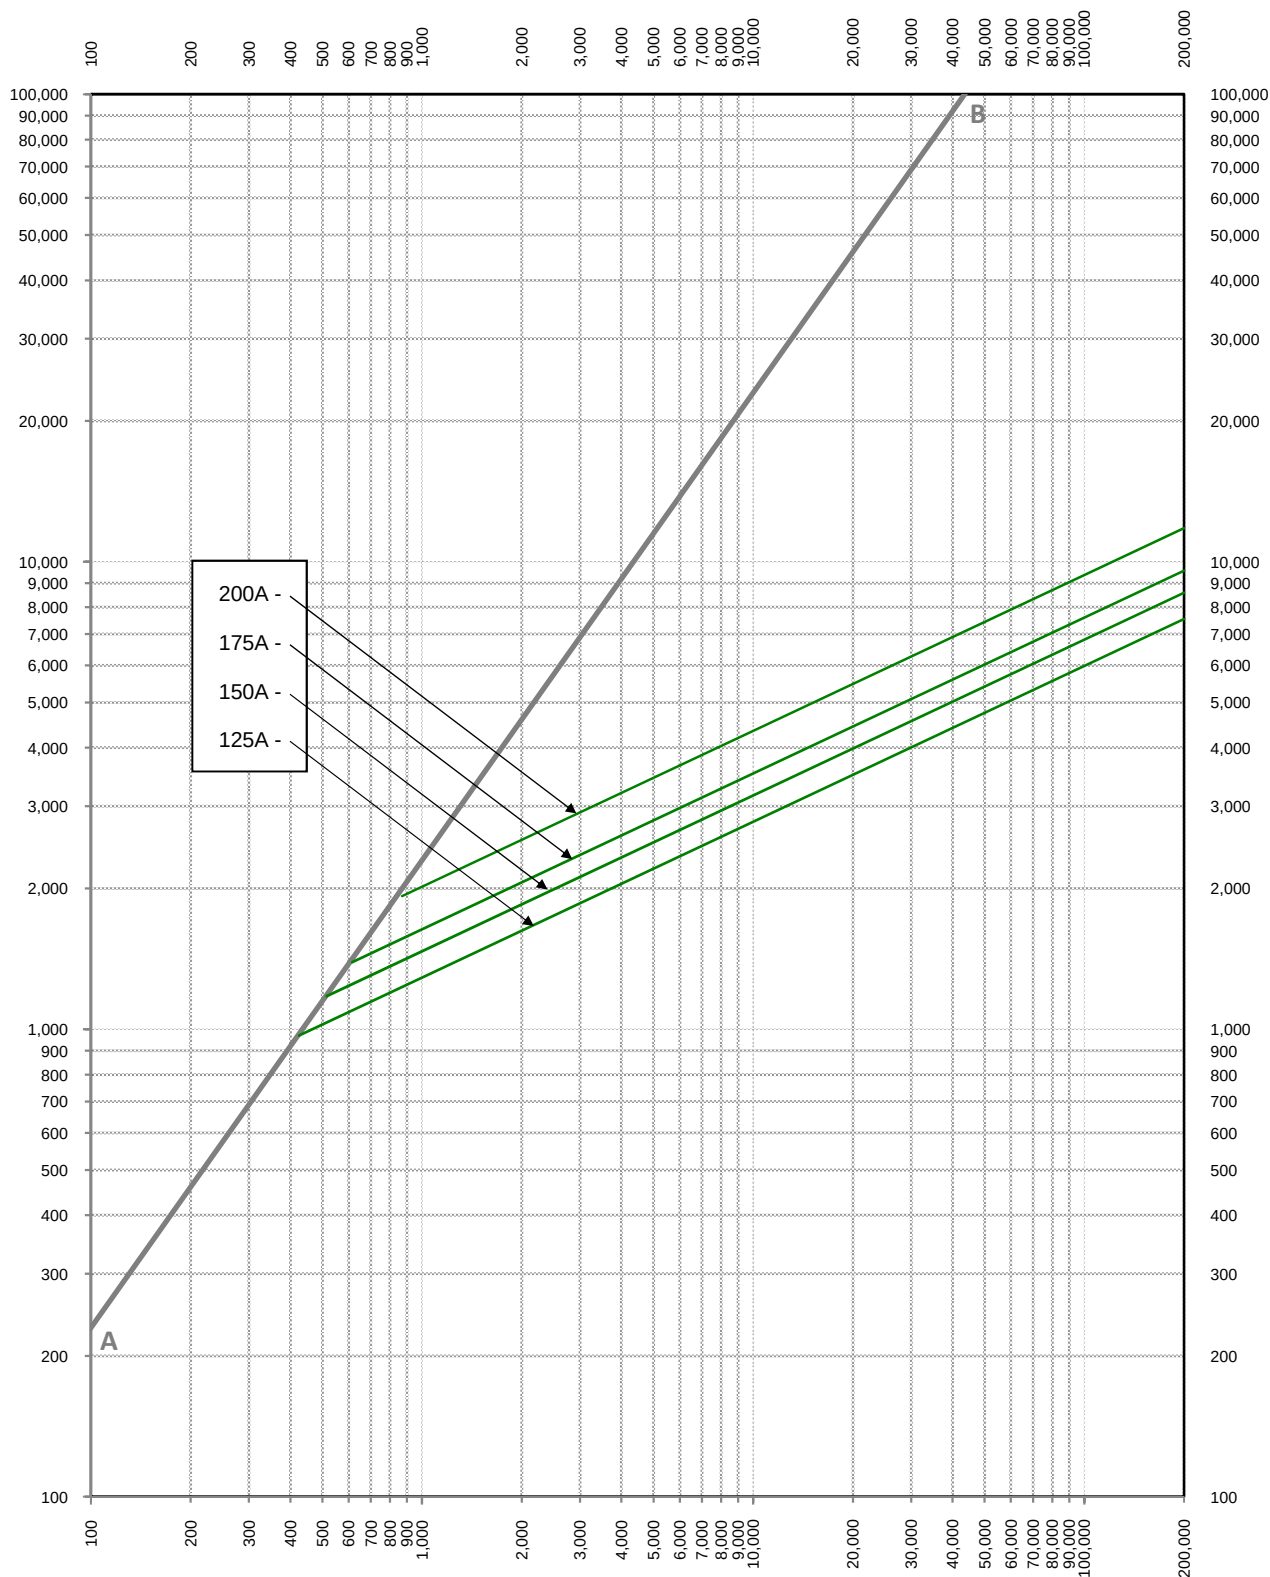

AVAILABLE FAULT CURRENT
SYMMETRICAL R.M.S. AMPERES


TEST VOLTAGE: TIME CONSTANT/POWER FACTOR: BASIS FOR DATA: AB = 15% Power Factor	FUSE CATALOG NUMBER: L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA	DRAWN BY: LLL DATE: 10/13/2015 REVISION: C
PEAK LET-THRU CHARACTERISTIC CURVES	DRAWING NO.: SHEET 5 OF 8 FCC05-L70QS

PEAK LET- THRU IN AMPERES

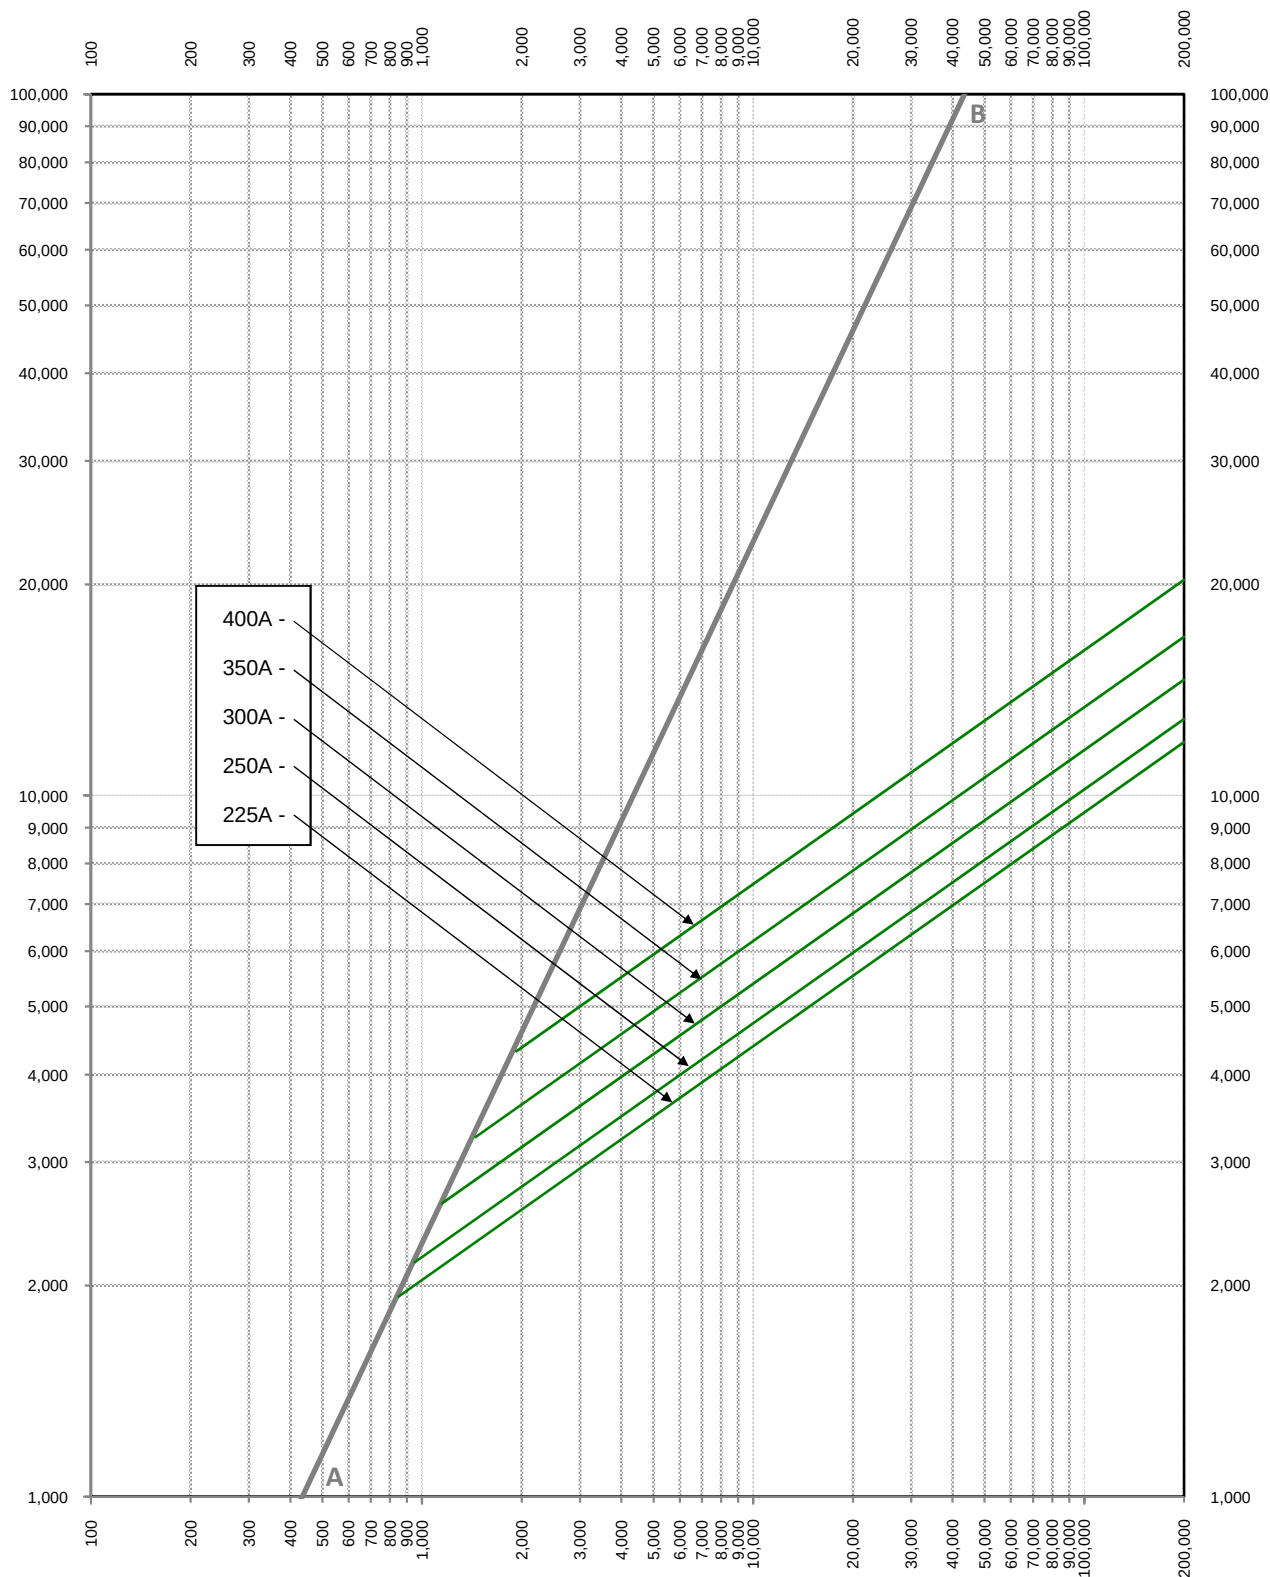


AVAILABLE FAULT CURRENT
SYMMETRICAL R.M.S. AMPERES

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 10/13/2015 REVISION: C
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO.: FCC05-L70QS SHEET 6 OF 8

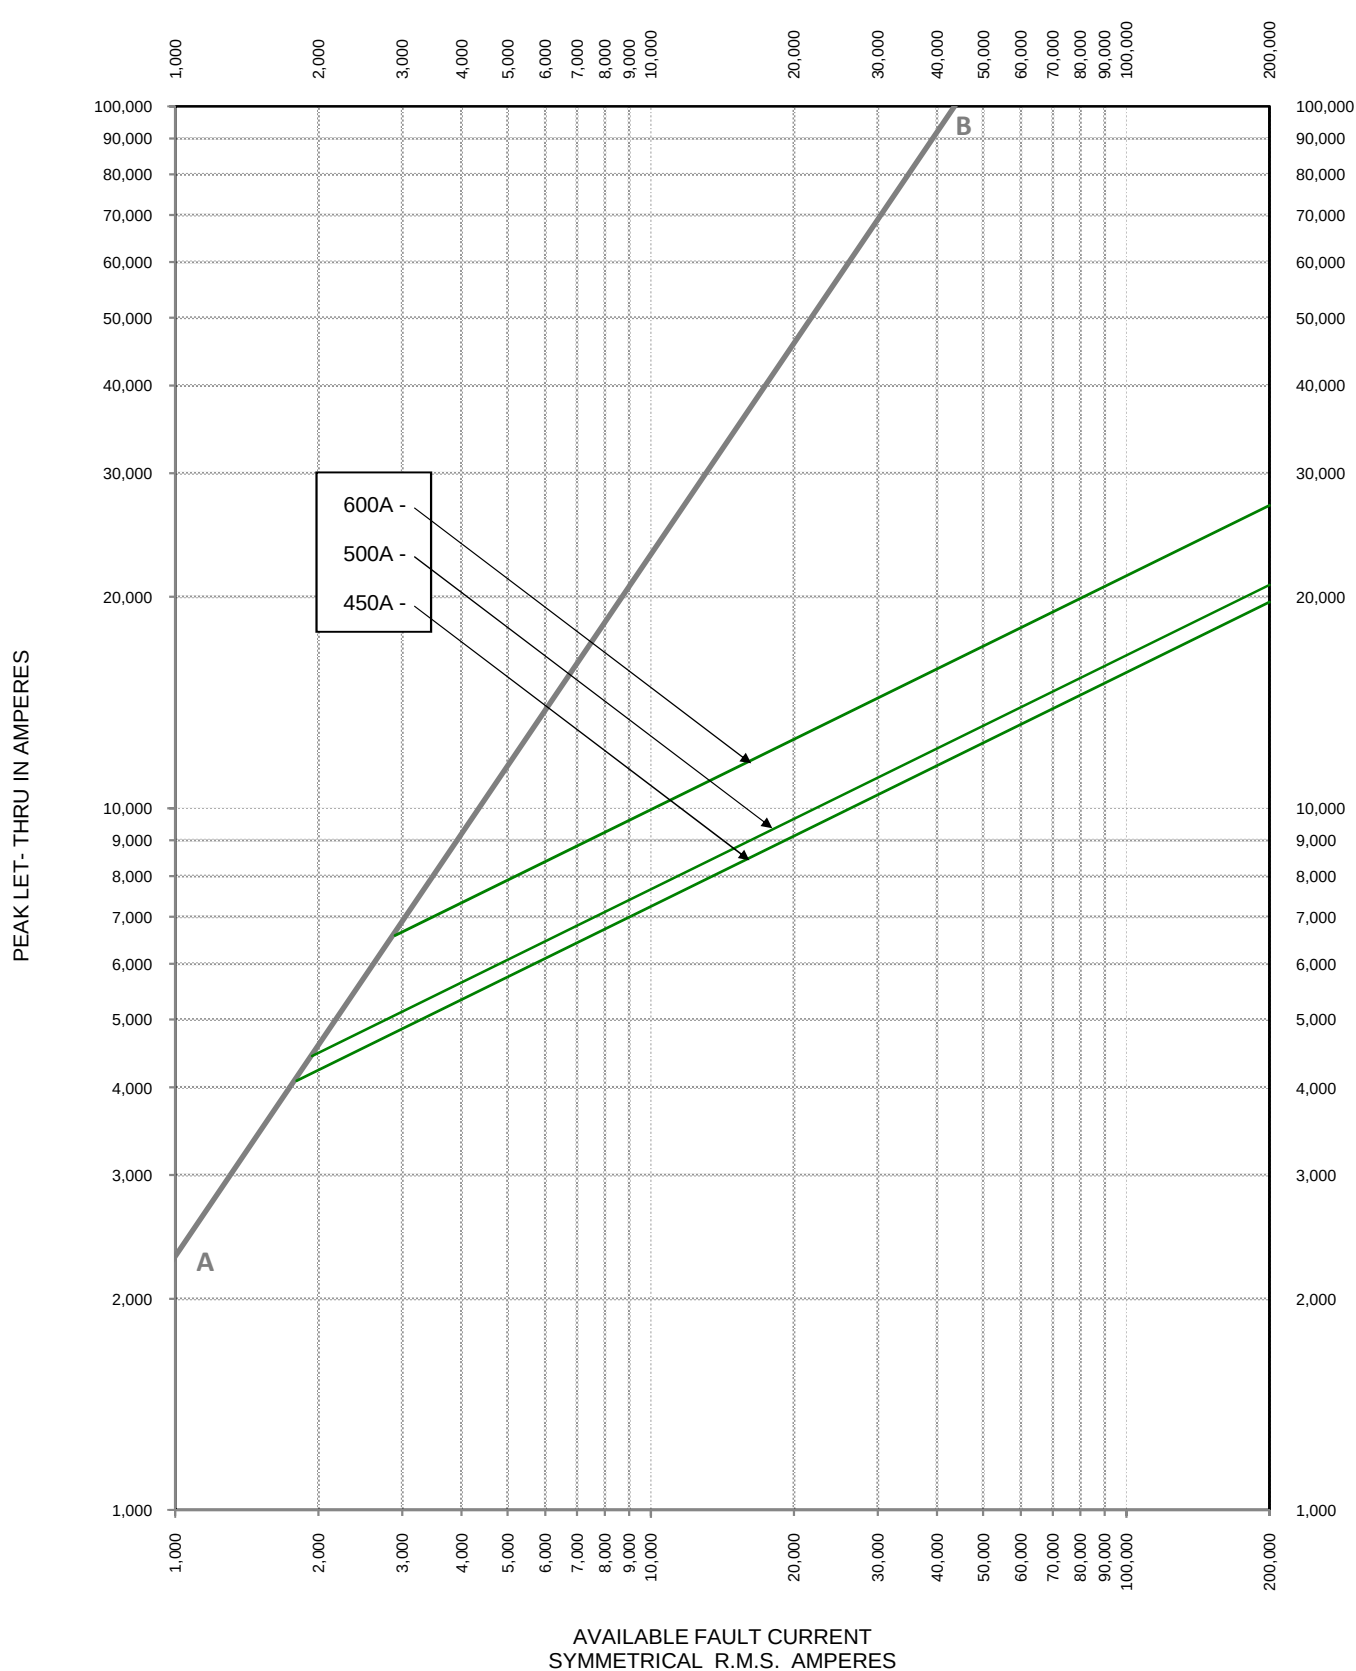

TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor			L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 10/13/2015	
PEAK LET-THRU CHARACTERISTIC CURVES		REVISION: C	
		DRAWING NO.: FCC05-L70QS	SHEET 7 OF 8

PEAK LET- THRU IN AMPERES

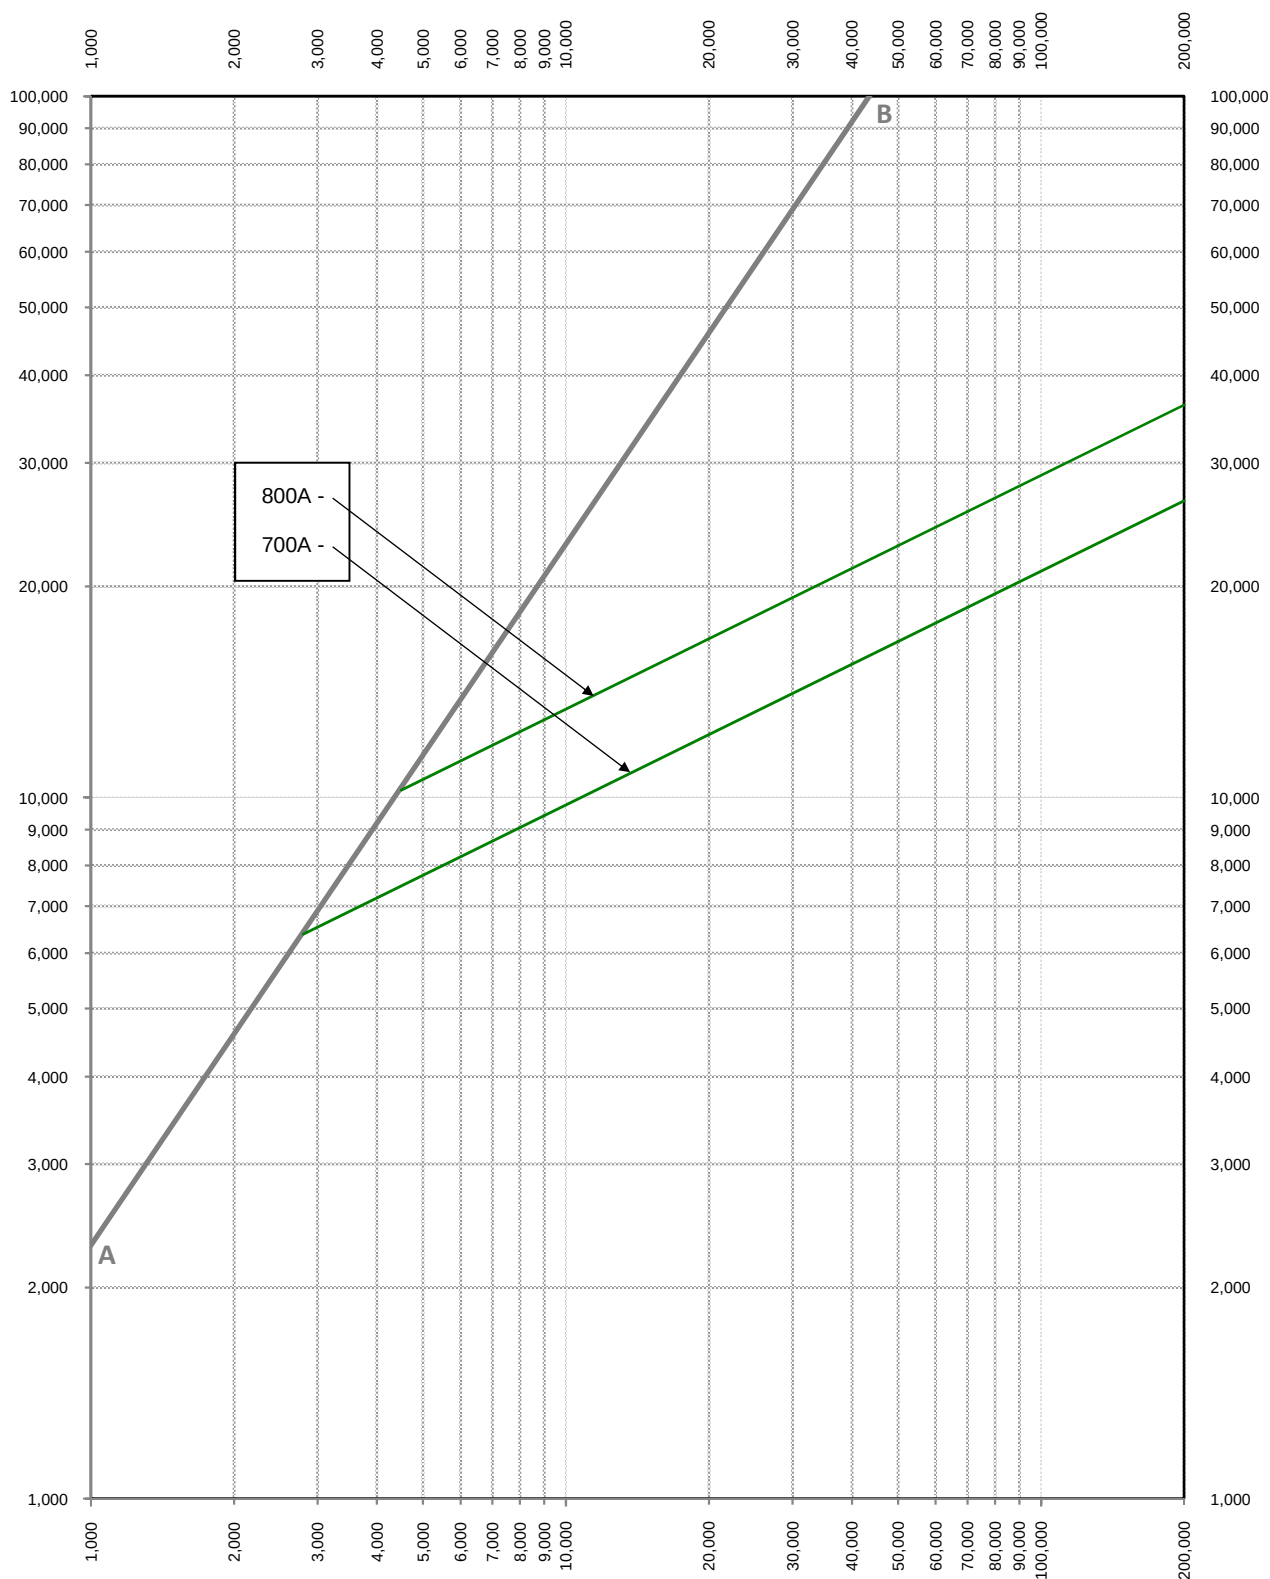

AVAILABLE FAULT CURRENT
SYMMETRICAL R.M.S. AMPERES

TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor			L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 10/13/2015	
PEAK LET-THRU CHARACTERISTIC CURVES		REVISION: C	
		DRAWING NO.: FCC05-L70QS SHEET 8 OF 8	