


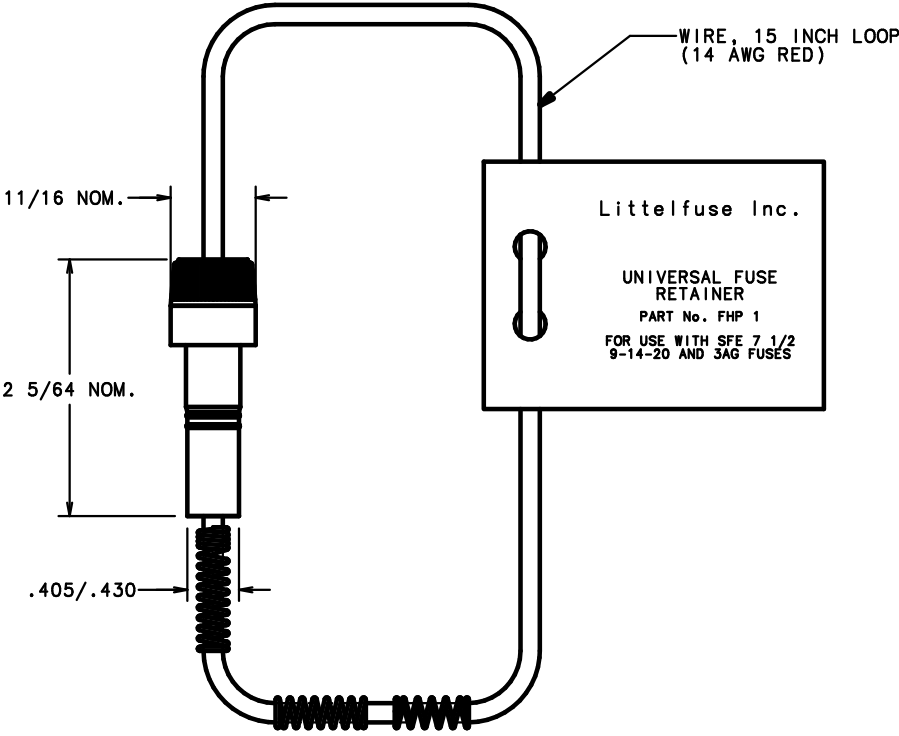

- NOTES:
- 1. THIS RETAINER IS SUPPLIED WITH THREE (3) SPRINGS, MAKING IT SUITABLE FOR 9, 14 + 20 AMP "SFE" FUSES BY SELECTING THE PROPER SPRING.
 - 2. FOR PANEL MOUNTING OF THIS RETAINER, ORDER SPRING CLIP -900-028.
 - 3. SPRINGS MAY BE SHIPPED ASSEMBLED EITHER INSIDE OR OUTSIDE OF FUSEHOLDER BODY.

NO		COMPONENT NO	DESCRIPTION		QTY/M	U/M
BILL OF MATERIAL						
COPIES TO		MATL SPEC		FINISH		
1	9	18	DRW	JMB	DATE	1/12/98
2	10	19			SCALE	1=1
3	12	20	CHK		DATE	SUPER DRW
4	13	21			DATE	RAW STK WT
5	14	23	APPD		DATE	LBS/M
6	15	33			TOLERANCE UNLESS OTHERWISE SPECIFIED	
7	16	43			FRACTION ±	
8	17	53			THREE PLACE DEC ±.005	
TITLE						
IN-LINE BAYONET KNOB FUSEHOLDER						
LTR		REVISION			CHK	APD
C	38958C- REVISED & REDRAWN ON NEW FORMAT			JMB	DATE	NO.
				OUTLINE		
				OFHP0001Z		
				C		
				DES PLAINES, ILLINOIS 60016		
				Littelfuse®		

UNLESS OTHERWISE SPECIFIED, DIMENSIONS DO NOT INCLUDE PLATING.

DENOTES CRITICAL CHARACTERISTICS.

DENOTES CPK DIMENSIONS.-MINIMUM CPK VALUE 1.0

DENOTES A CHARACTERISTIC THAT PROVIDES AN INDICATION OF PROCESS PERFORMANCE.-PROCEDURE FOR MEASUREMENT OF PROCESS PERFORMANCE IS LOCATED IN THE LITTELFUSE INSPECTION INSTRUCTIONS.

DENOTES CP DIMENSIONS.-MINIMUM CP VALUE .50

DENOTES DIMENSIONS WITHIN THE DIMENSIONAL LIMITATIONS OF THE DRAWING AND MINIMALLY LOCATED TO THE PART FOR MAXIMUM TOOL LIFE.

**Littelfuse**
DES PLAINES, ILLINOIS 60016

FORM NO. OUTLINE
OFHP0001Z

UNCONTROLLED DOCUMENT