


**AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES**

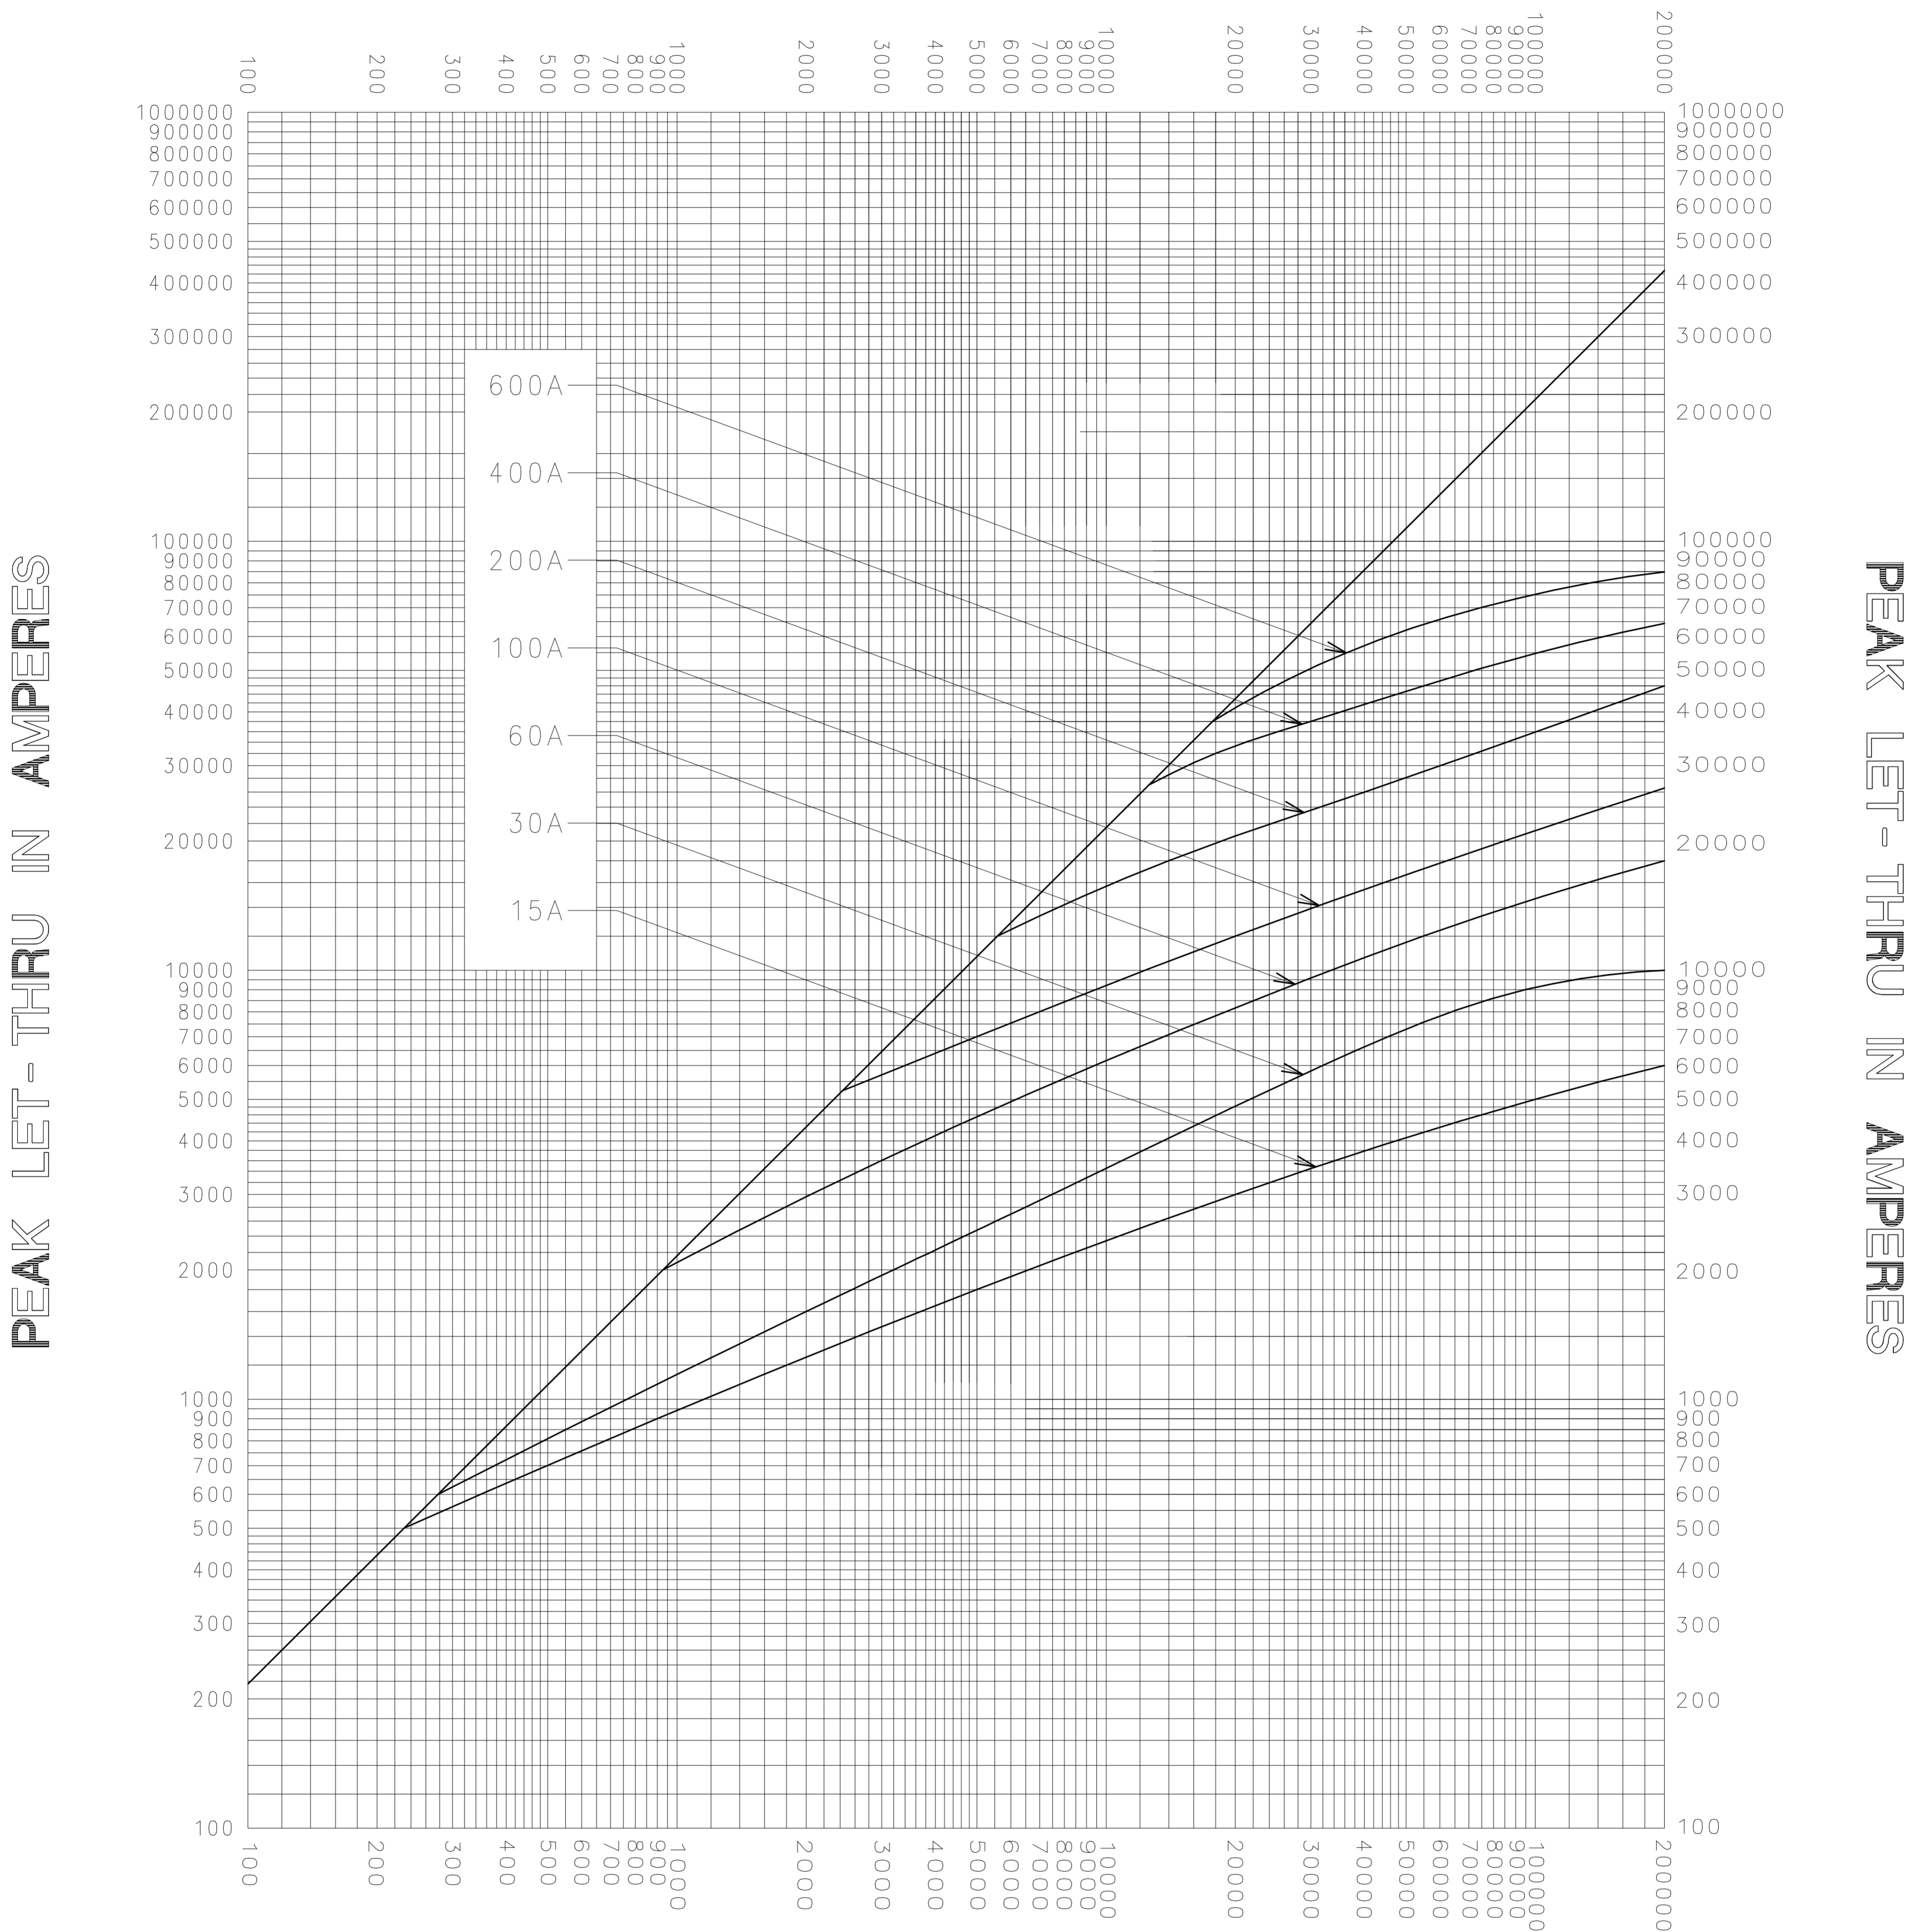

**AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	FLSR (15A - 600A) ID _____

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>09/06/06</u>
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC05-FLSR-001</u>

-THIS DATA GENERATED ON CAD-

**UNCONTROLLED  
DOCUMENT**