


AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

PEAK LET-THRU IN AMPERES

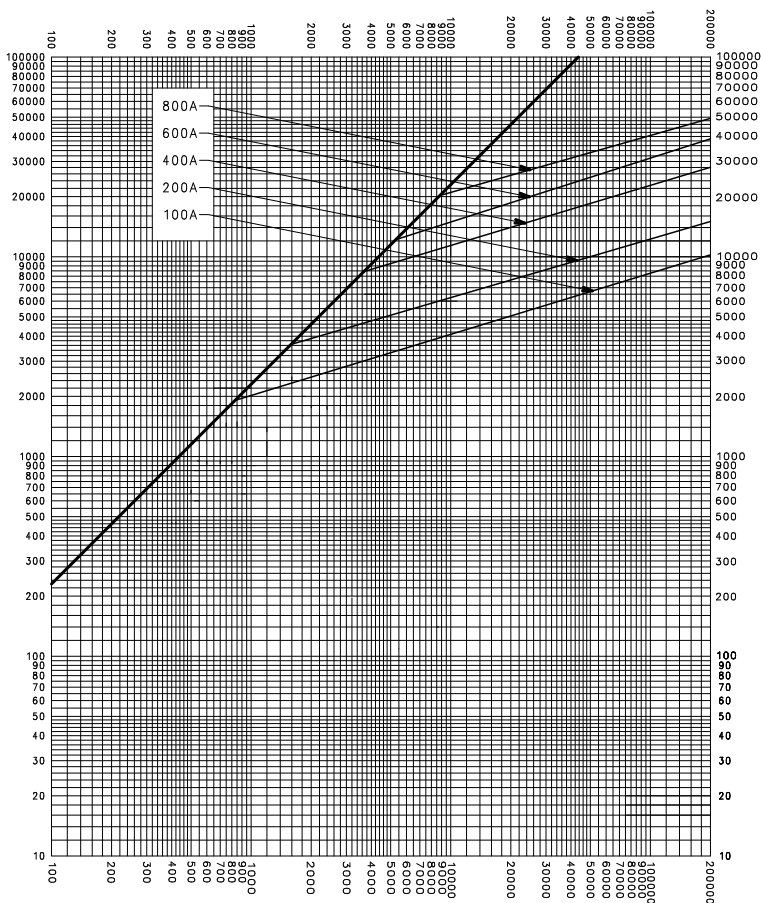

PEAK LET-THRU IN AMPERES

AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

TEST VOLTAGE <u>600V</u> TIME CONSTANT / POWER FACTOR _____		FUSE CATALOG NUMBER
BASIS FOR DATA _____		<u>L60S (100A - 800A)</u>
 LITTELFUSE, INC. DES PLAINES, ILL. USA		DRAWN BY <u>LLL</u> DATE <u>05/17/06</u> CHECKED BY <u>MP</u>
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO. <u>A-FCC05</u> SCALE <u>1:1</u>

-THIS DATA GENERATED ON CAD-

**UNCONTROLLED
DOCUMENT**