



**AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES**

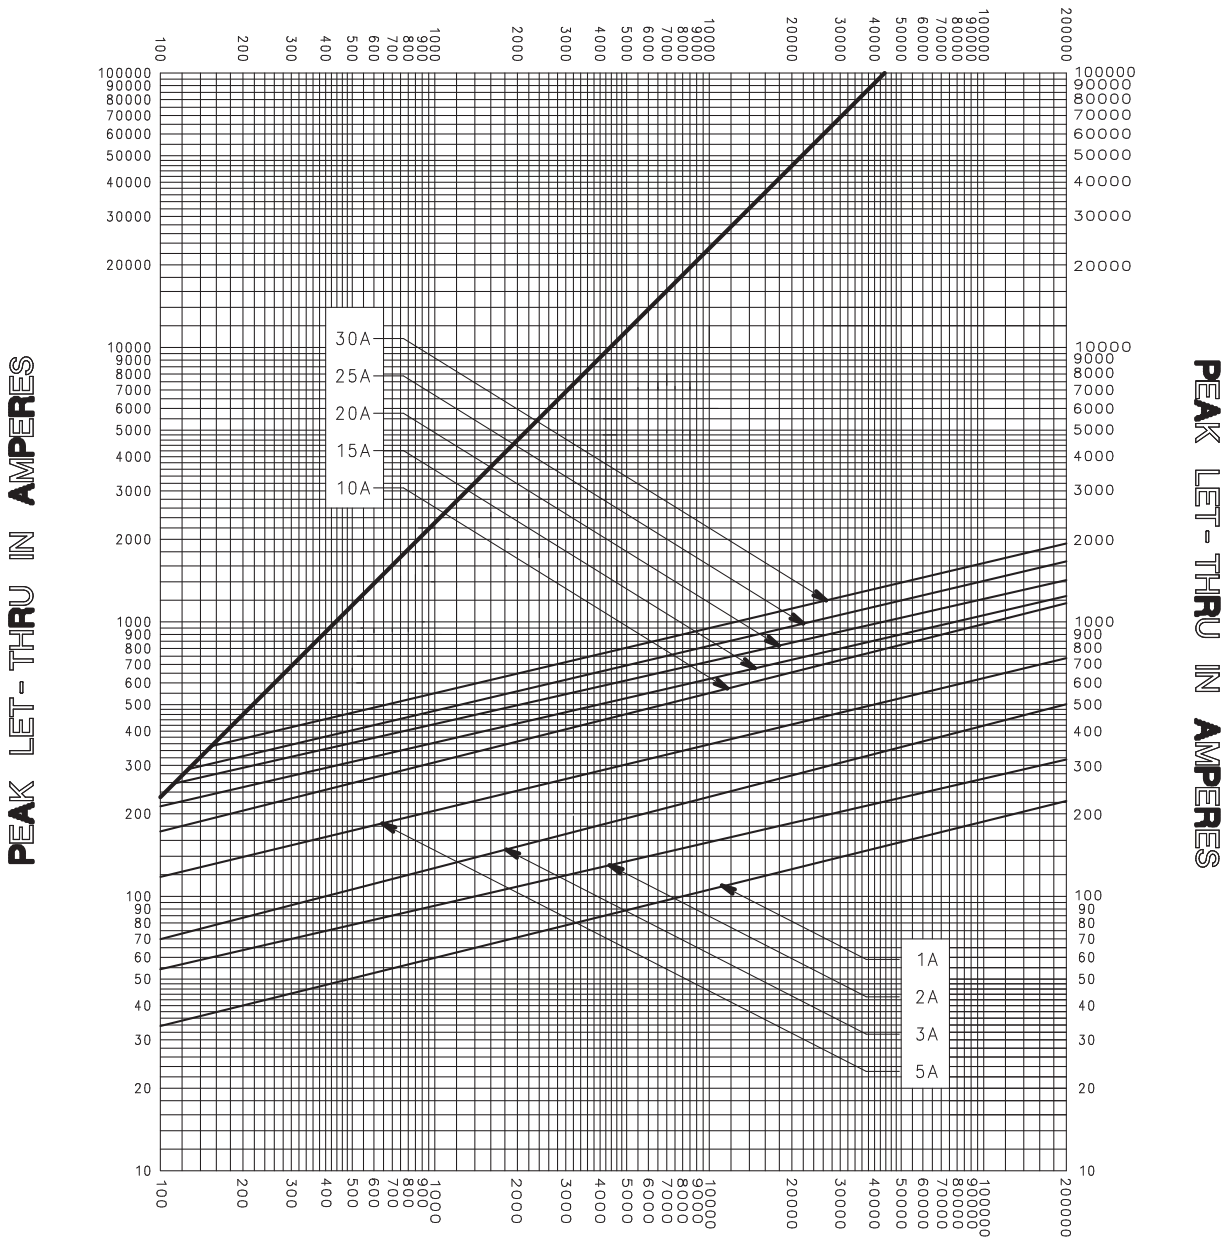



**AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE <u>250V</u> TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	L25S (1A - 30A)
 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>05/17/06</u>
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC05-355-1</u>


-THIS DATA GENERATED ON CAD-

**UNCONTROLLED  
DOCUMENT**

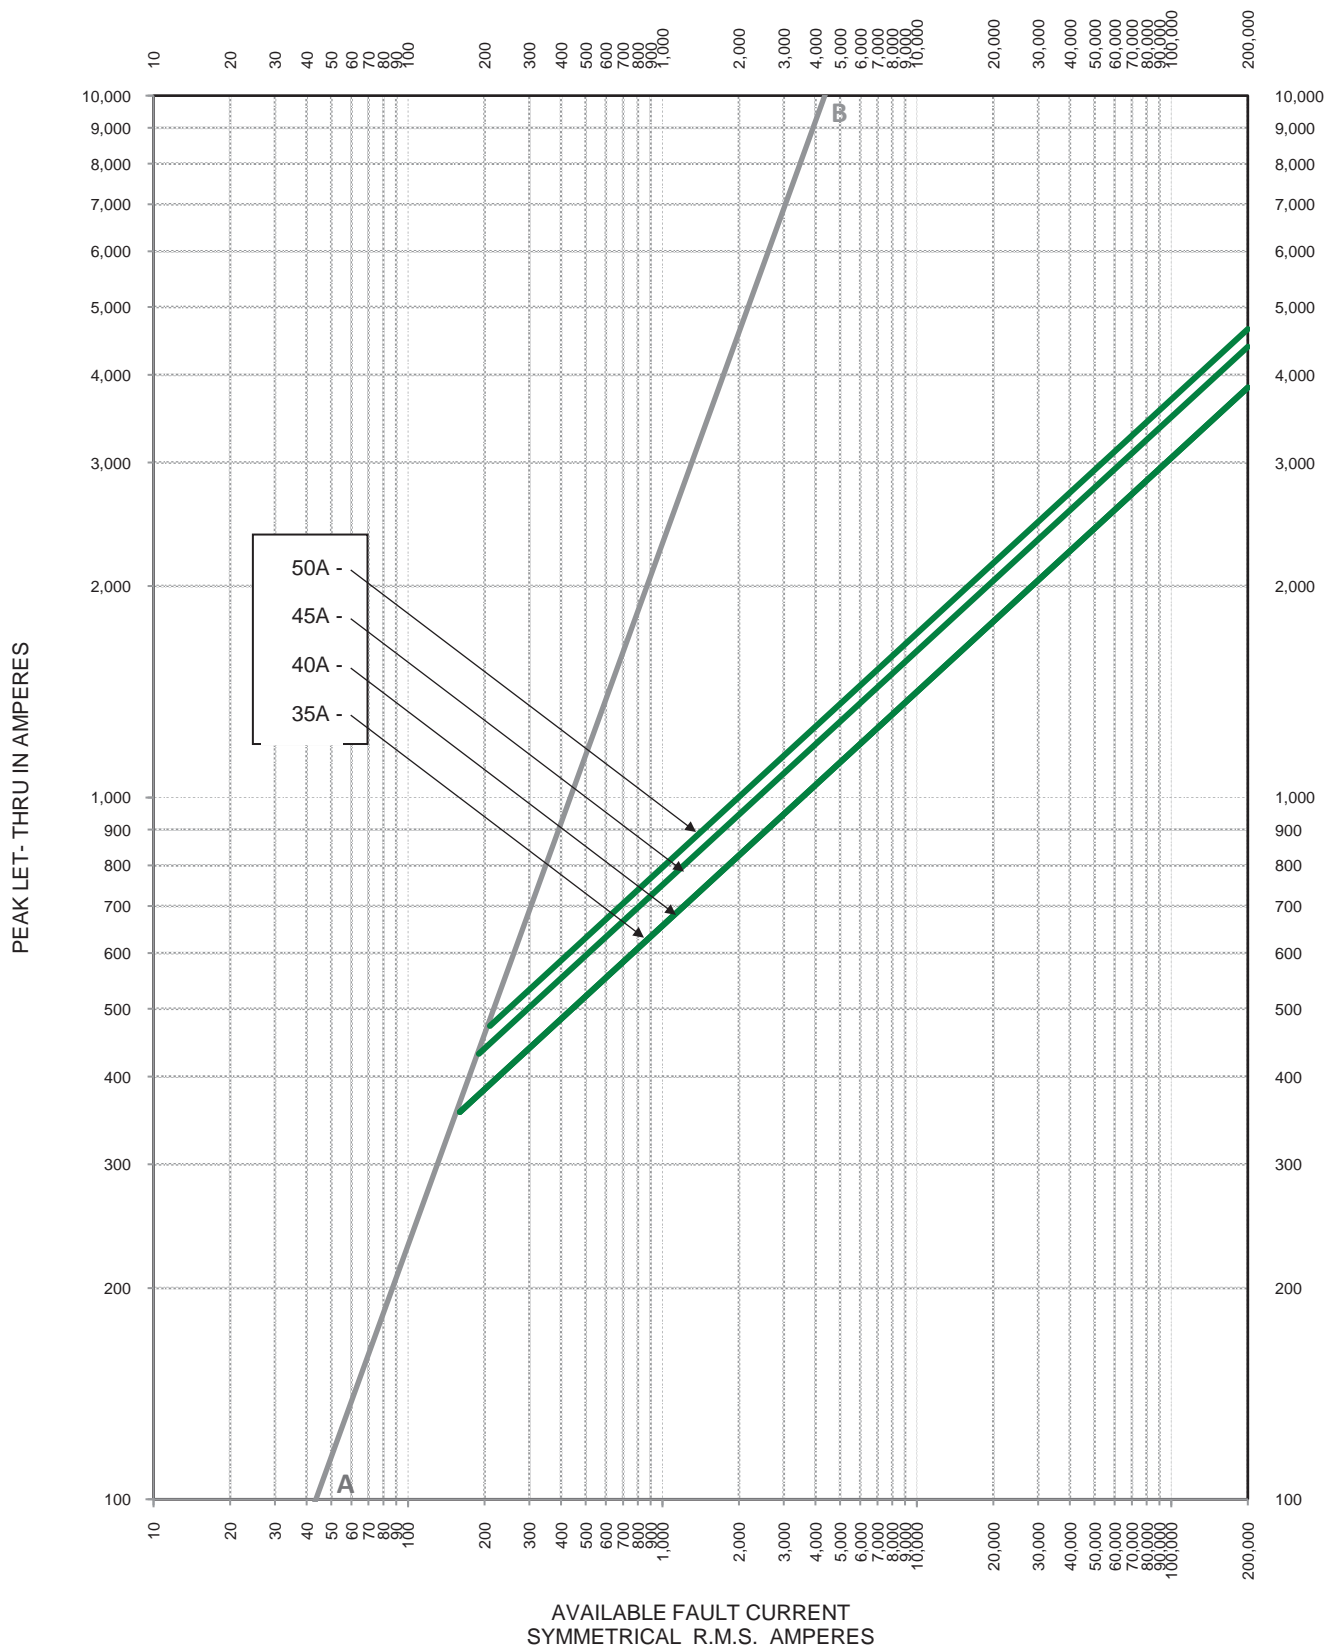

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		L25S 35A - 50A
		DRAWN BY: LLL
		DATE: 11/27/2018
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		REVISION: A
		DRAWING NO.: SHEET 2 OF 2
		FCC05-L25S

**AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES**

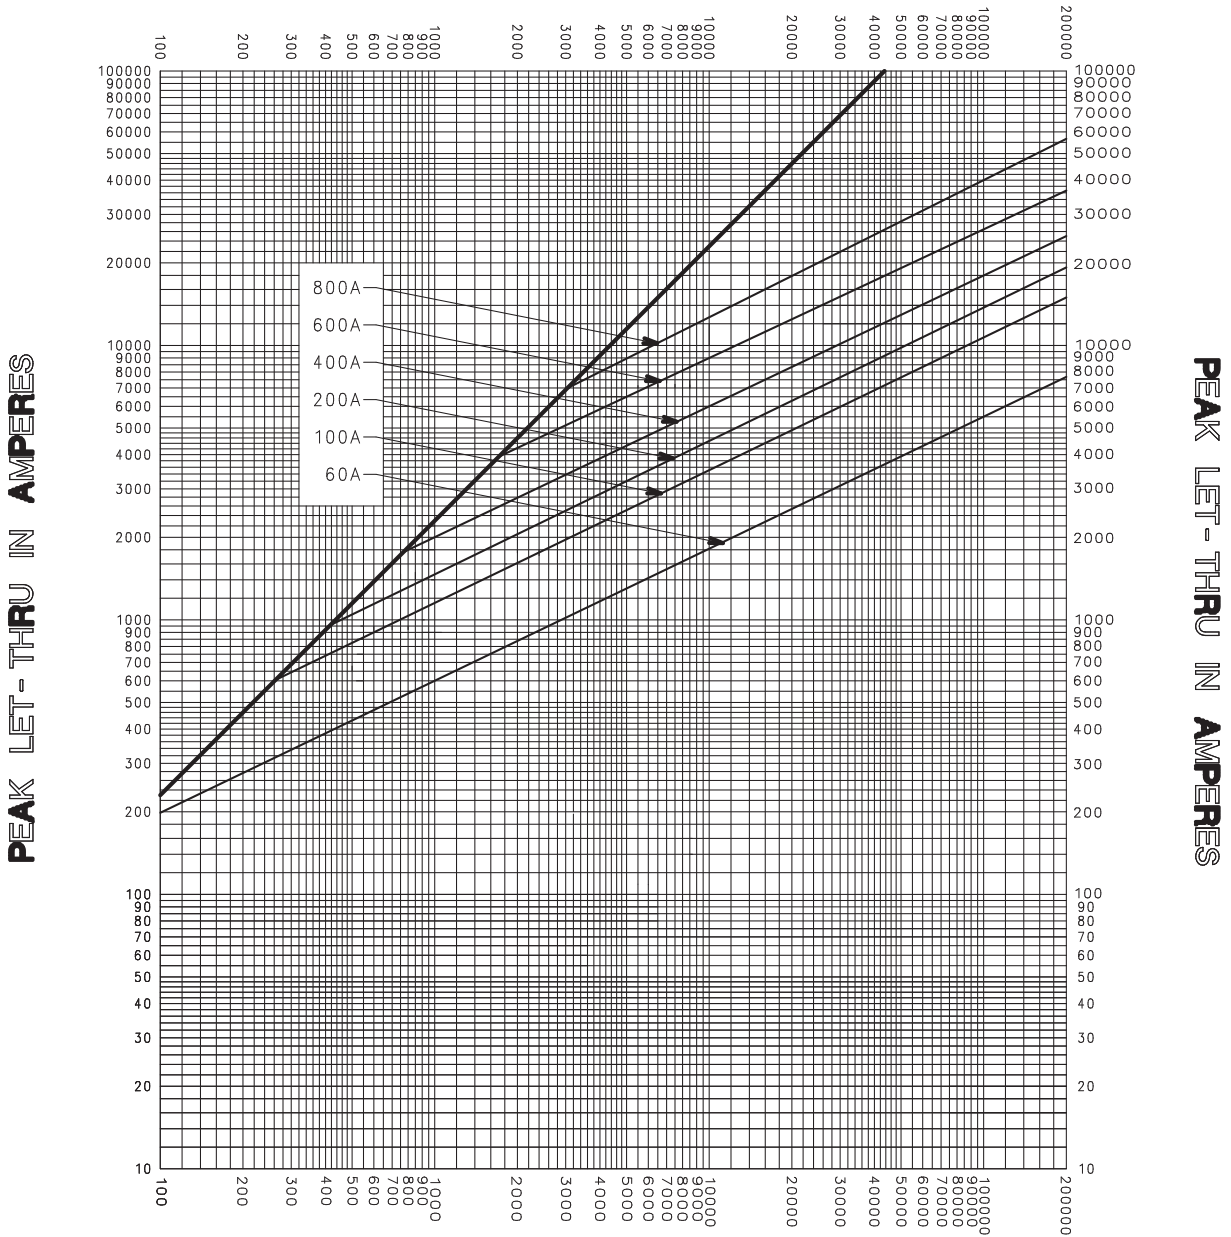

**AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE <u>250V</u>	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		L25S (60A - 800A)

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>05/17/06</u>
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC05-355-2</u>

-THIS DATA GENERATED ON CAD-

**UNCONTROLLED  
DOCUMENT**