



AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

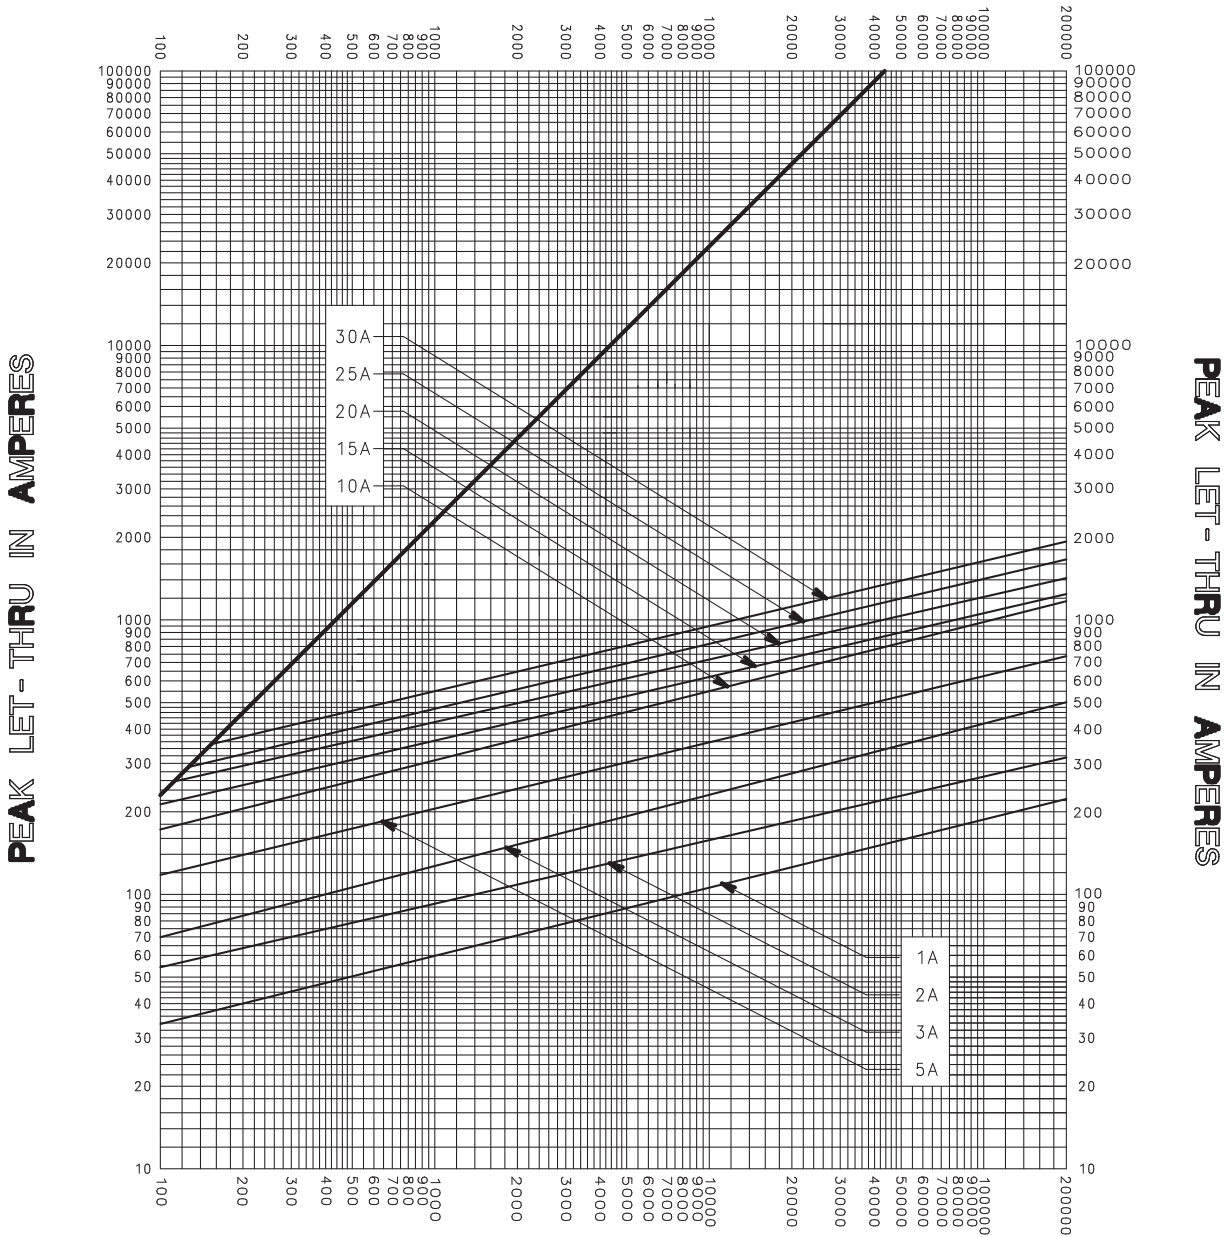



AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

TEST VOLTAGE <u>250V</u> TIME CONSTANT / POWER FACTOR _____		FUSE CATALOG NUMBER
BASIS FOR DATA _____		<u>L25S (1A - 30A)</u>
 LITTELFUSE, INC. DES PLAINES, ILL. USA		DRAWN BY <u>LLL</u> DATE <u>05/17/06</u> CHECKED BY <u>MP</u>
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO. <u>A-FCC05-1</u> 100000


- THIS DATA GENERATED ON CAD -

**UNCONTROLLED
DOCUMENT**

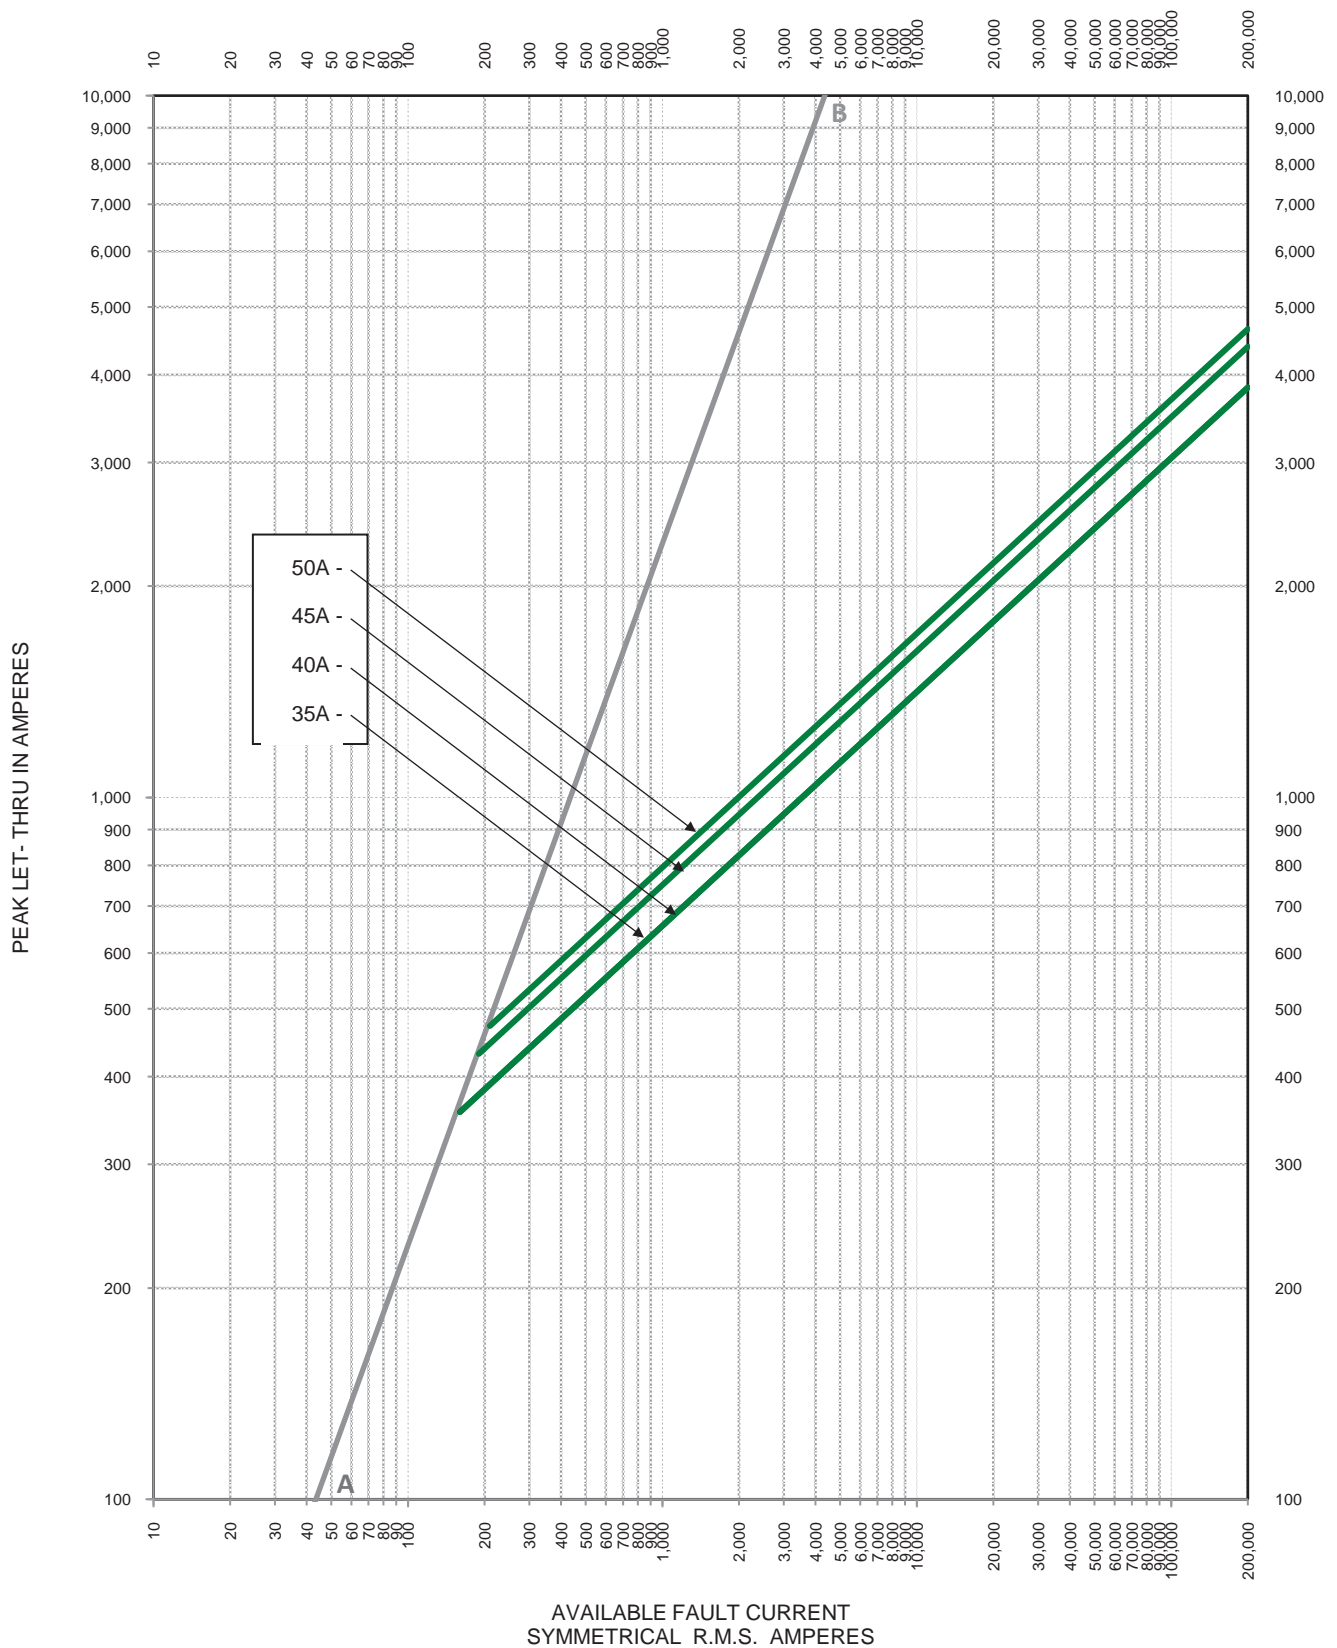


TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor			L25S 35A - 50A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 11/27/2018	
PEAK LET-THRU CHARACTERISTIC CURVES		REVISION: A	
		DRAWING NO.:	SHEET 2 OF 2
		FCC05-L25S	

AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

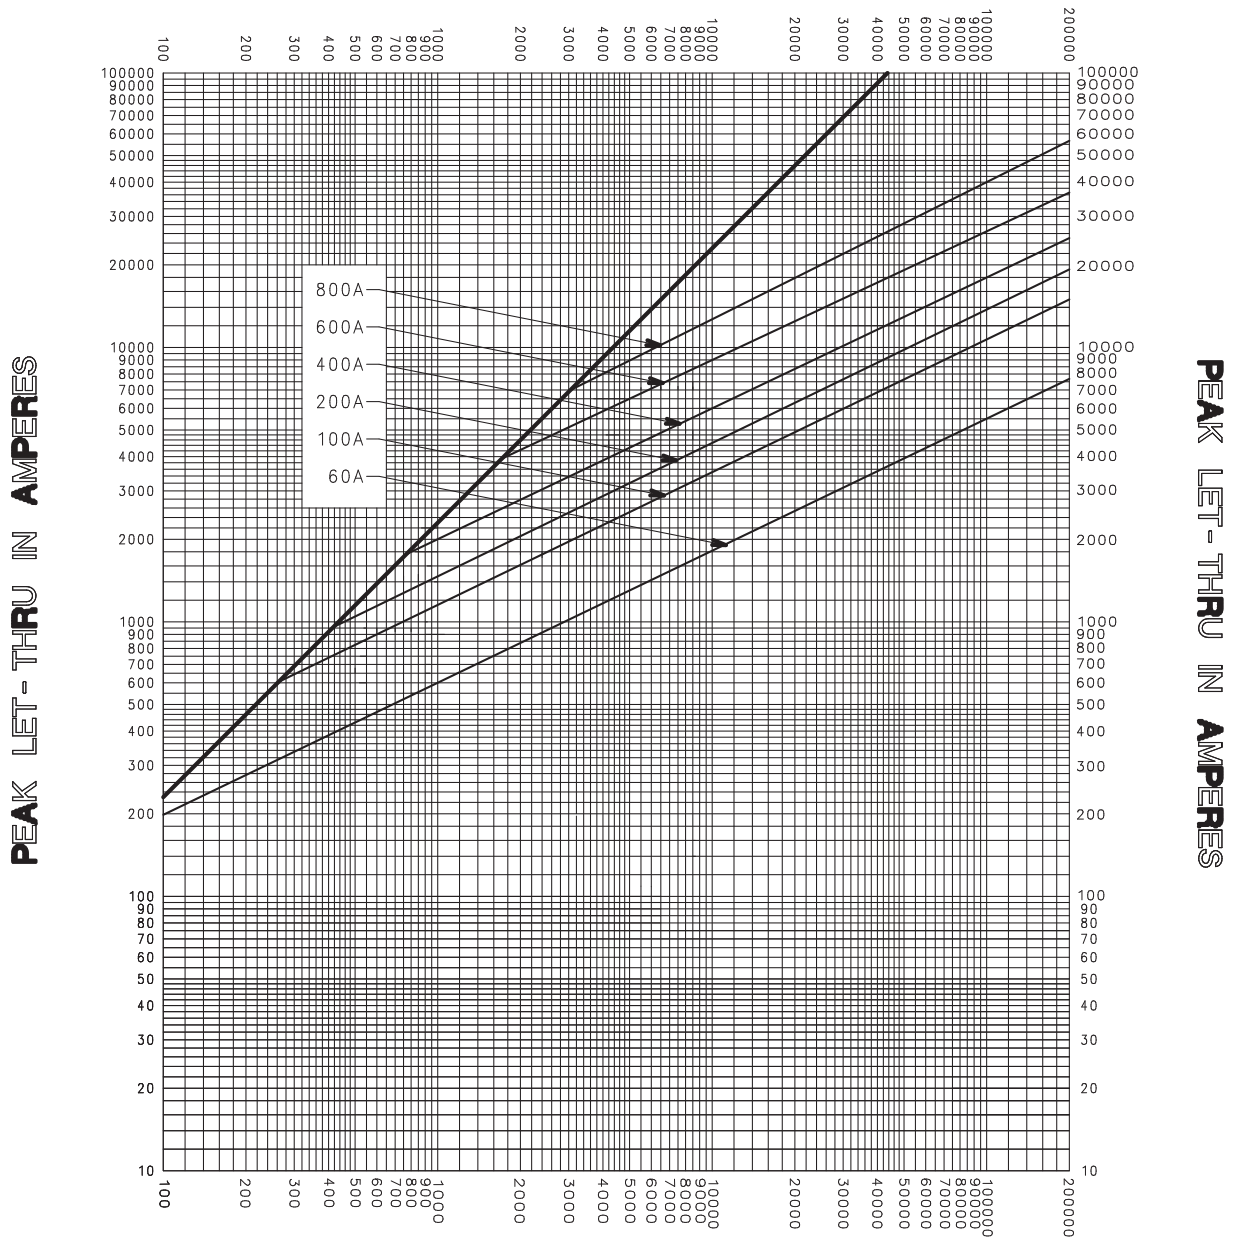

AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

TEST VOLTAGE <u>250V</u> TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____		FUSE CATALOG NUMBER L25S (60A - 800A)
 LITTELFUSE, INC. DES PLAINES, ILL. USA		DRAWN BY <u>LLL</u> DATE <u>05/17/06</u> CHECKED BY <u>MP</u>
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO. <u>A-FCC05-155-2</u>

- THIS DATA GENERATED ON CAD -

**UNCONTROLLED
DOCUMENT**