



AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

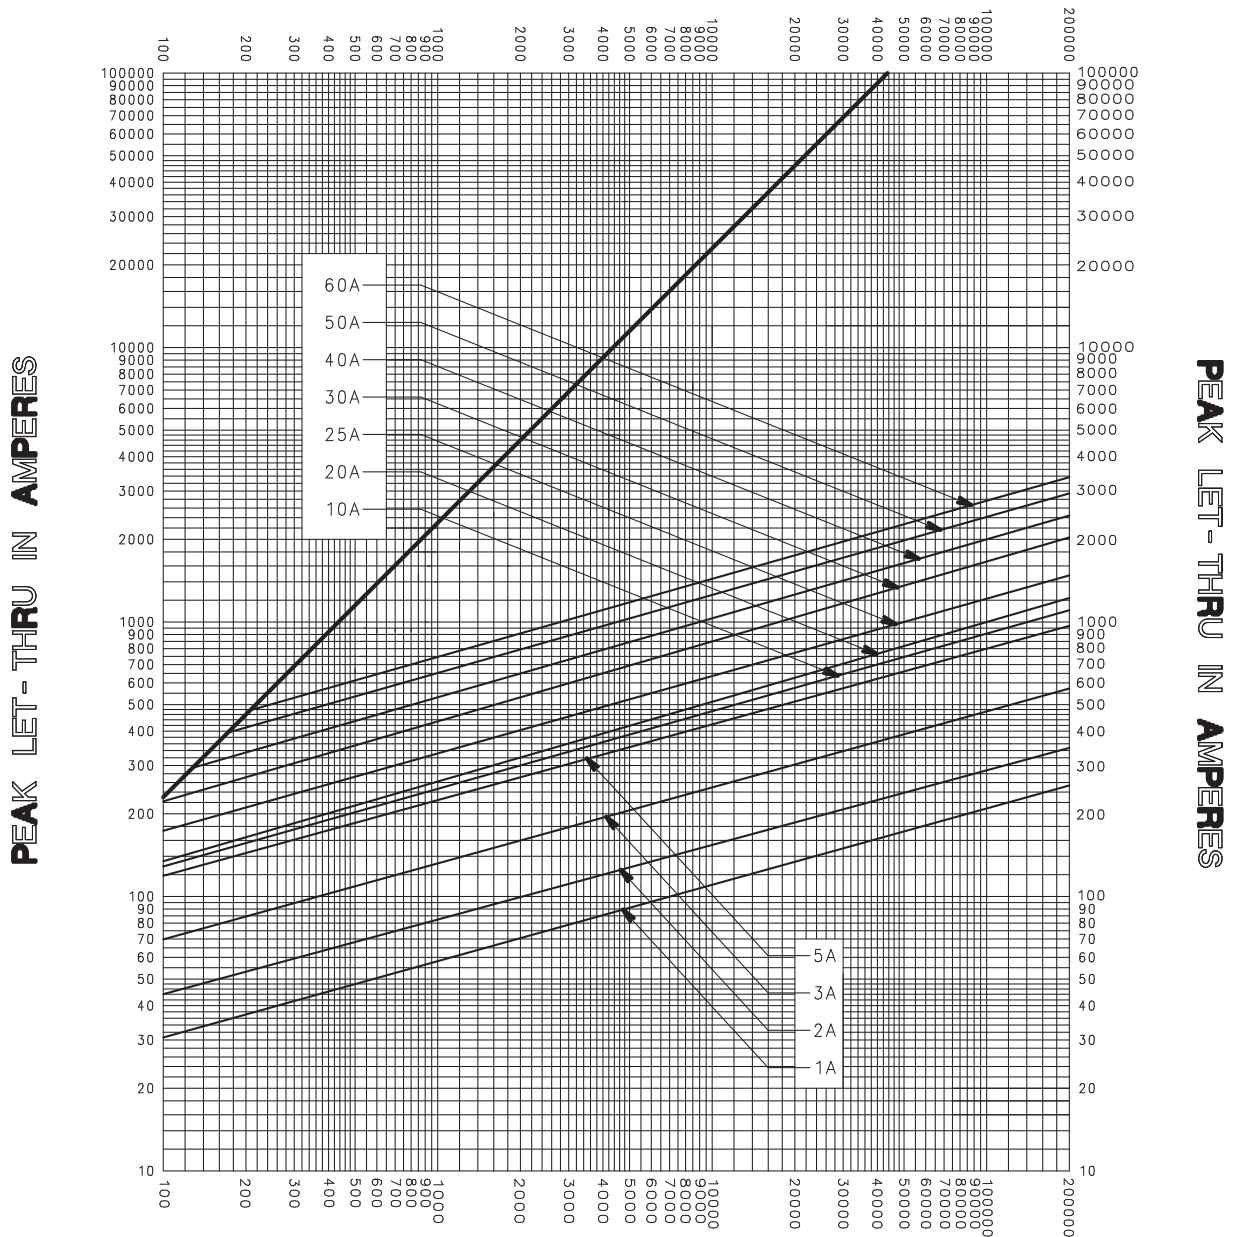

AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES


TEST VOLTAGE <u>150V</u> TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____		FUSE CATALOG NUMBER <p align="center">L 15S (1A-60A)</p>	
 LITTELFUSE, INC. DES PLAINES, ILL. USA		DRAWN BY <u>LLL</u> DATE <u>05/17/06</u> CHECKED BY <u>MP</u>	
		DRAWING NO. <p align="center">A-FCC05-355-1</p>	

PEAK LET-THRU CHARACTERISTIC CURVES


- THIS DATA GENERATED ON CAD -

**UNCONTROLLED
DOCUMENT**

AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

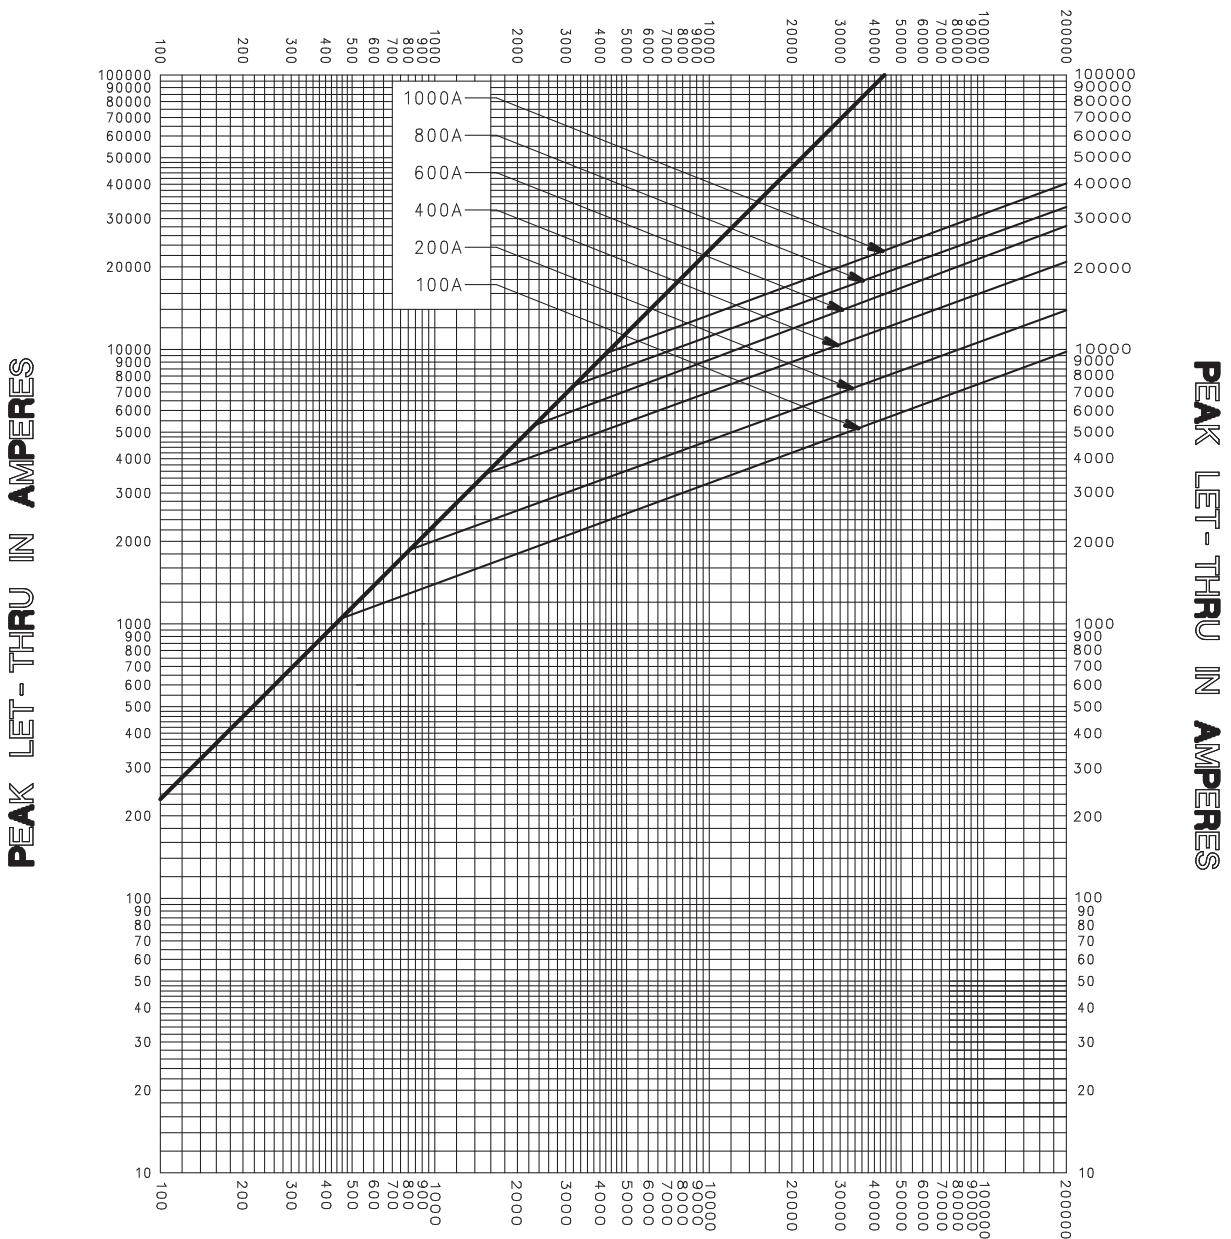



AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

TEST VOLTAGE <u>150V</u> TIME CONSTANT / POWER FACTOR _____		FUSE CATALOG NUMBER
BASIS FOR DATA _____		<u>L15S (100A - 1000A)</u>
 LITTELFUSE, INC. DES PLAINES, ILL. USA		DRAWN BY <u>LLL</u> DATE <u>05/17/06</u> CHECKED BY <u>MP</u>
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO. <u>A-FCC05-15S-12</u>

- THIS DATA GENERATED ON CAD -

**UNCONTROLLED
DOCUMENT**

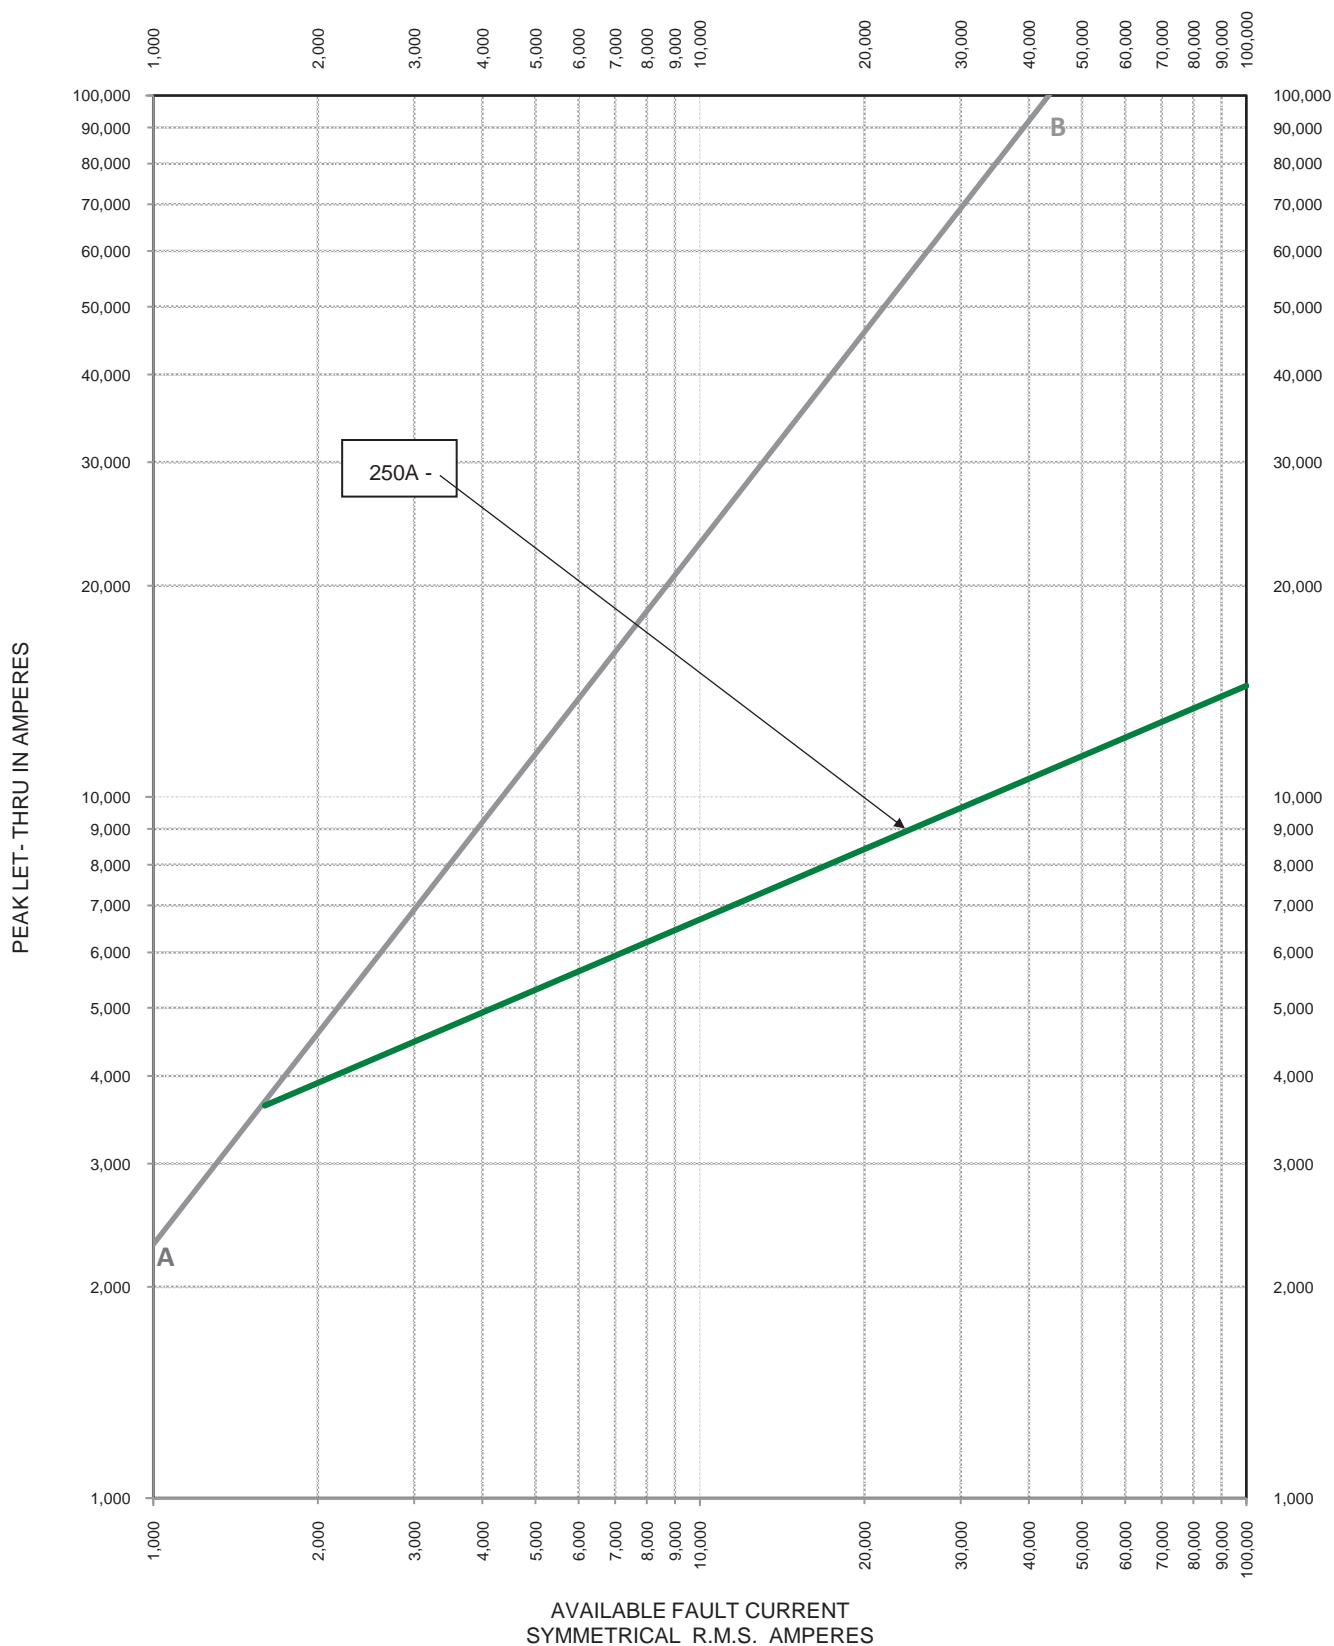

TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor			L15S 250A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 12/18/2018	
PEAK LET-THRU CHARACTERISTIC CURVES		REVISION: A	
		DRAWING NO.:	SHEET 2 OF 2
		FCC05-L15S	