



**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

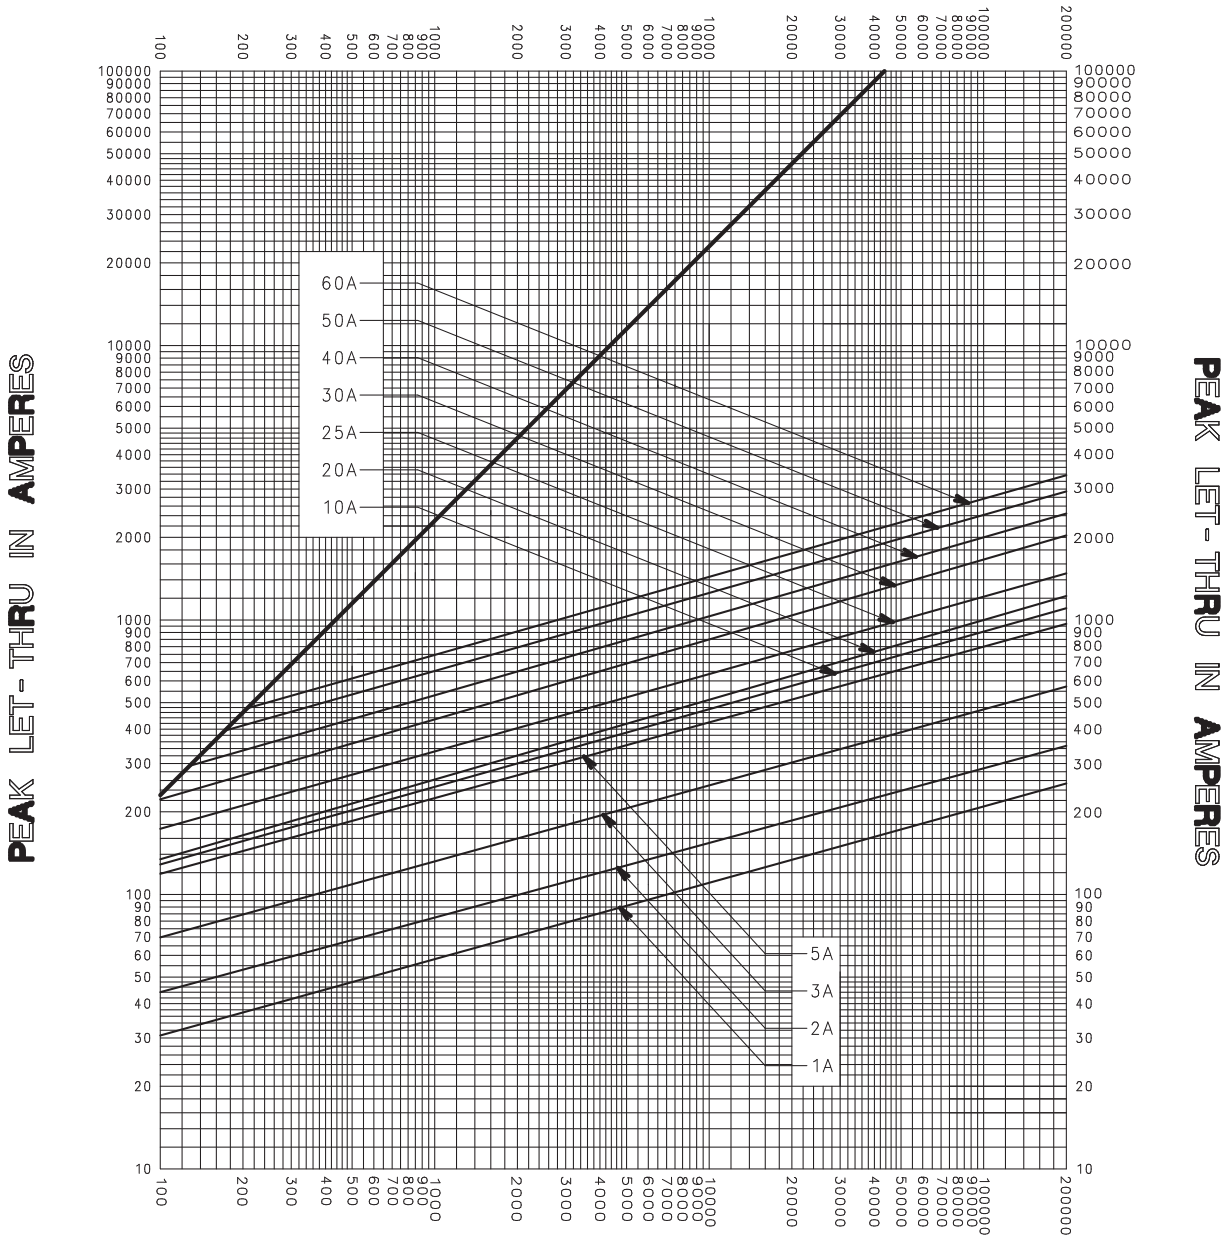


**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE <u>150V</u> TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	L 15S (1A-60A)
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>05/17/06</u>
PEAK LET-THRU CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC05</u>


-THIS DATA GENERATED ON CAD-

**UNCONTROLLED
DOCUMENT**

**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

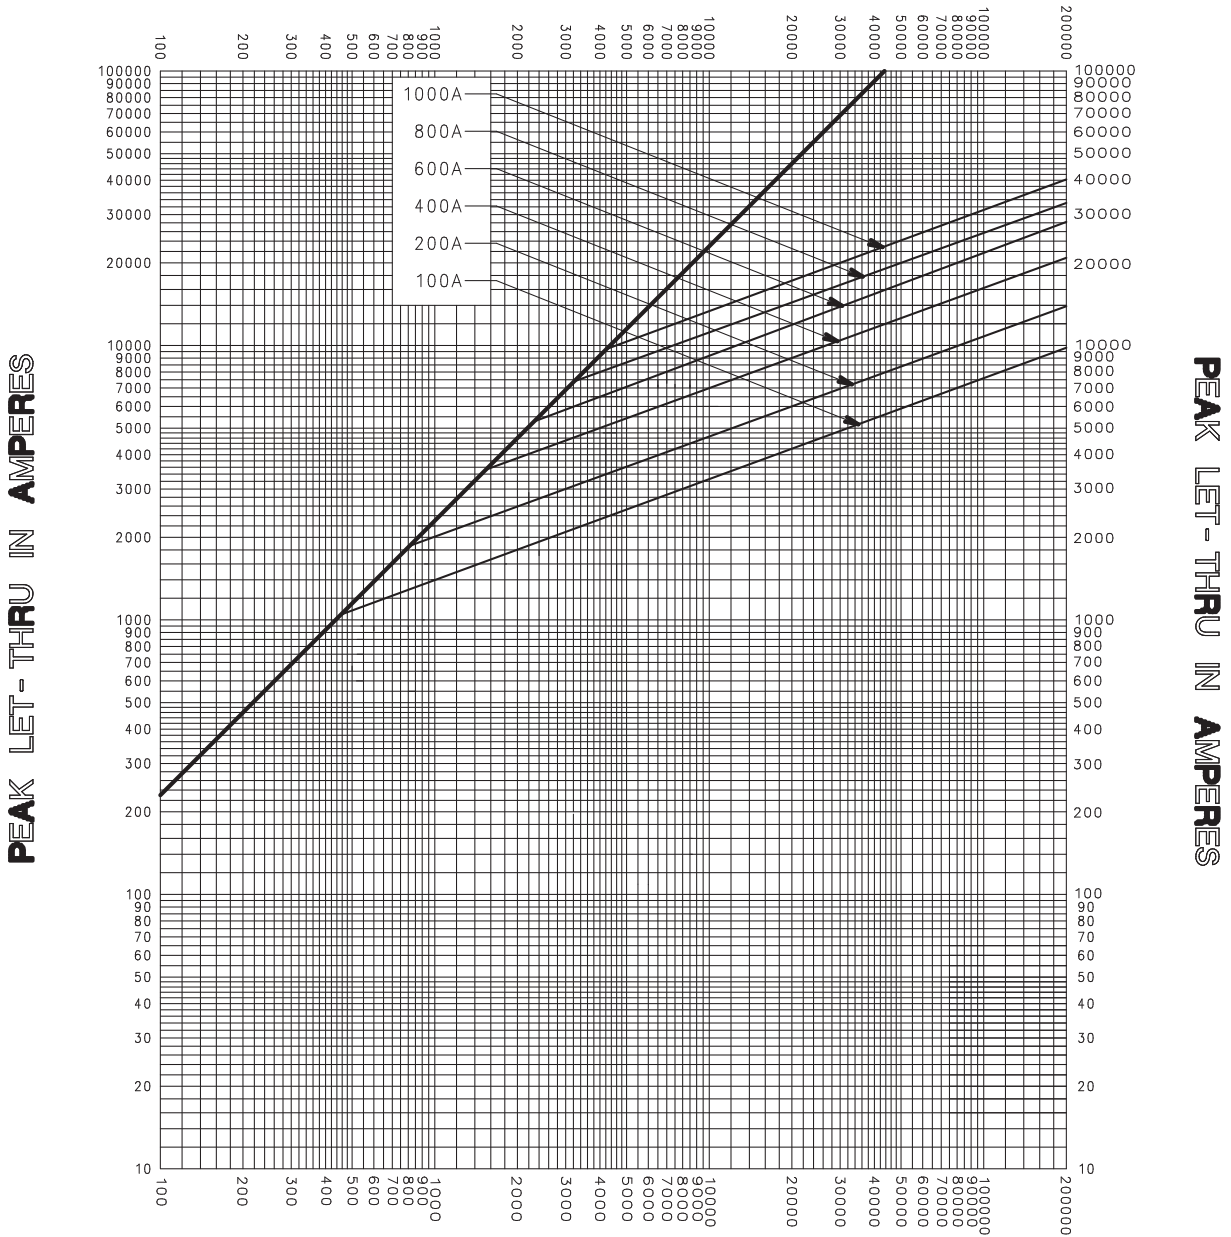



**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE <u>150V</u> TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	<u>L15S (100A - 1000A)</u>
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>05/17/06</u>
PEAK LET-THRU CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC05-355-2</u>

-THIS DATA GENERATED ON CAD-

**UNCONTROLLED
DOCUMENT**

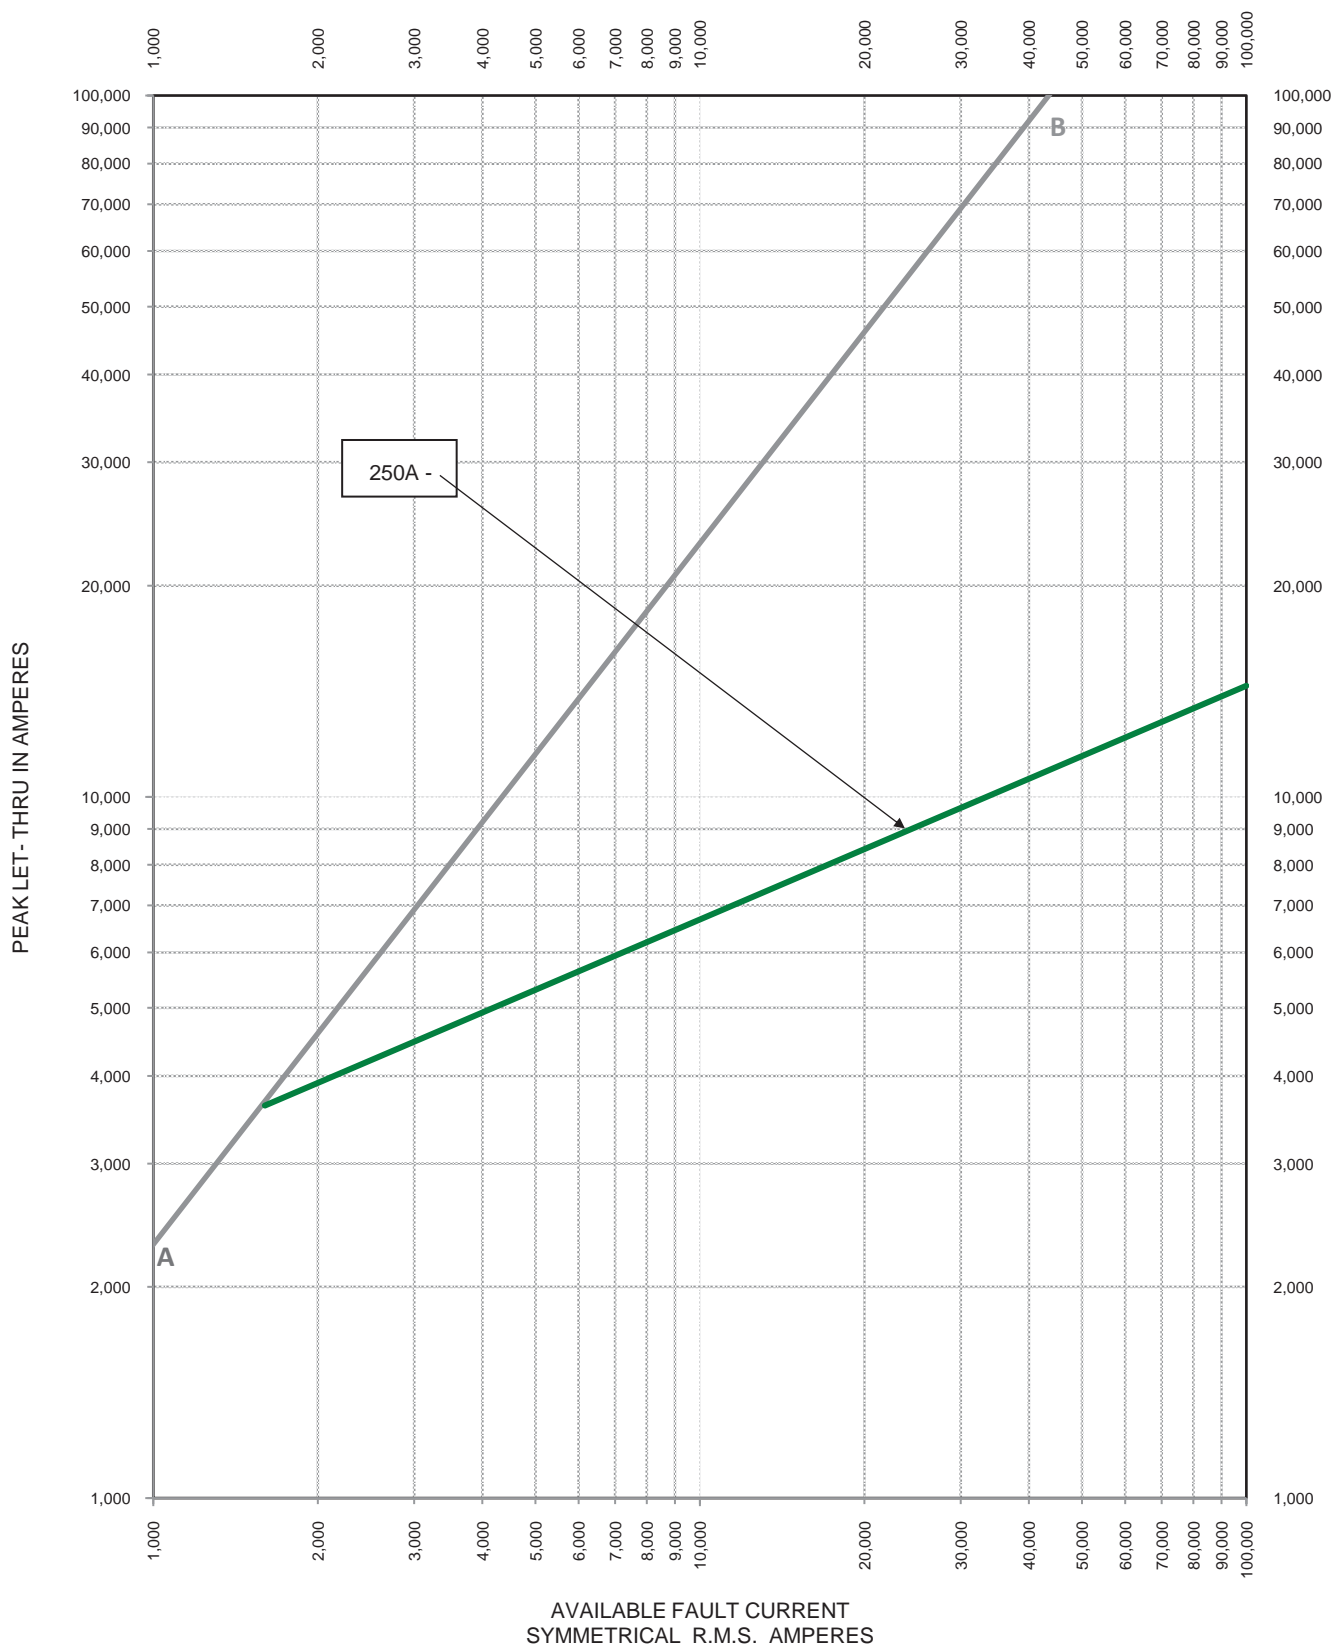

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		L15S 250A
		DRAWN BY: LLL
		DATE: 12/18/2018
PEAK LET-THRU CHARACTERISTIC CURVES		REVISION: A
		DRAWING NO.: SHEET 2 OF 2
		FCC05-L15S