


CURRENT IN AMPERES



CLEARING TIME CHARACTERISTIC

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 15.5kV E-RATED 100E-300E
BASIS FOR DATA _____		

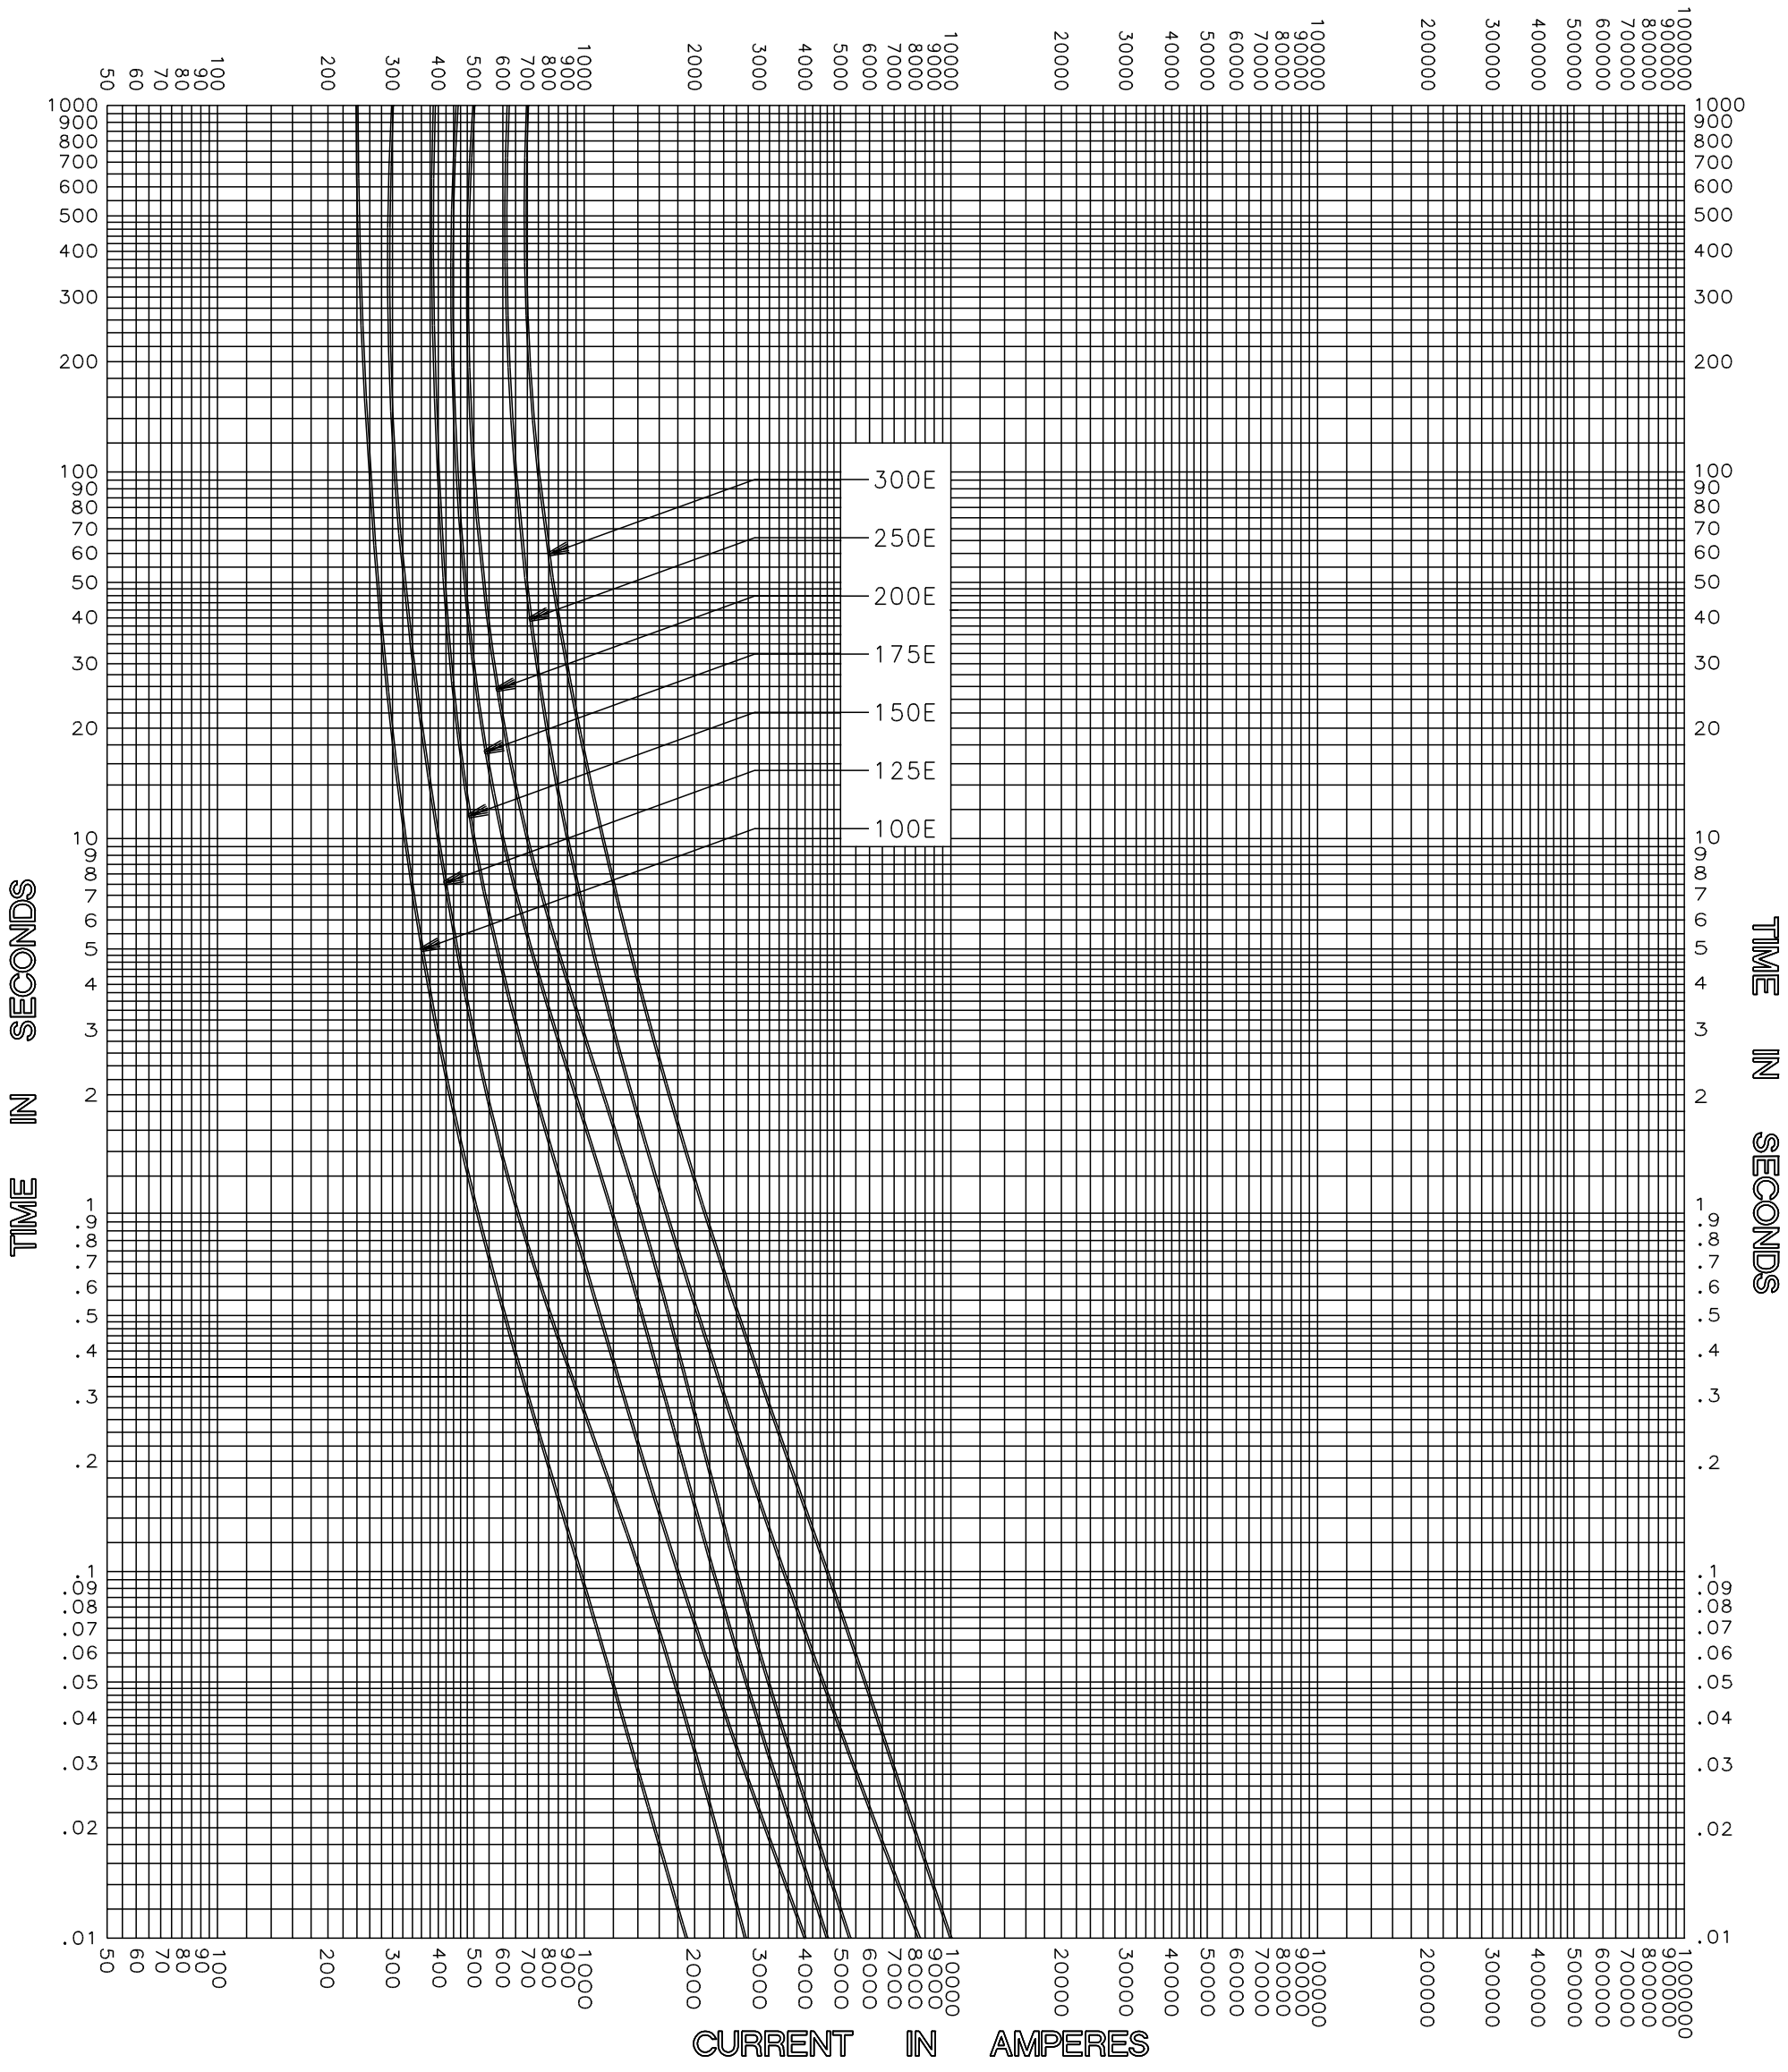

DRAWN BY LLL
DATE 05/17/04
CHECKED BY MP
DRAWING NO. A-FCC04155E002

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT