


**CURRENT IN AMPERES**

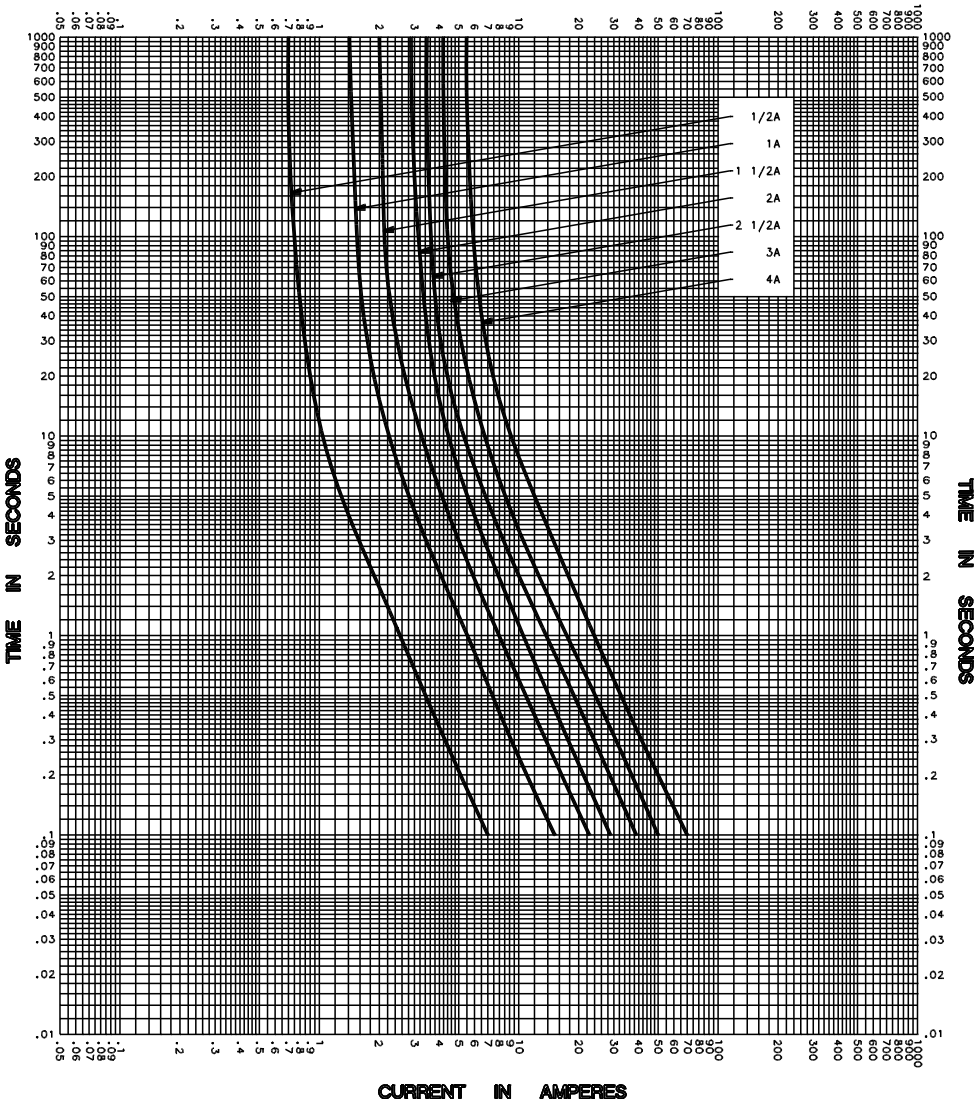

**CURRENT IN AMPERES**


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		BLF (1/2A - 4A)

<b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>MRD</u>
	DATE <u>02/17/03</u>
	CHECKED BY <u>TN</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	
DRAWING NO. <u>B-FCC-001</u>	


-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

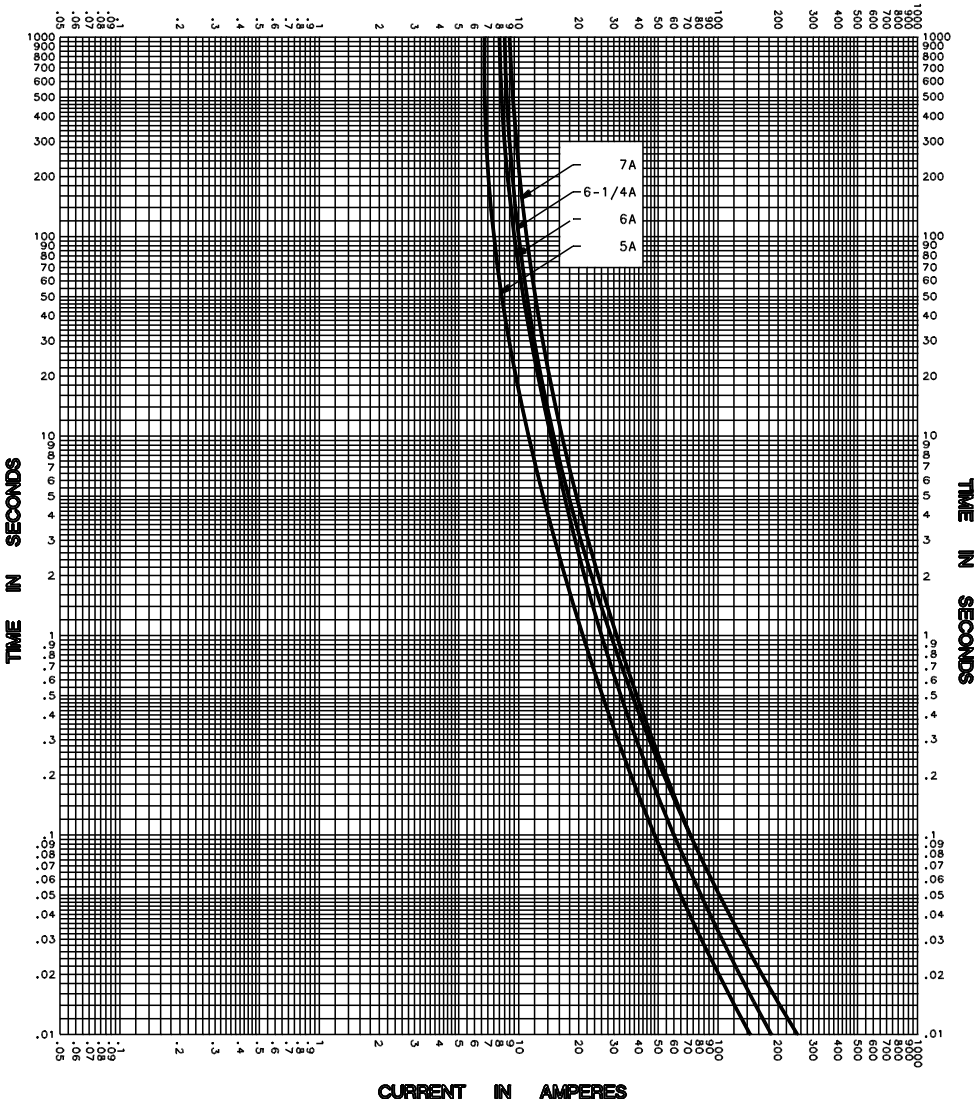


CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	BLF (5A - 7A)
 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 02/10/05
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	CHECKED BY MP
	DRAWING NO. A-FCC00002

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

**CURRENT IN AMPERES**

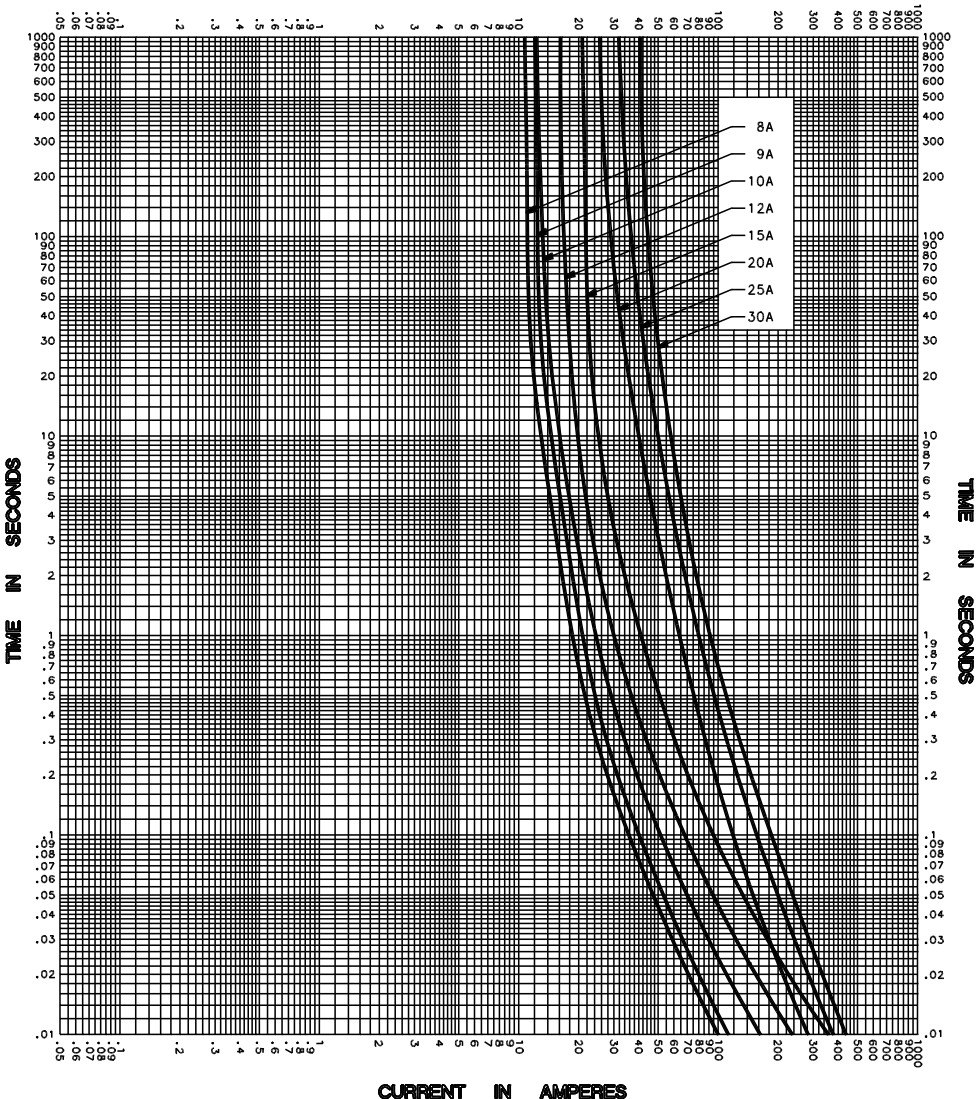

**CURRENT IN AMPERES**

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER BLF (8A - 30A)
BASIS FOR DATA _____		
<b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>	
	DATE <u>02/10/05</u>	
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	CHECKED BY <u>MP</u>	
	DRAWING NO. <u>A-FCC 91</u>	

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT