
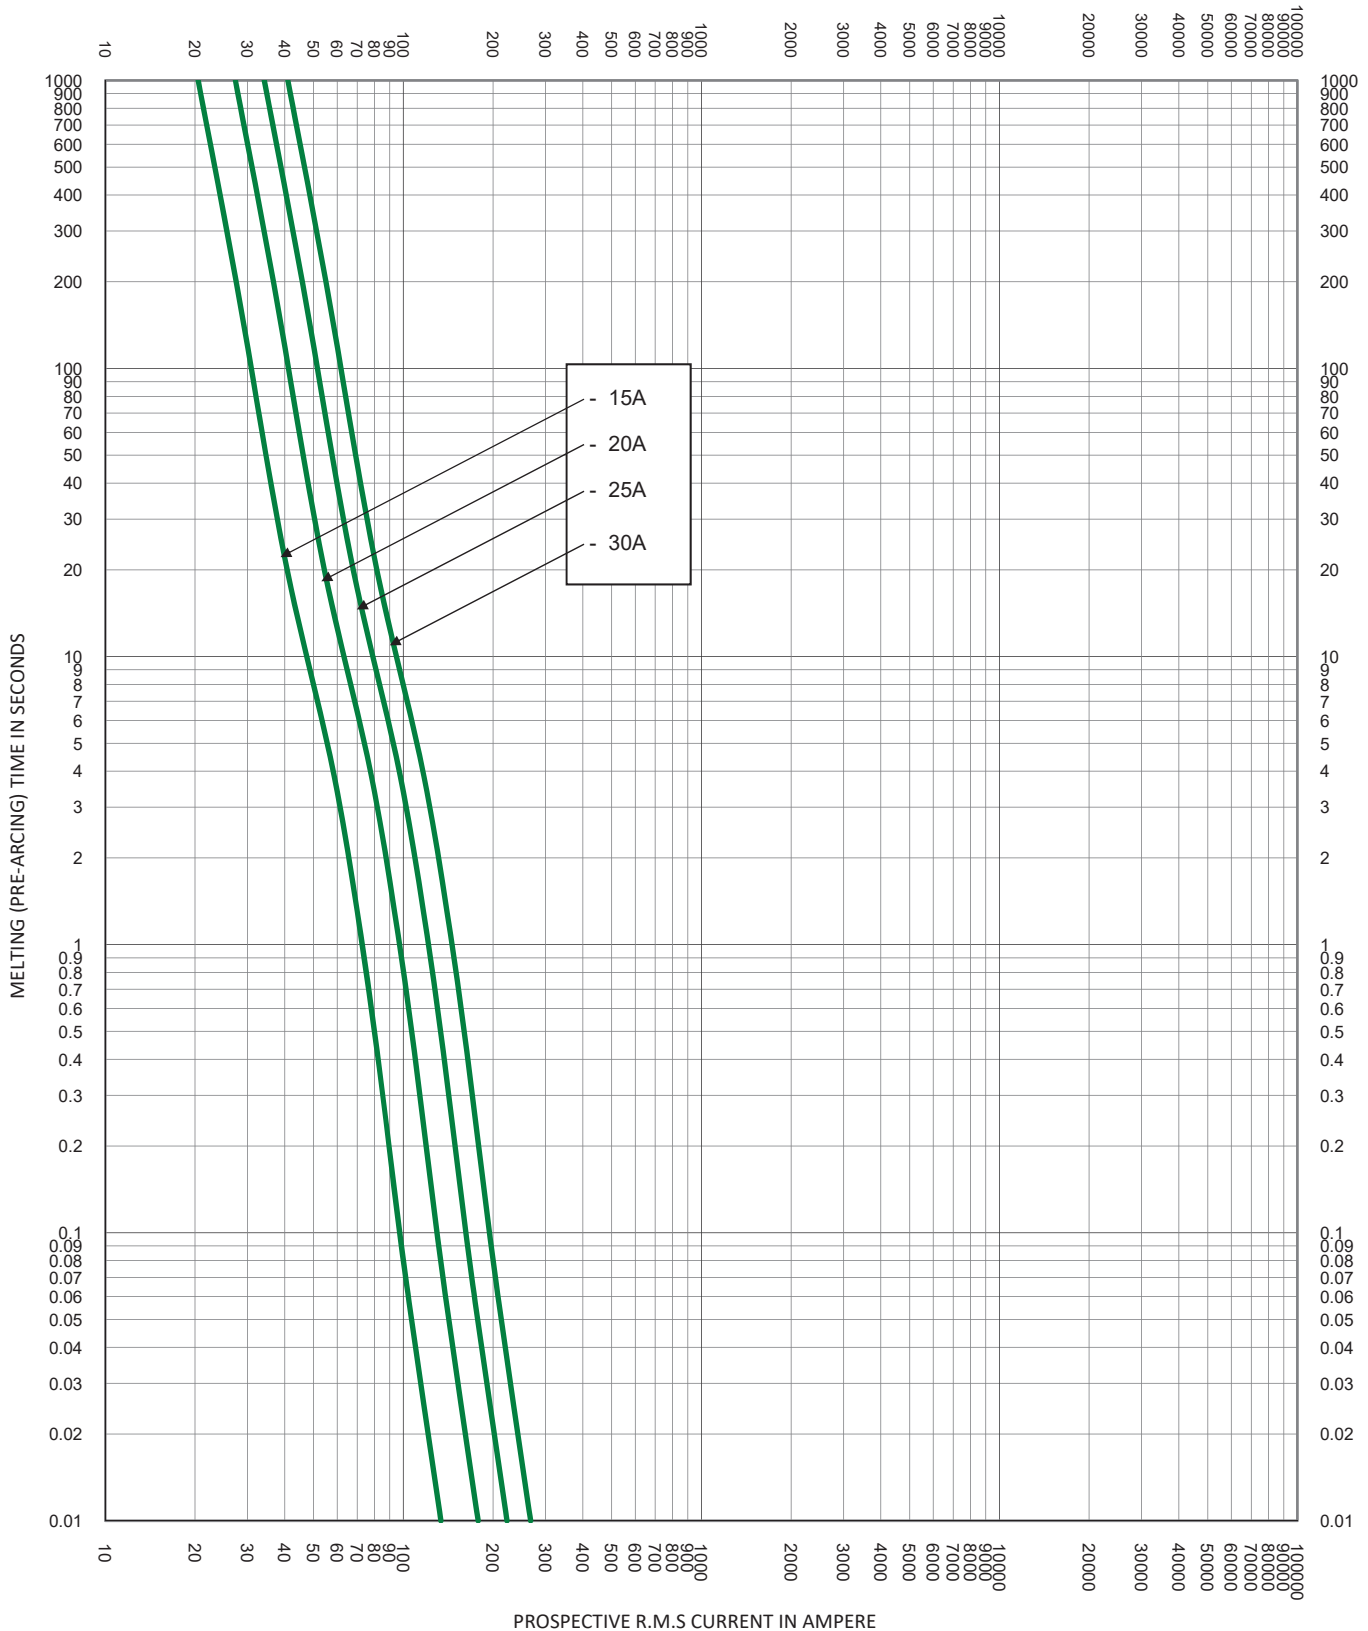

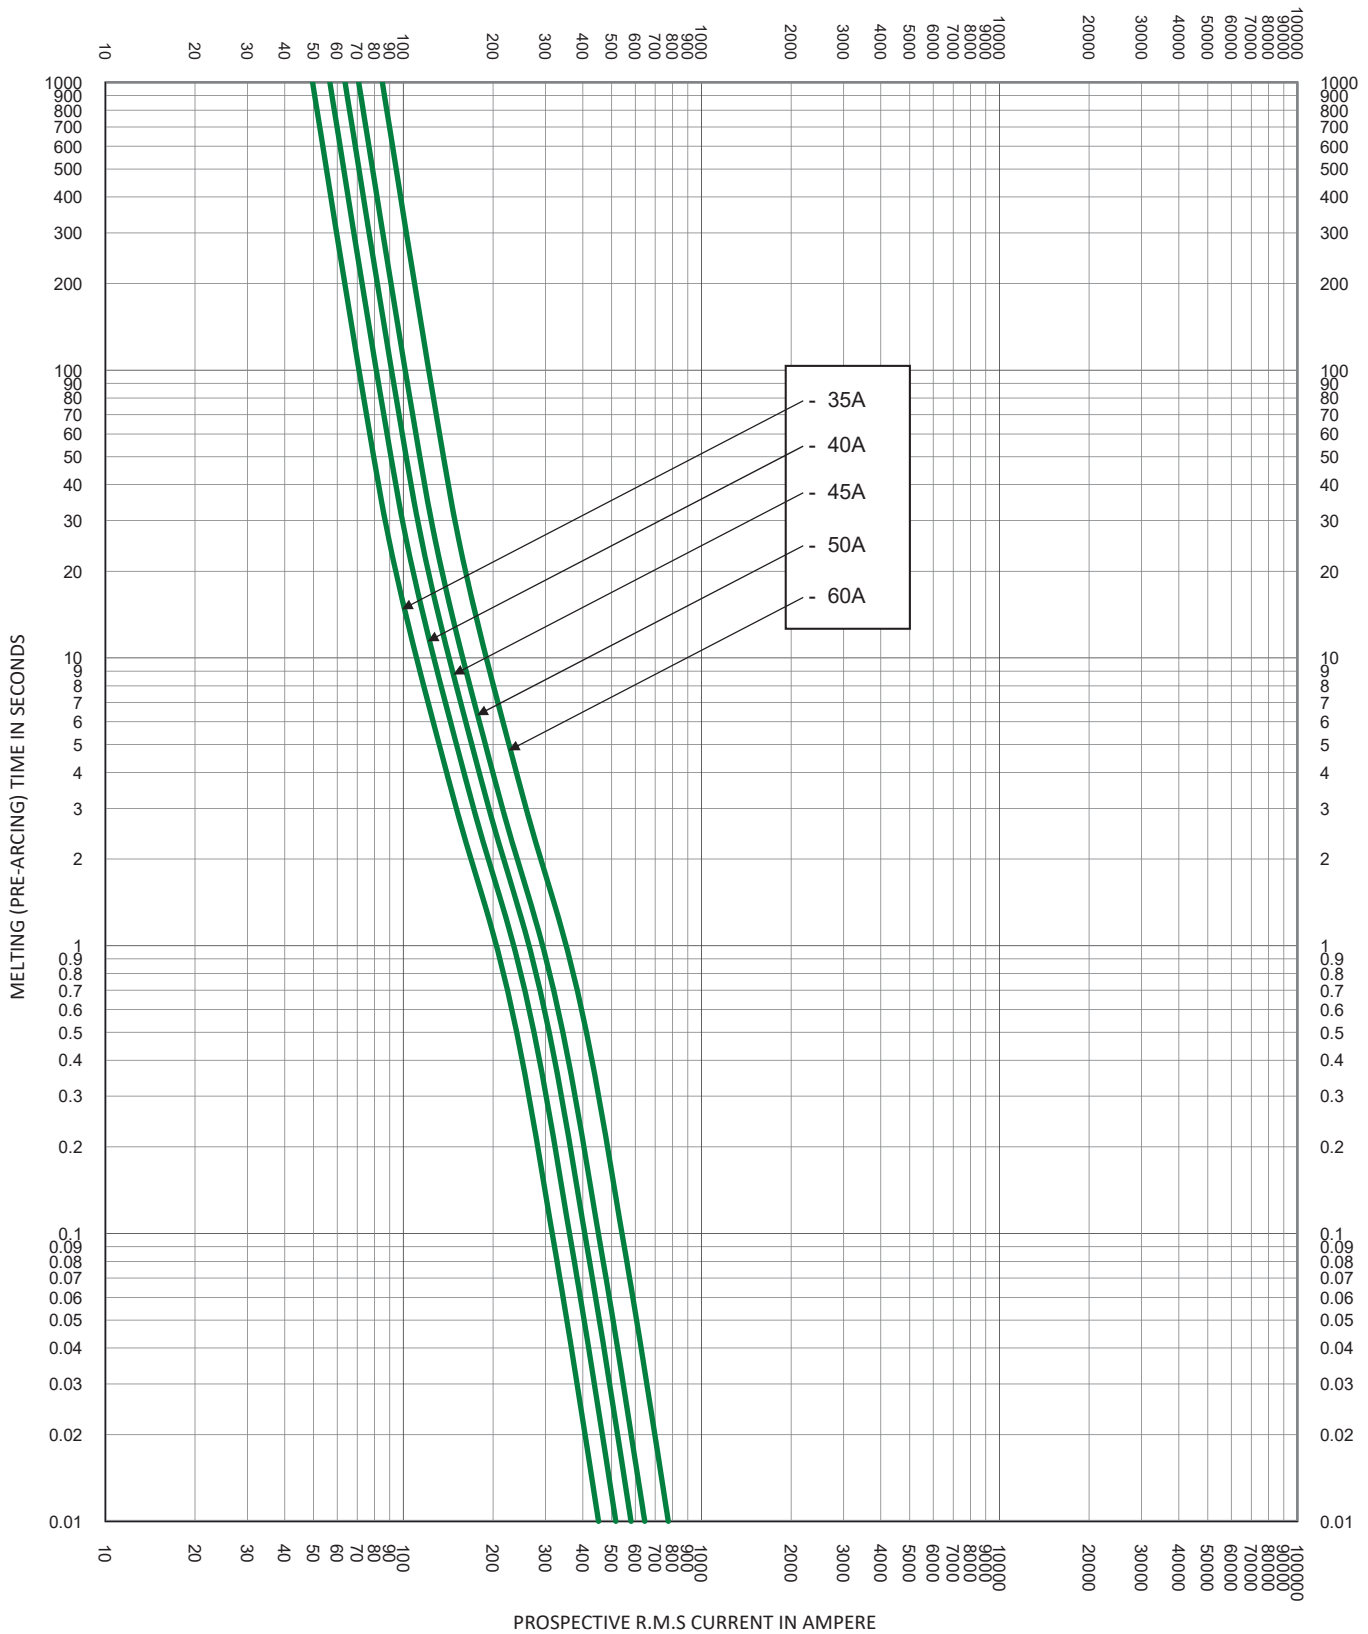



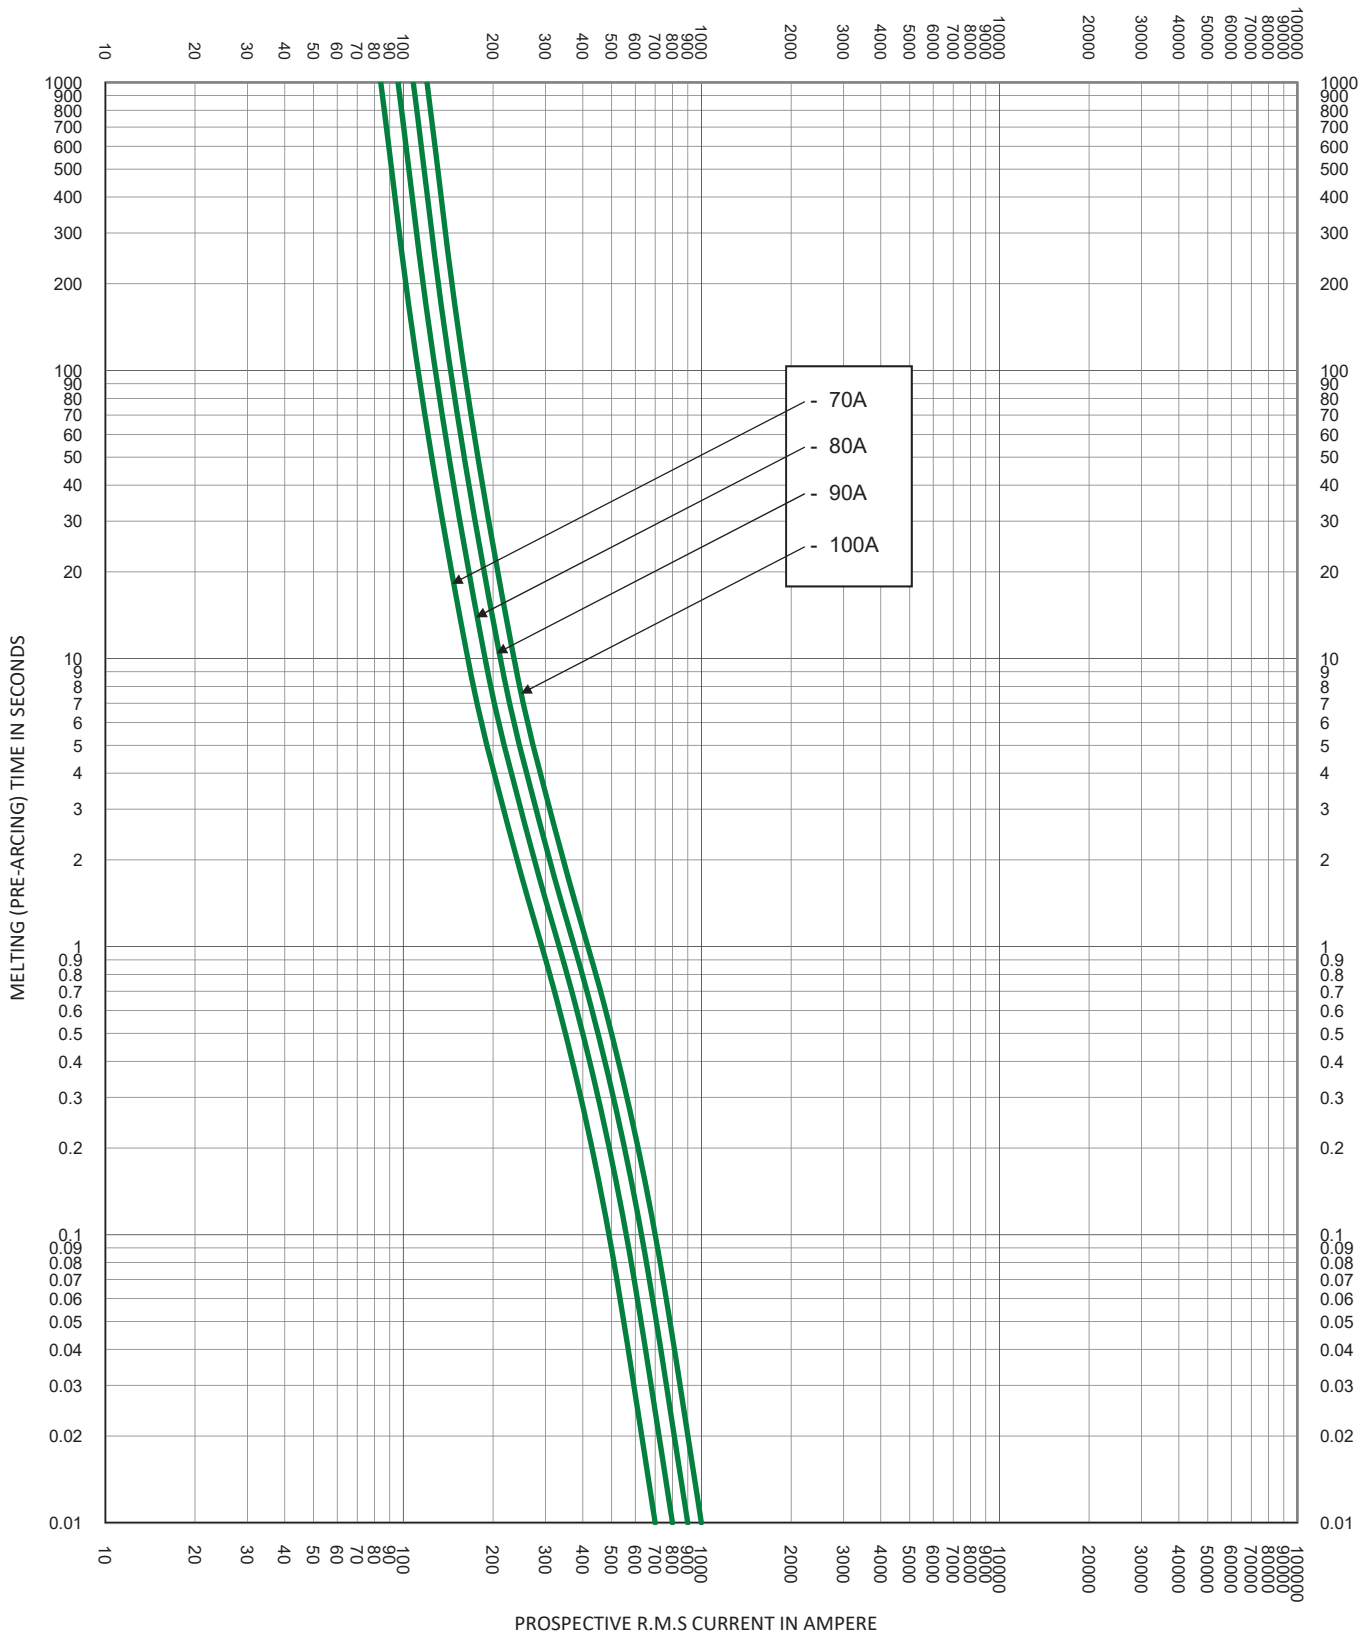
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A
		DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 2 OF 8 FCC01-KLSR




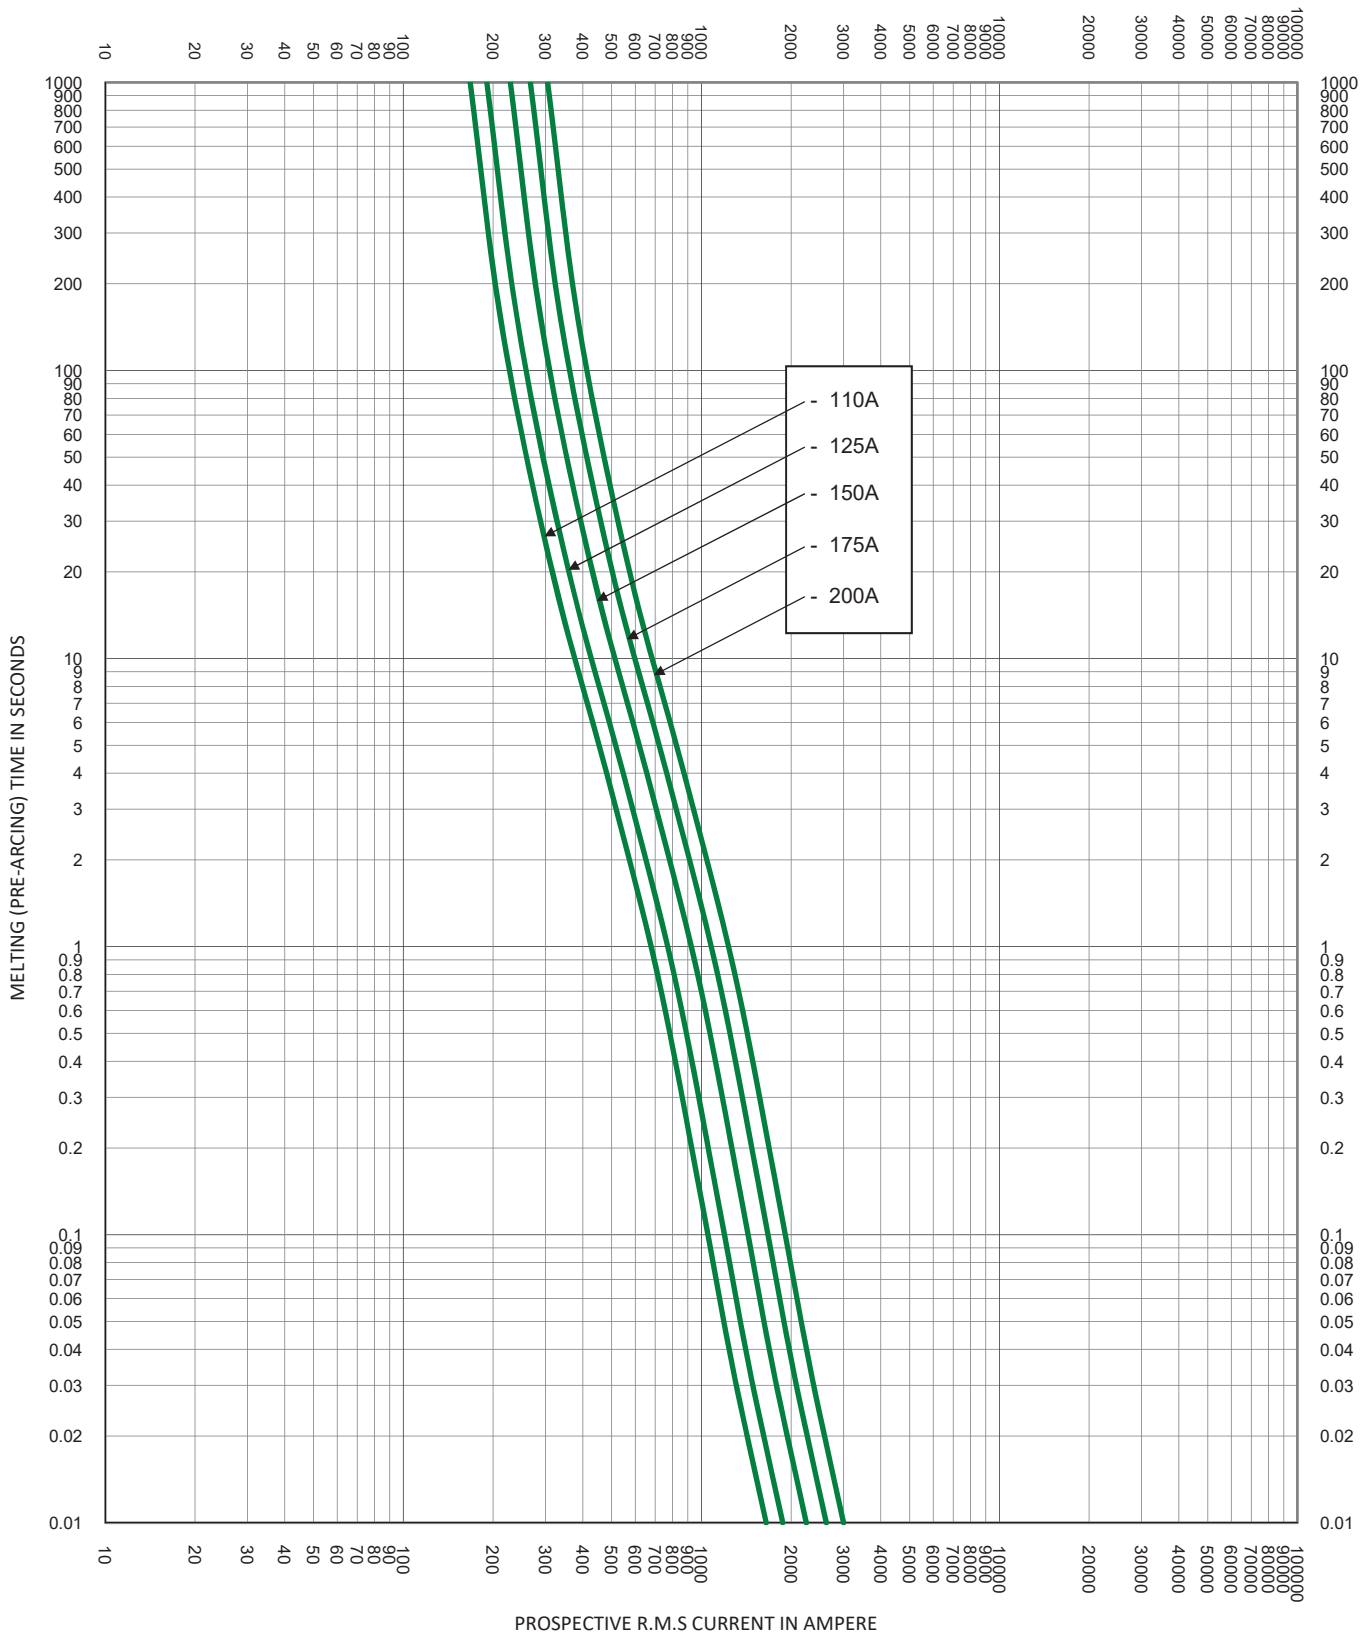
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A
		DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 3 OF 8 FCC01-KLSR




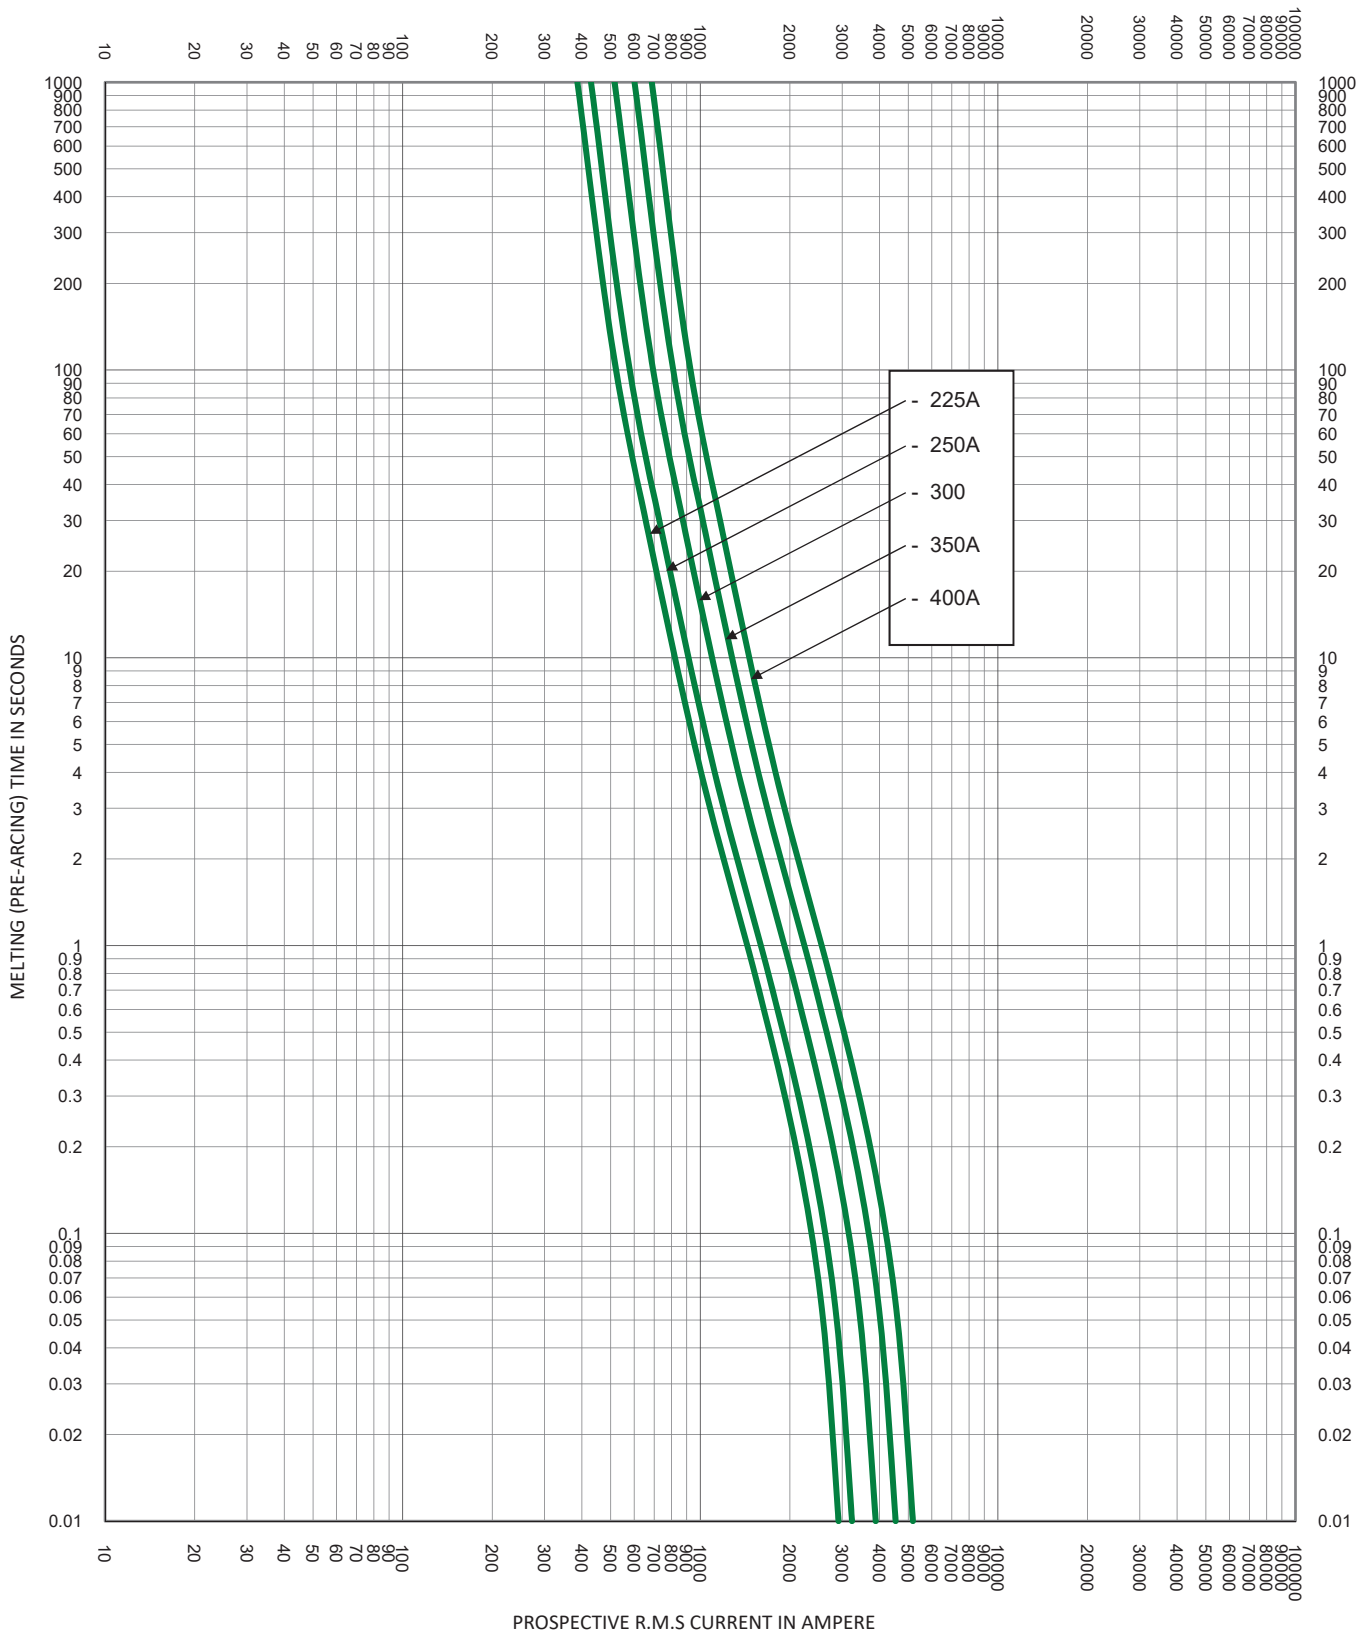
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A
		DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 4 OF 8 FCC01-KLSR




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 5 OF 8 FCC01-KLSR




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A
		DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 6 OF 8 FCC01-KLSR




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A

 LITTELFUSE, INC. CHICAGO, IL. USA	DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
	DRAWING NO.: SHEET 7 OF 8 FCC01-KLSR

TIME CURRENT CHARACTERISTIC CURVES

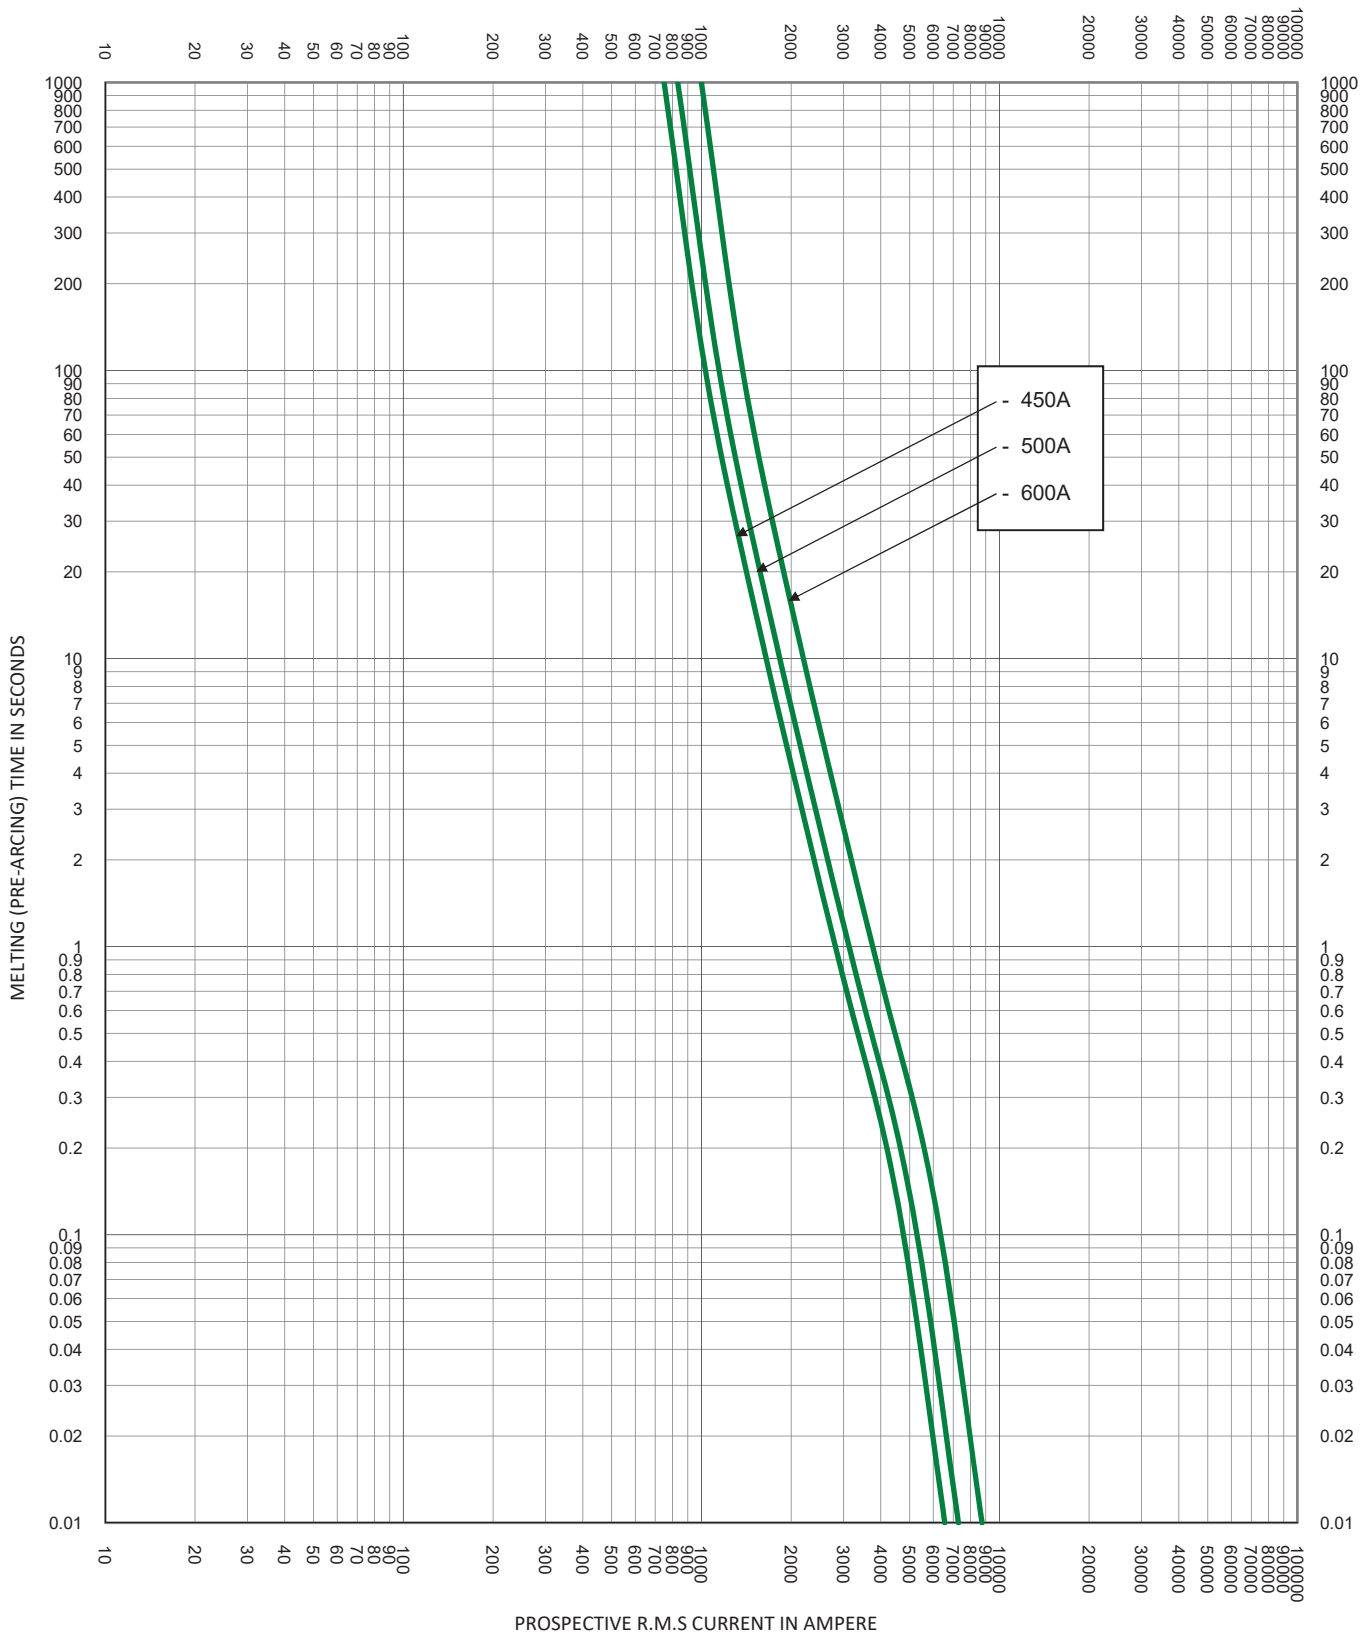

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 8 OF 8 FCC01-KLSR