
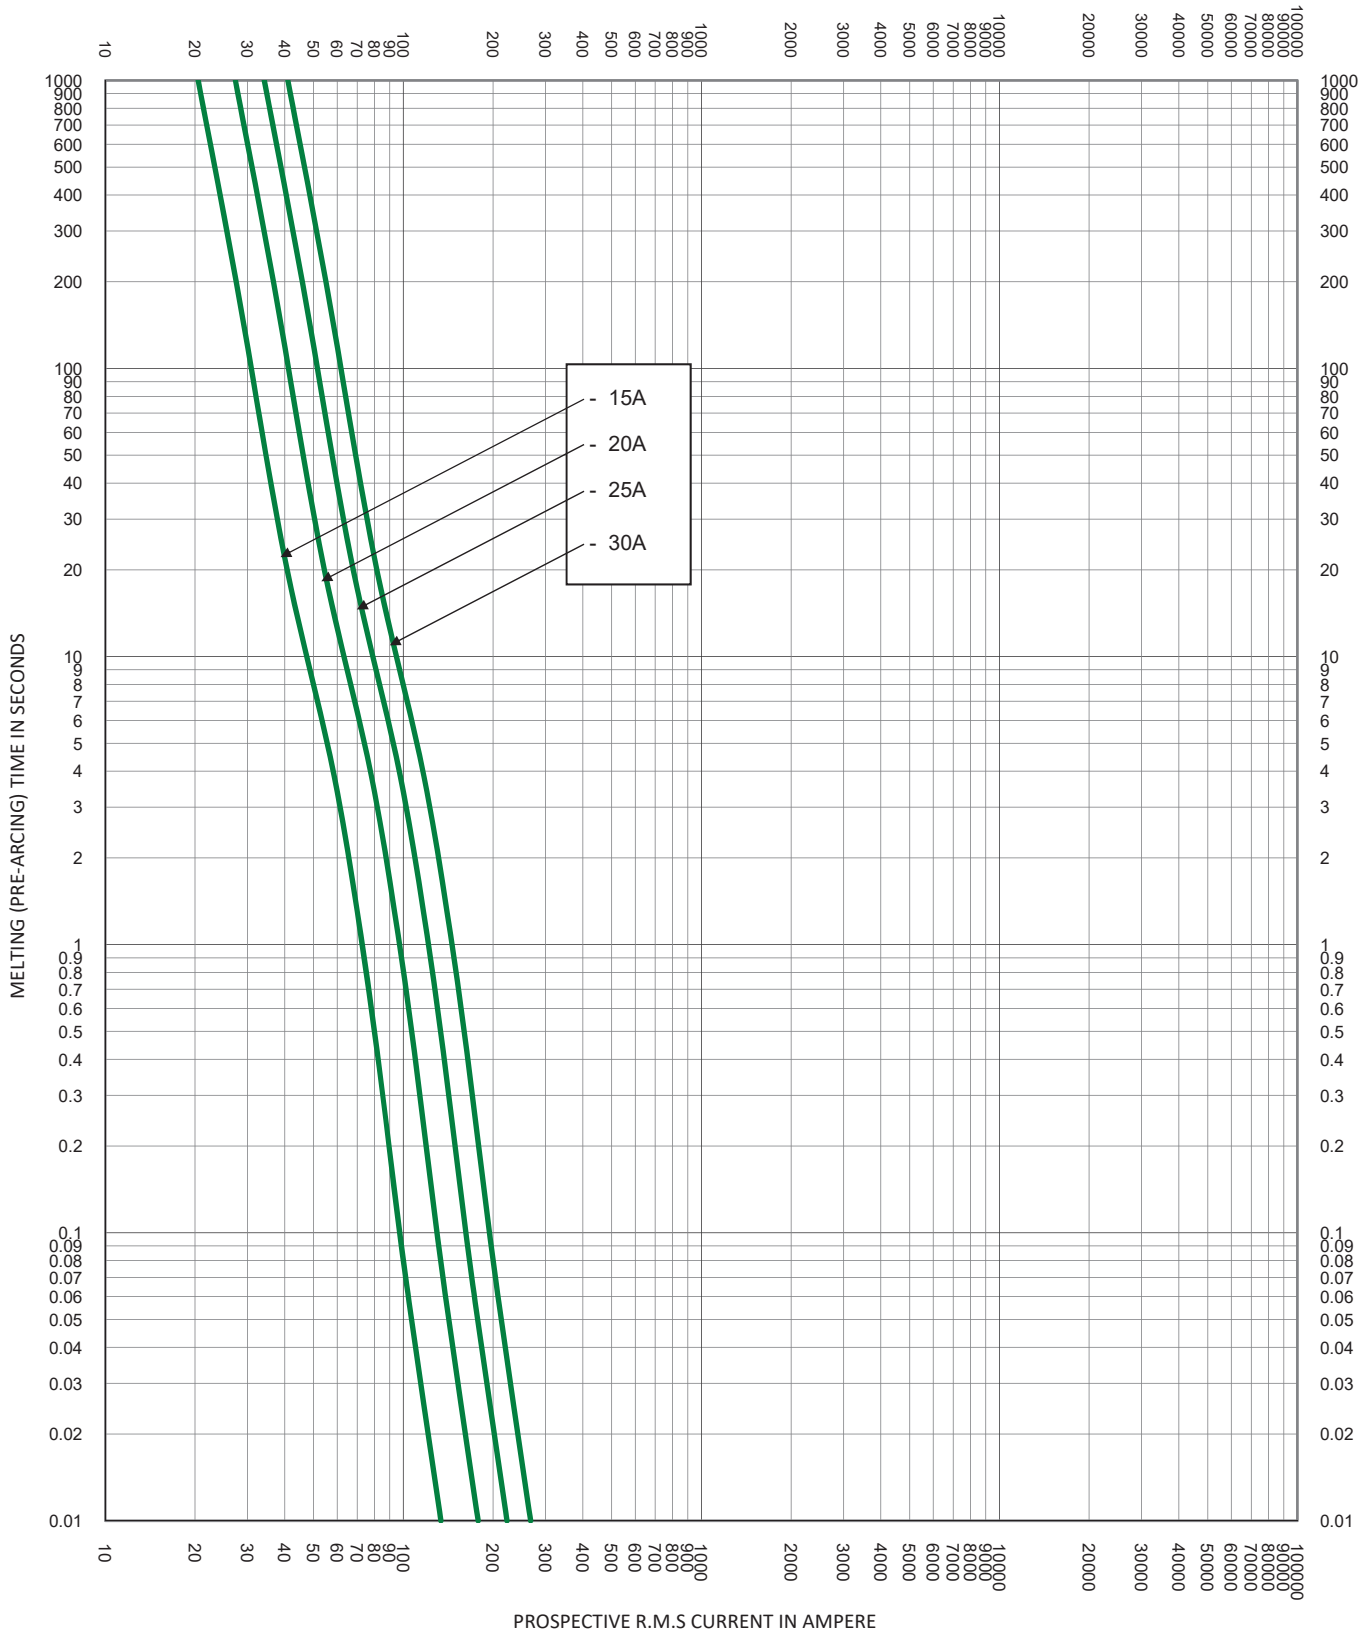



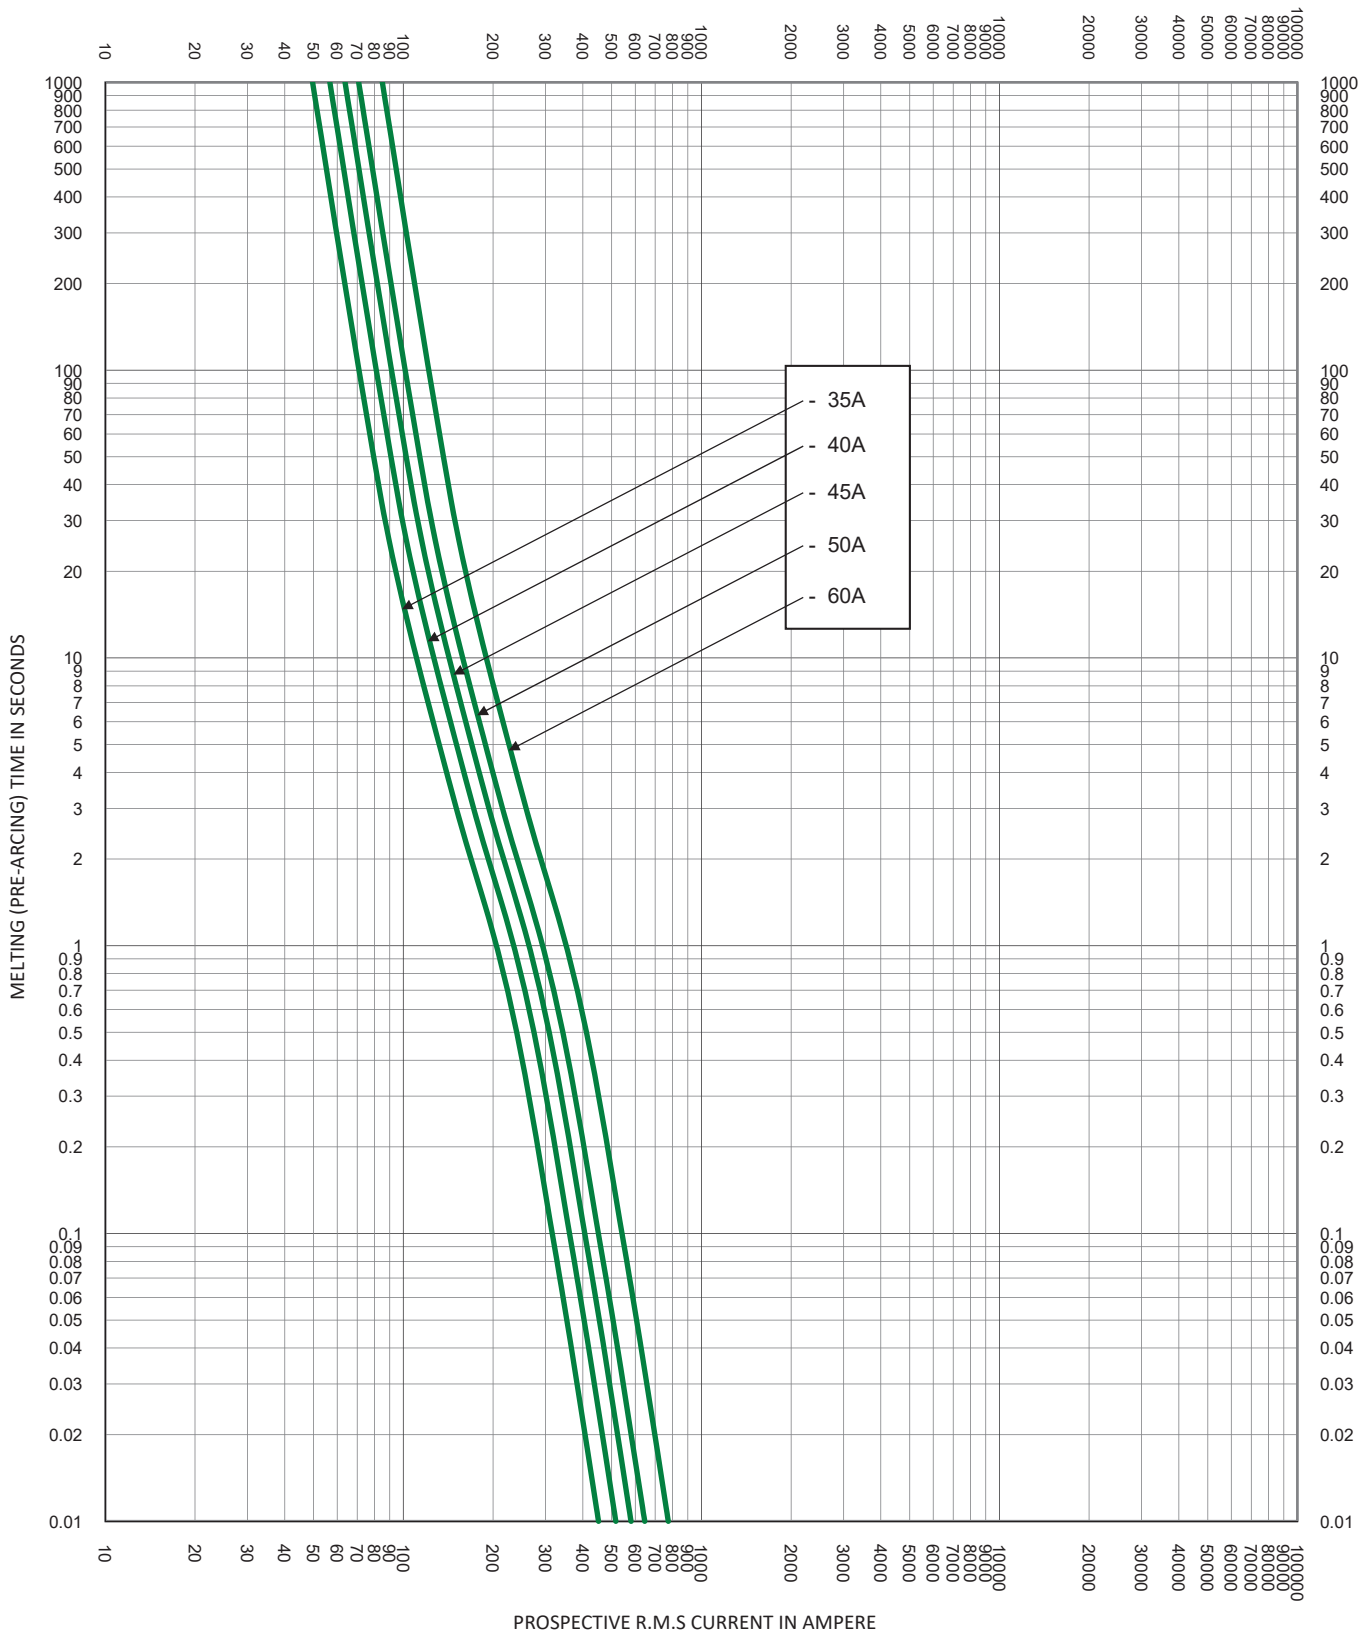
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A


 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA	DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
	DRAWING NO.: SHEET 2 OF 8 <b>FCC01-KLSR</b>


**TIME CURRENT CHARACTERISTIC CURVES**




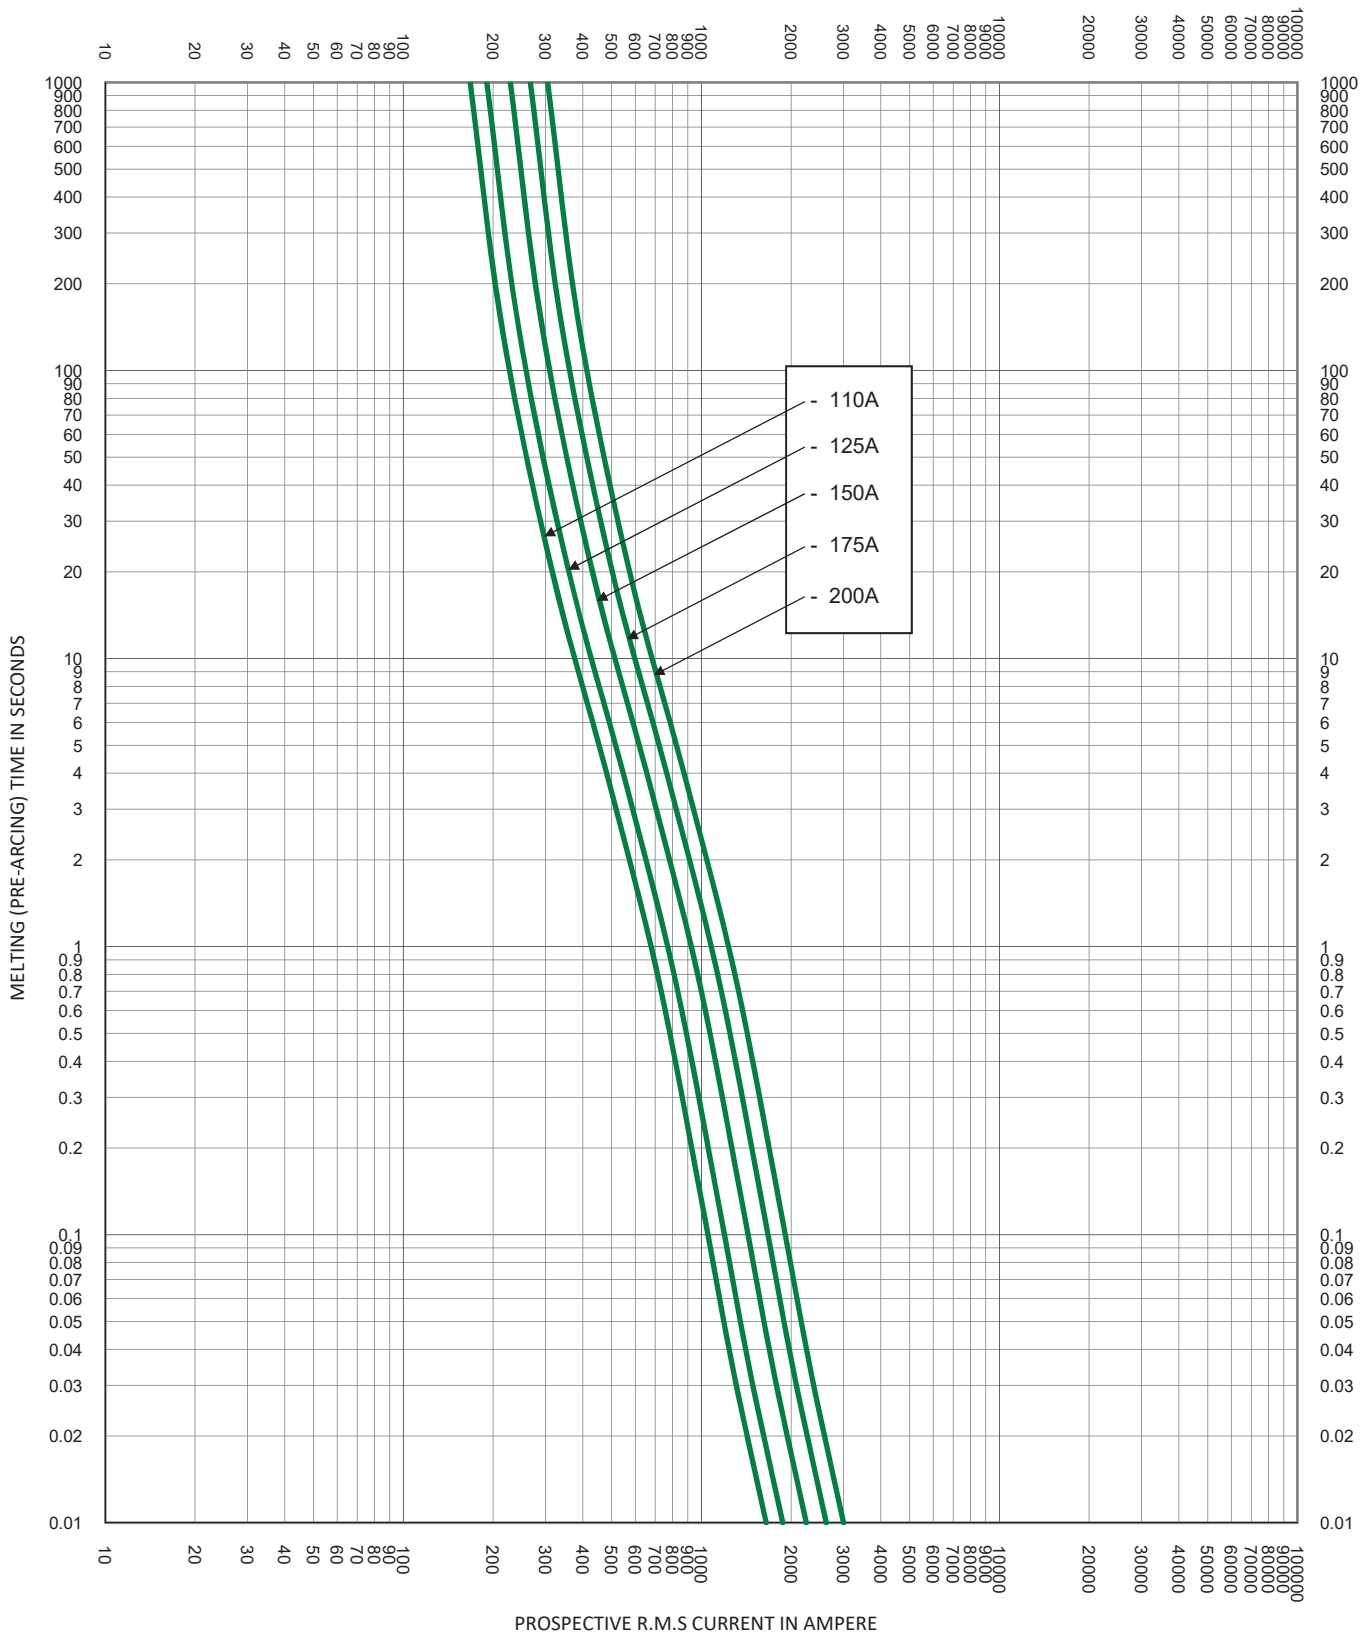
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A
		DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 3 OF 8 <b>FCC01-KLSR</b>




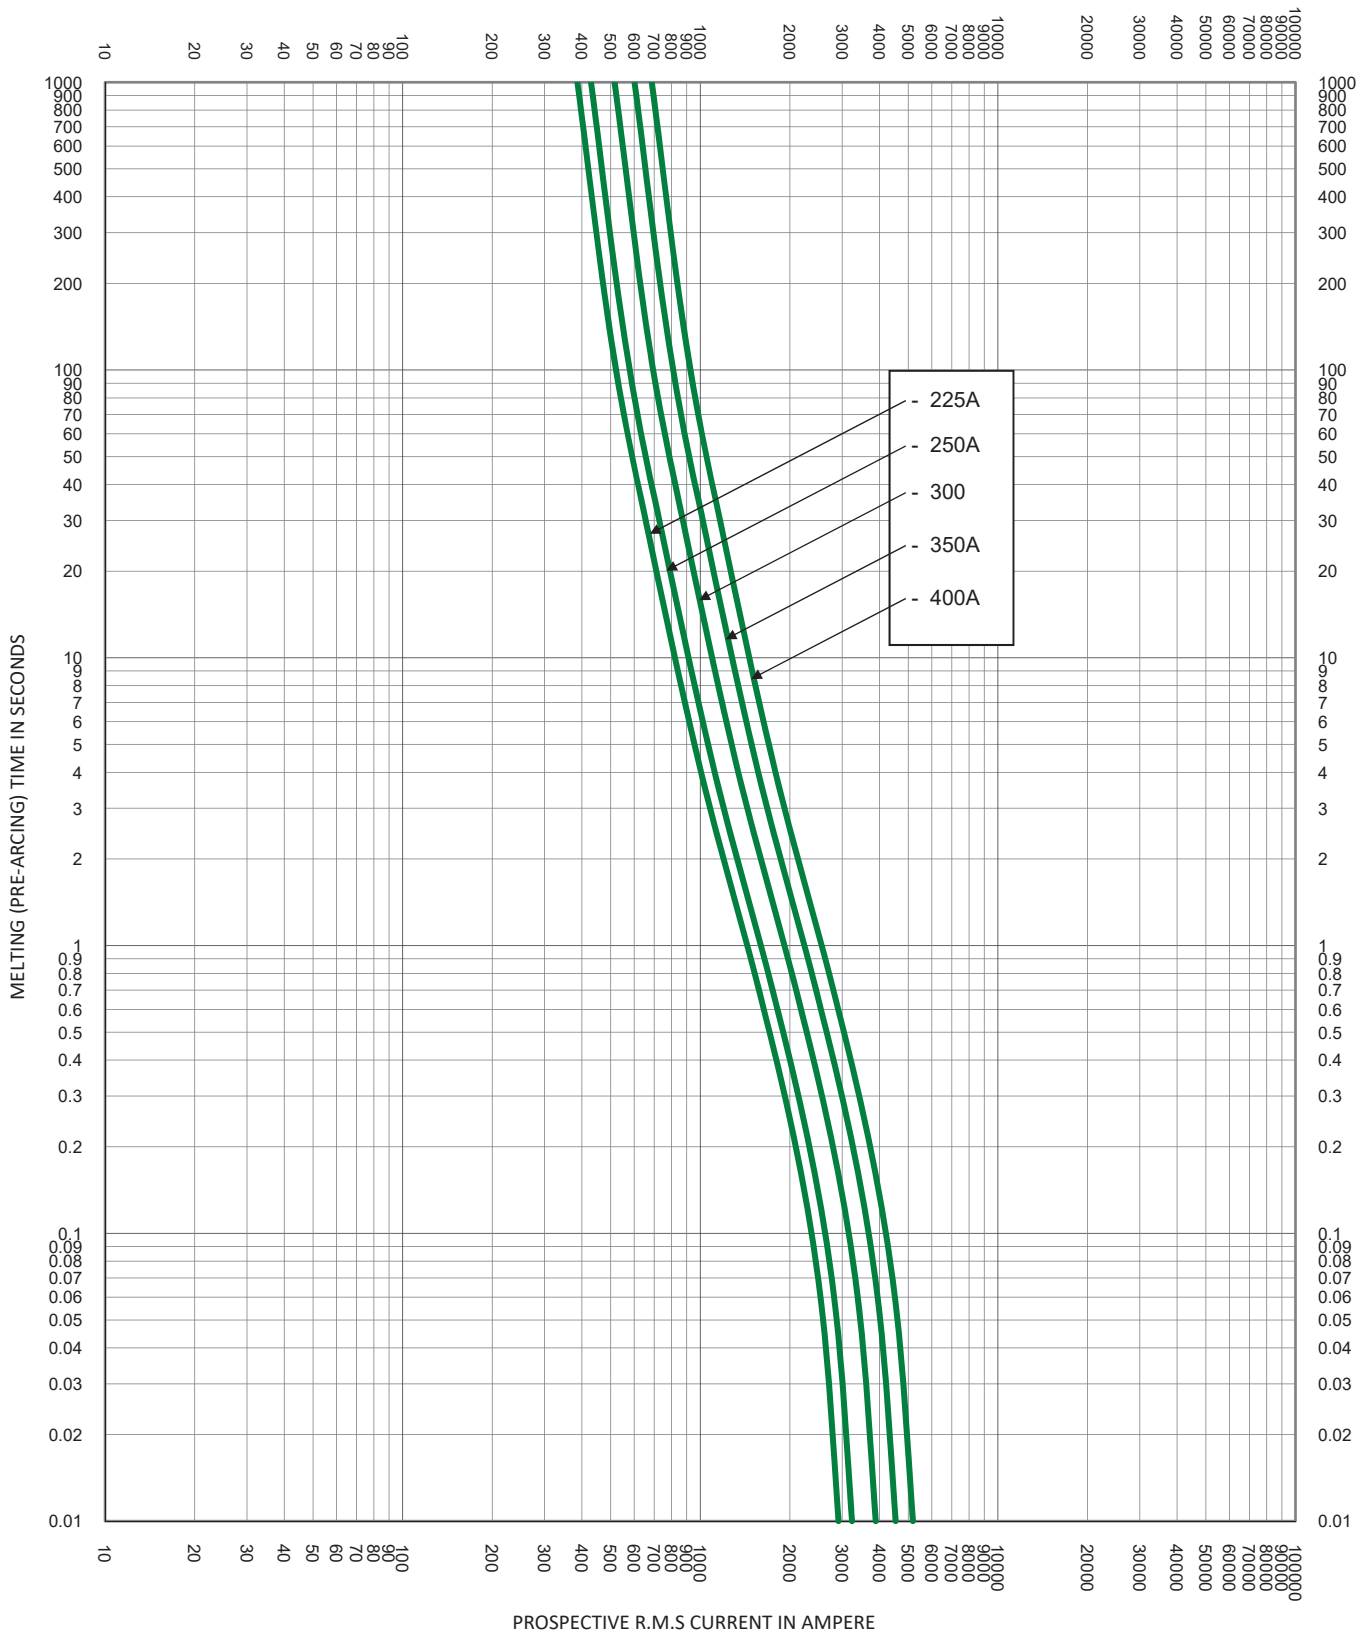
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A
		DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 4 OF 8 <b>FCC01-KLSR</b>

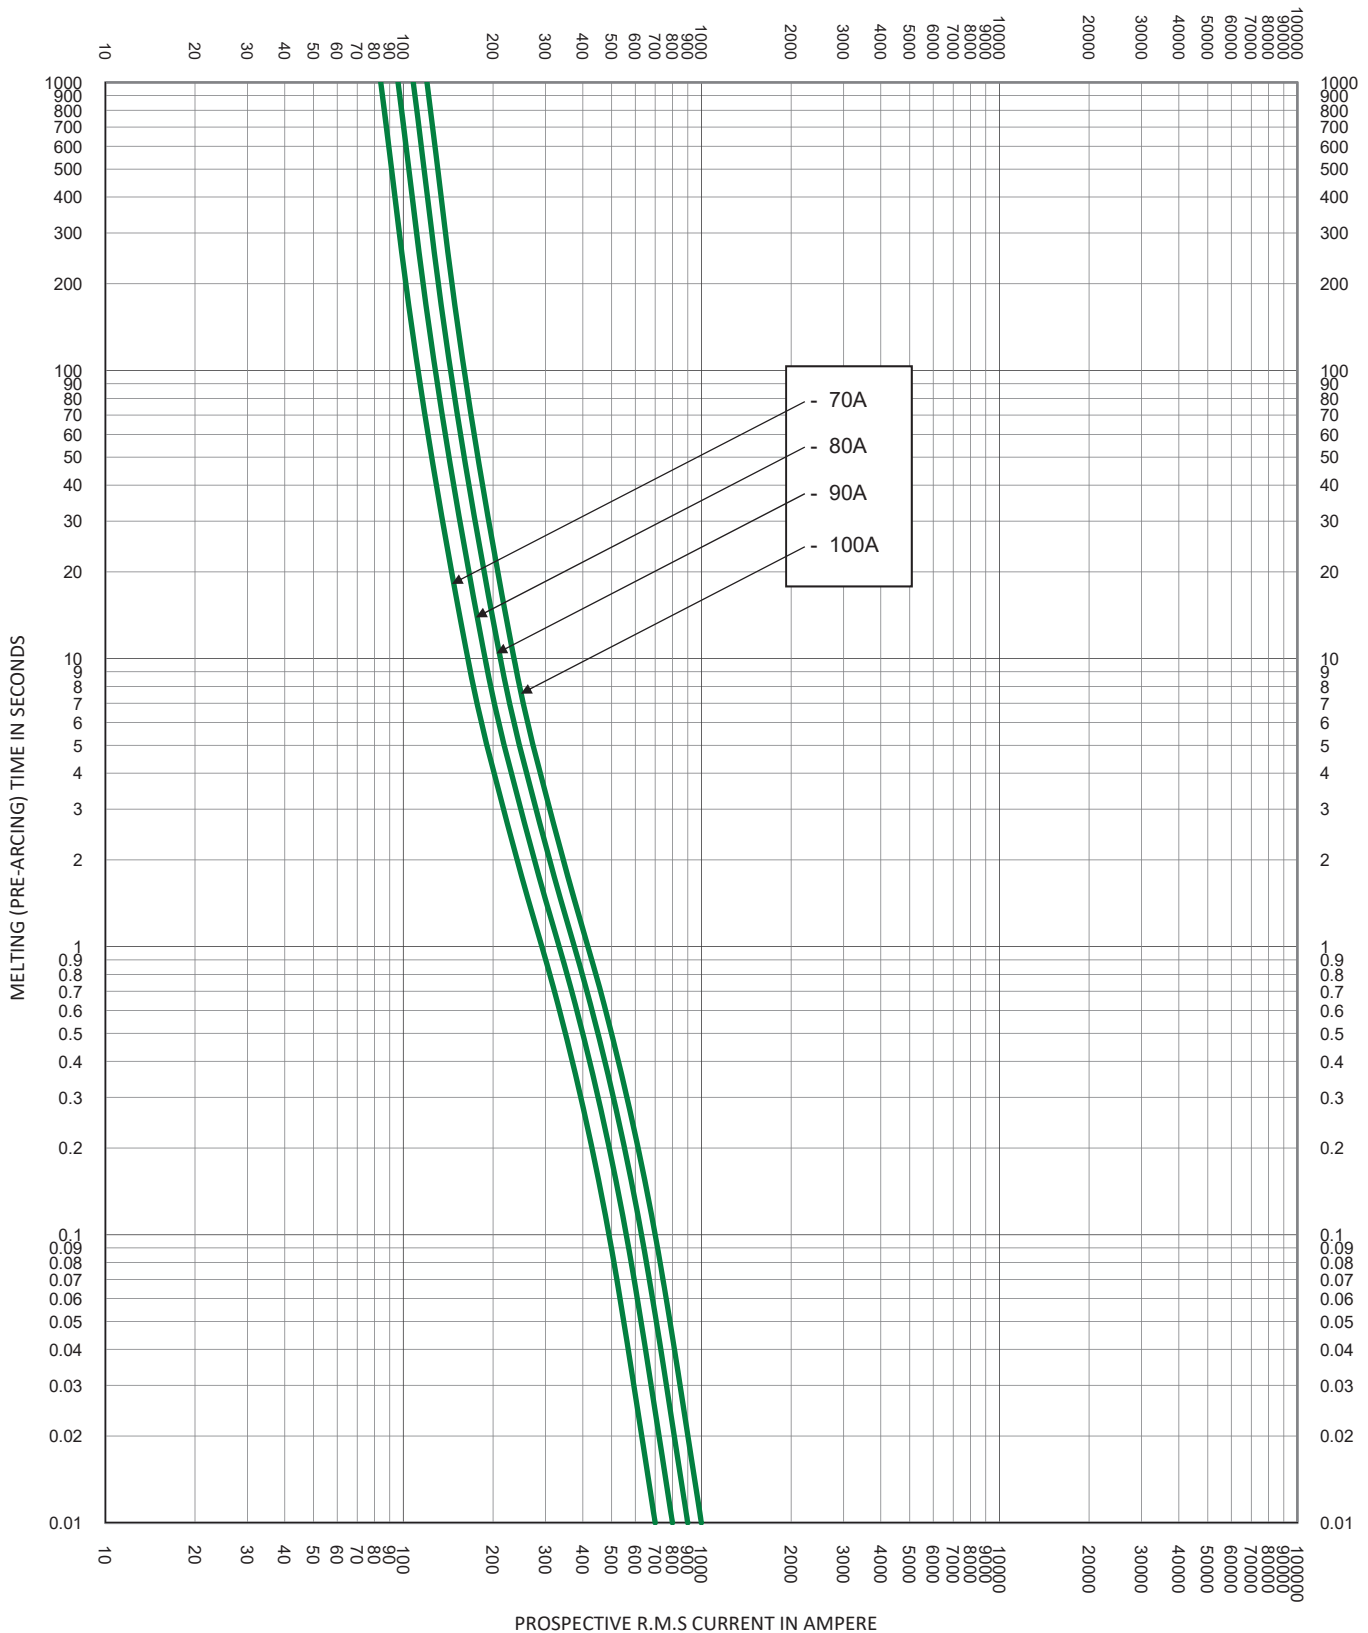


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A
		DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 5 OF 8 <b>FCC01-KLSR</b>




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A
		DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 6 OF 8 <b>FCC01-KLSR</b>




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A

	DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
	DRAWING NO.: SHEET 7 OF 8 <b>FCC01-KLSR</b>

**TIME CURRENT CHARACTERISTIC CURVES**

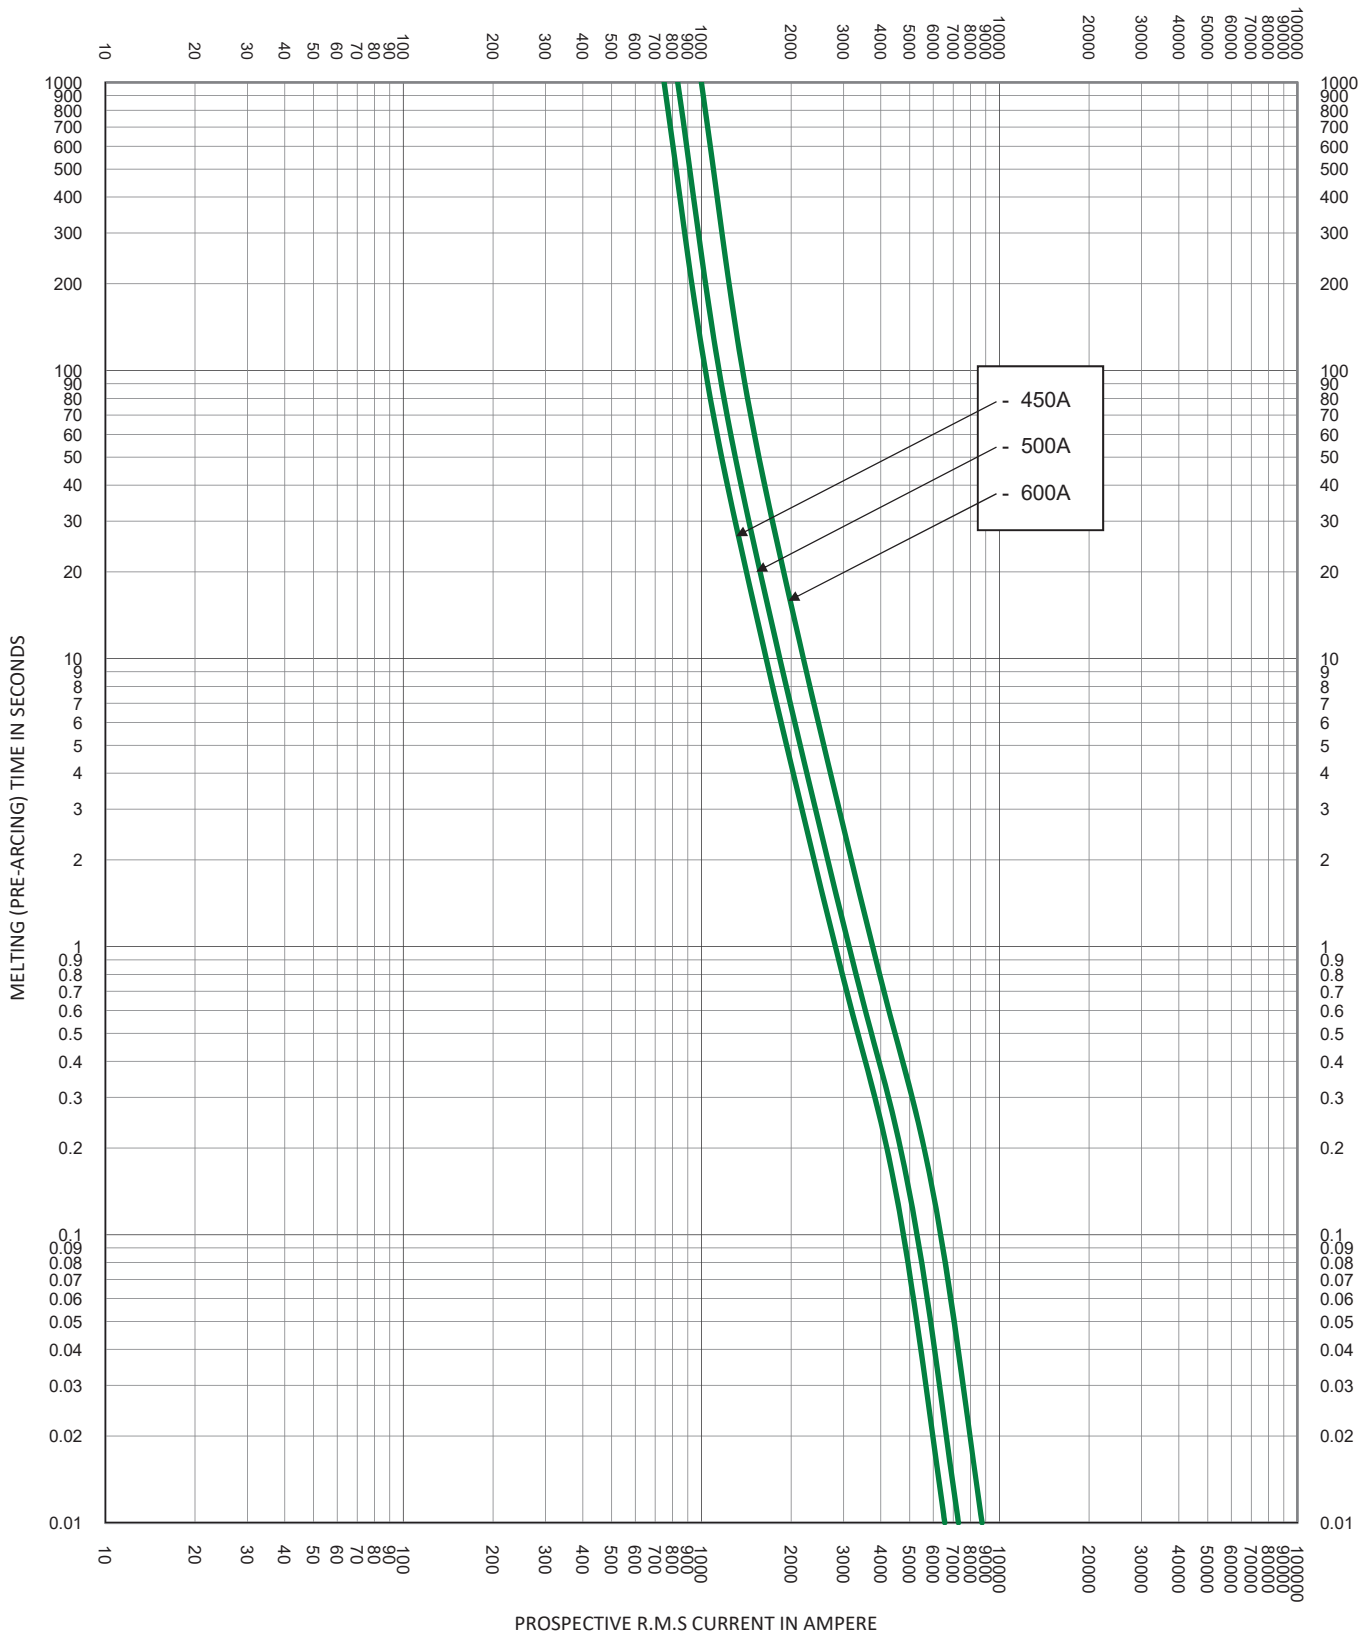

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLSR 1A - 600A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 07/12/2019 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 8 OF 8 <b>FCC01-KLSR</b>