
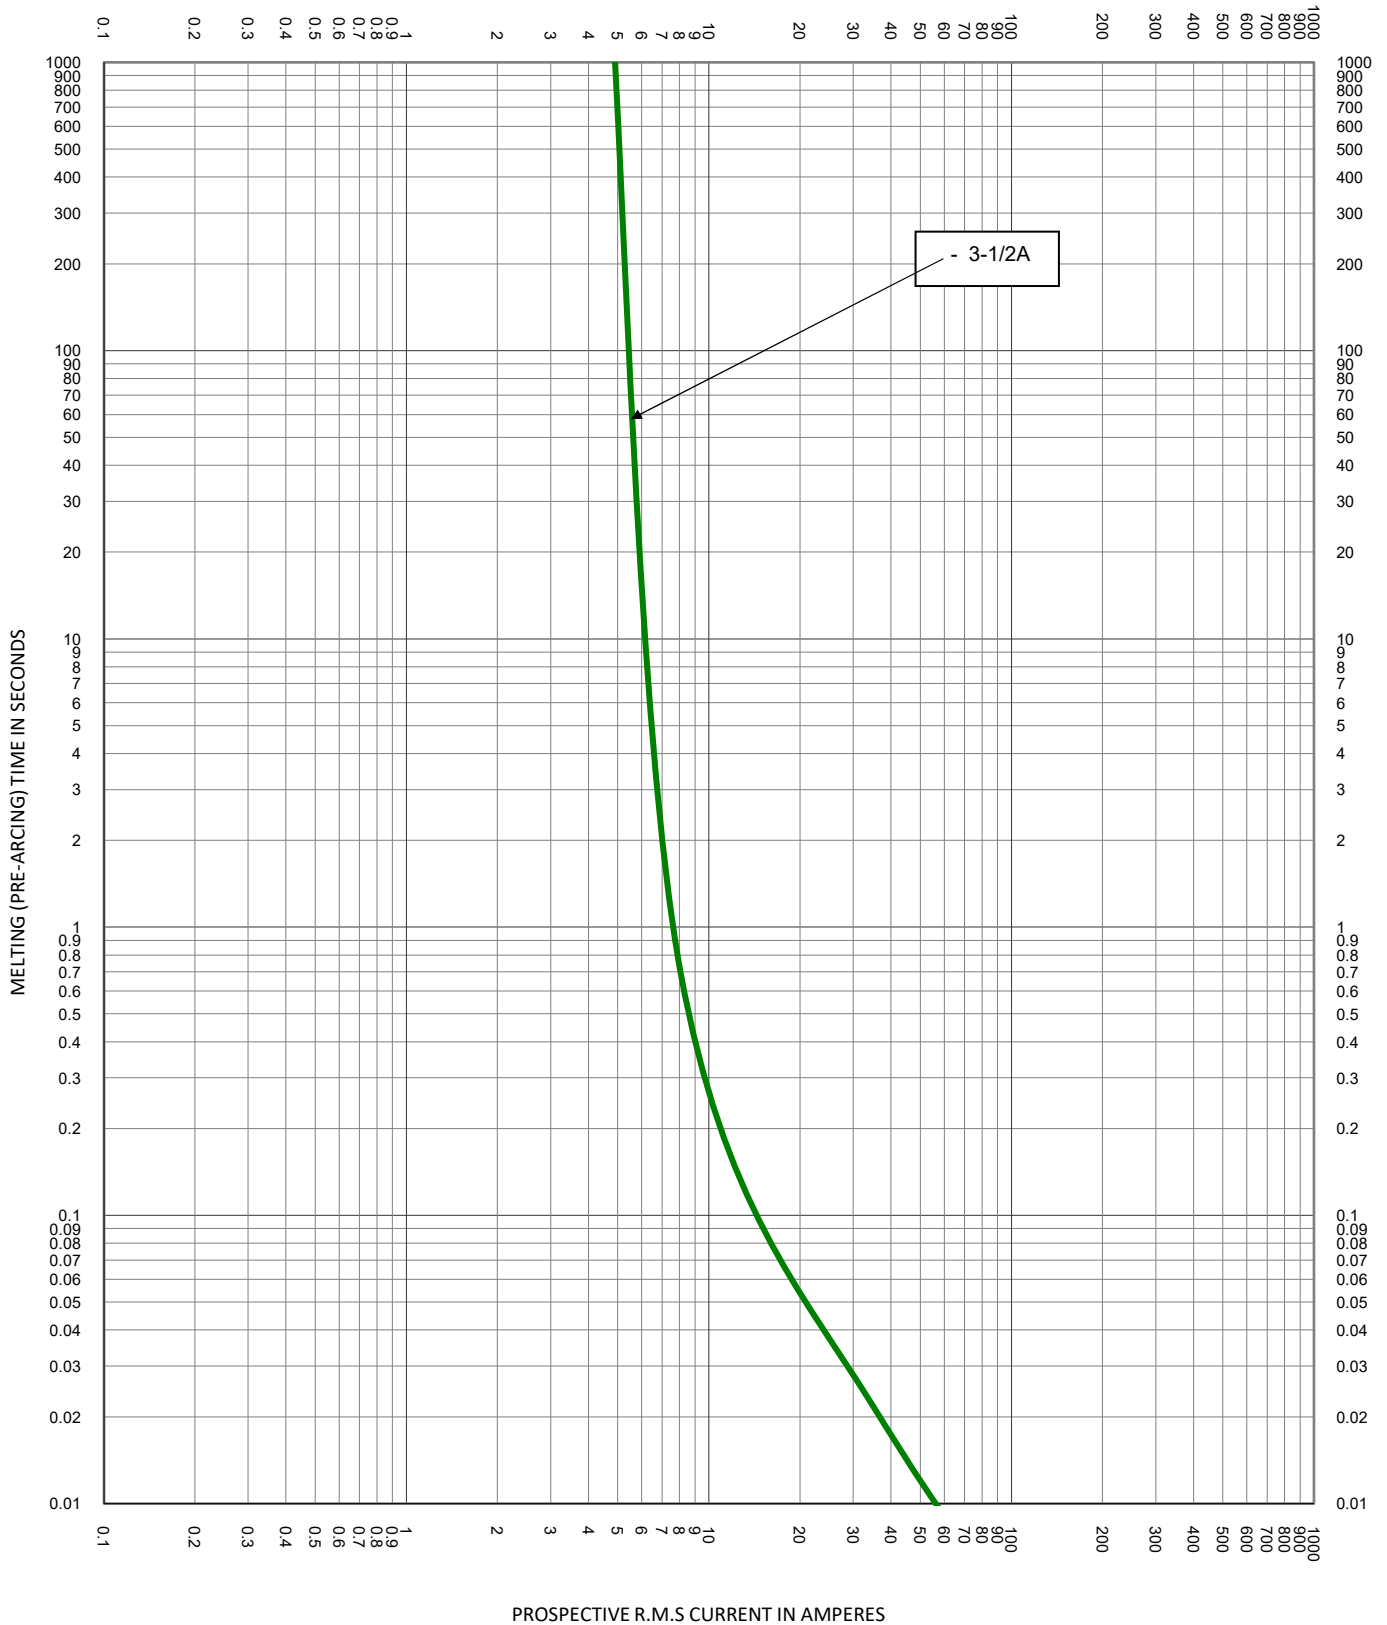



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A

 <b>LITTELFUSE, INC.</b> CHICAGO, IL, USA	DRAWN BY: LLL DATE: 03/15/2022 REVISION: J
	DRAWING NO.: SHEET 2 OF 6 <b>FCC01-SPXI</b>


**TIME CURRENT CHARACTERISTIC CURVES**




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A

 <b>LITTELFUSE, INC.</b> CHICAGO, IL, USA	DRAWN BY: LLL DATE: 03/15/2022 REVISION: J
	DRAWING NO.: SHEET 3 OF 6 <b>FCC01-SPXI</b>


**TIME CURRENT CHARACTERISTIC CURVES**

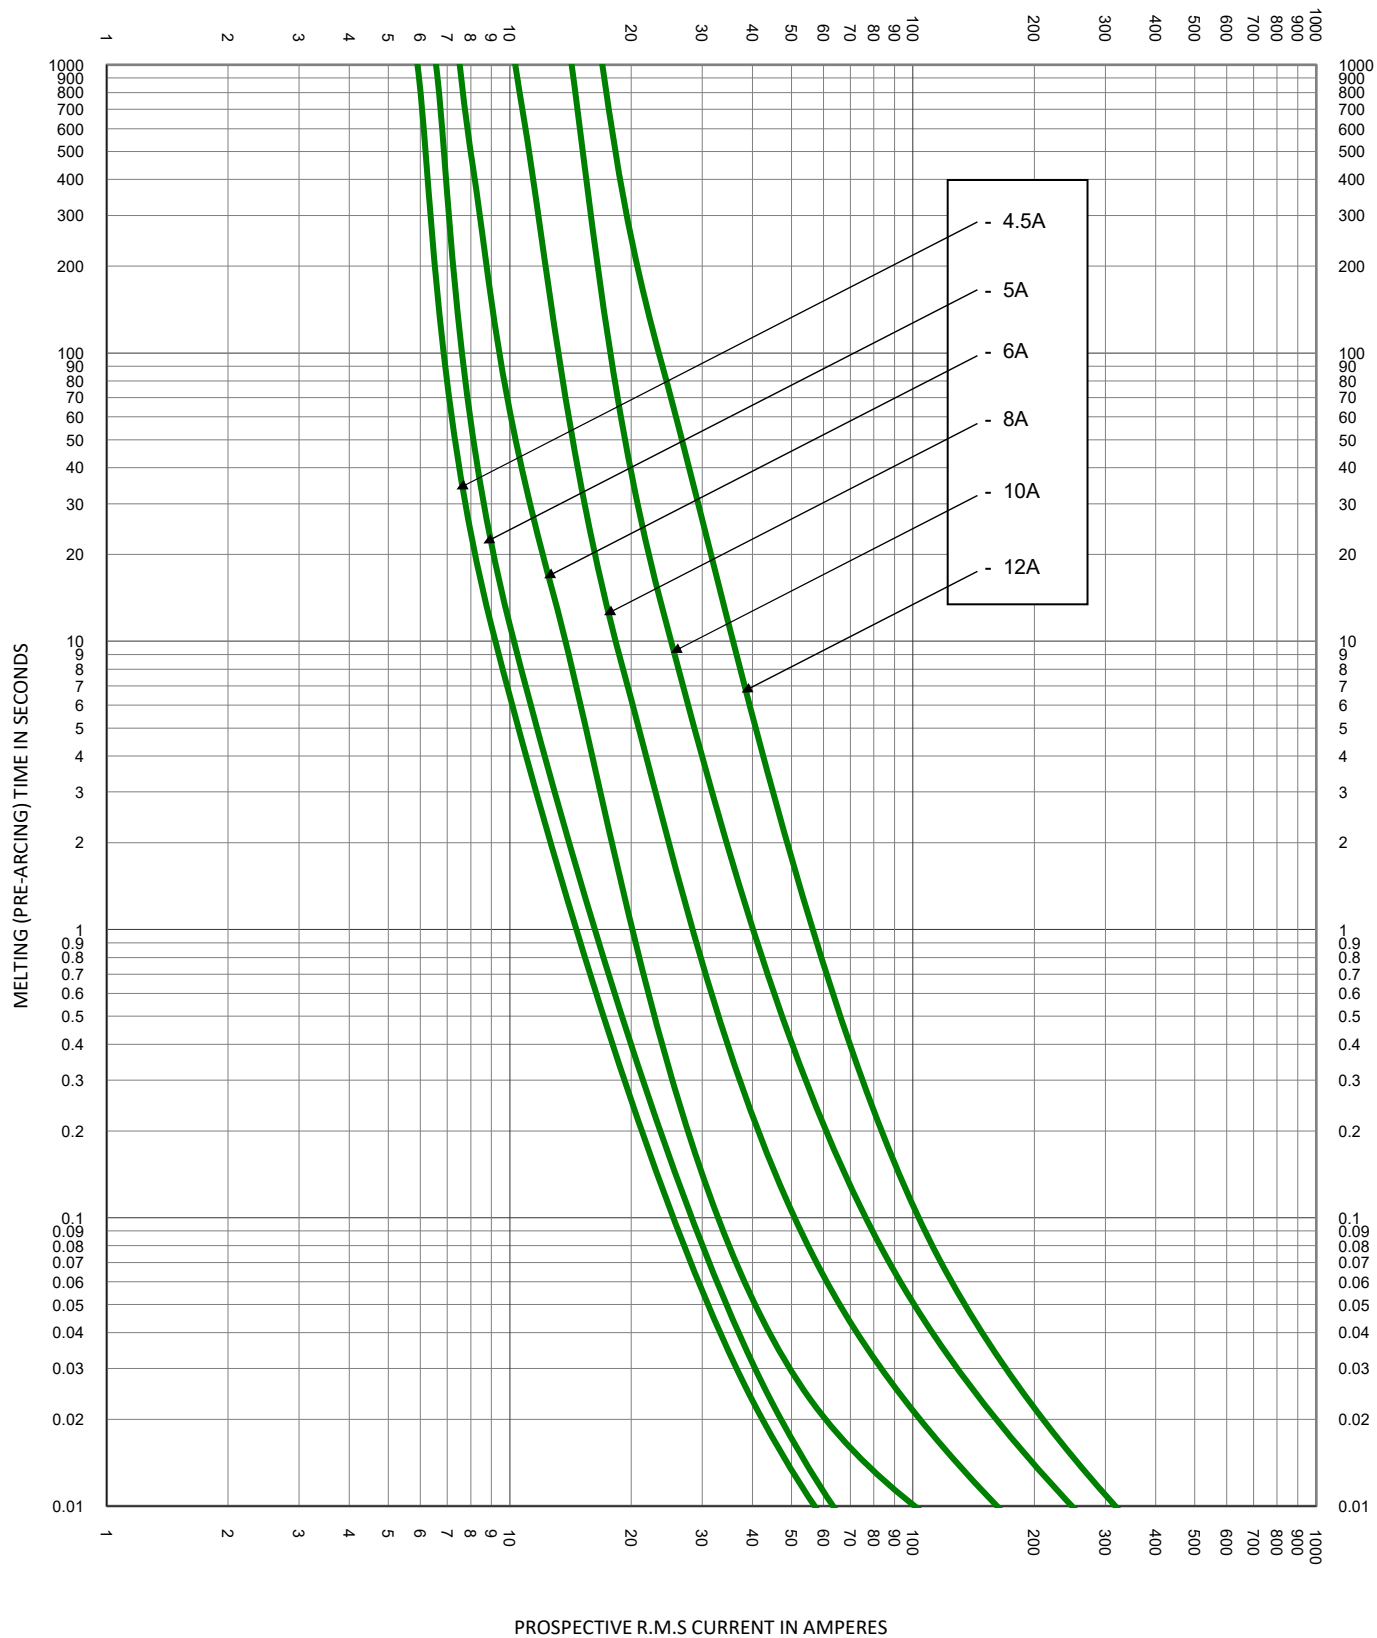


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A

 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA	DRAWN BY: LLL DATE: 03/15/2022 REVISION: J
	DRAWING NO.: SHEET 4 OF 6 <b>FCC01-SPXI</b>


**TIME CURRENT CHARACTERISTIC CURVES**

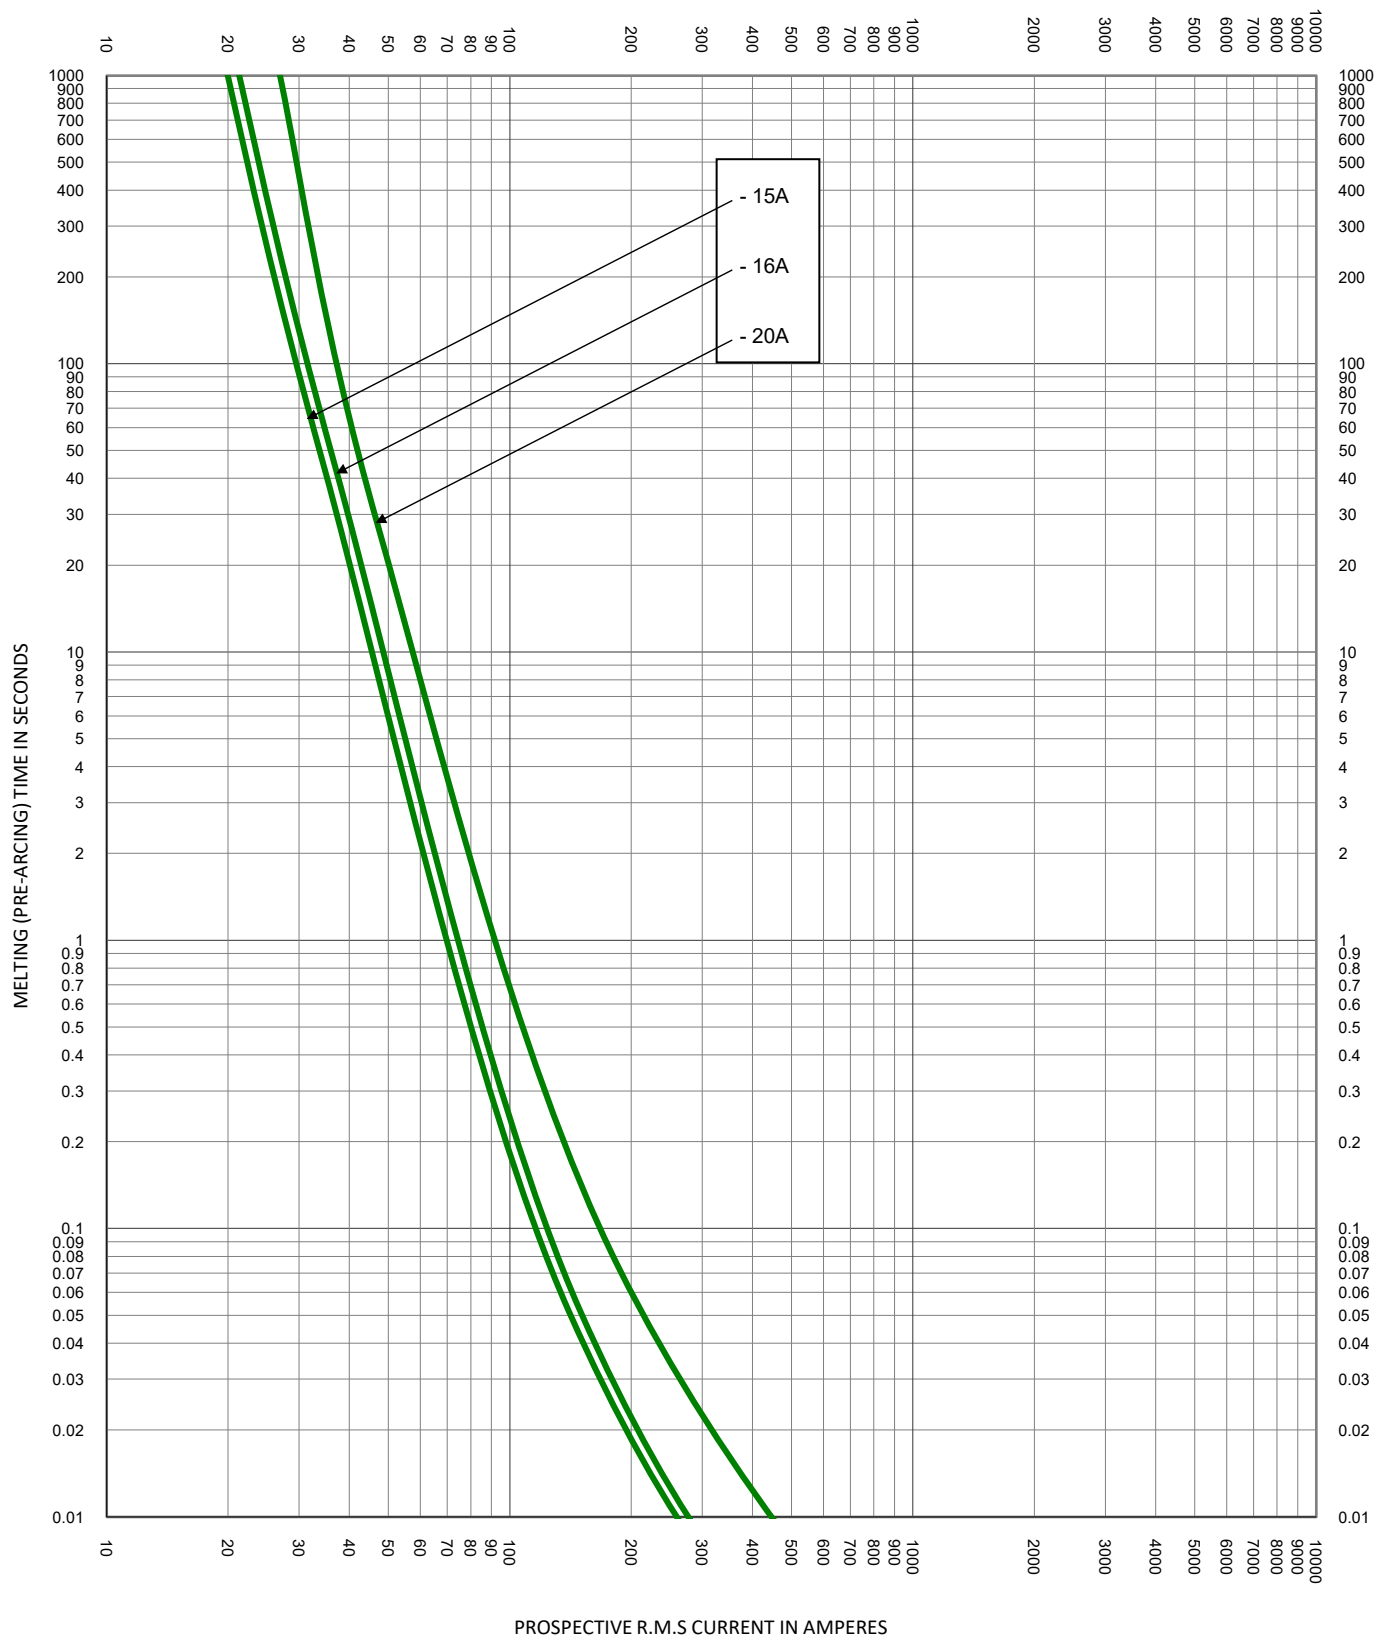


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A

 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA	DRAWN BY: LLL DATE: 03/15/2022 REVISION: J
	DRAWING NO.: SHEET 5 OF 6 <b>FCC01-SPXI</b>

**TIME CURRENT CHARACTERISTIC CURVES**

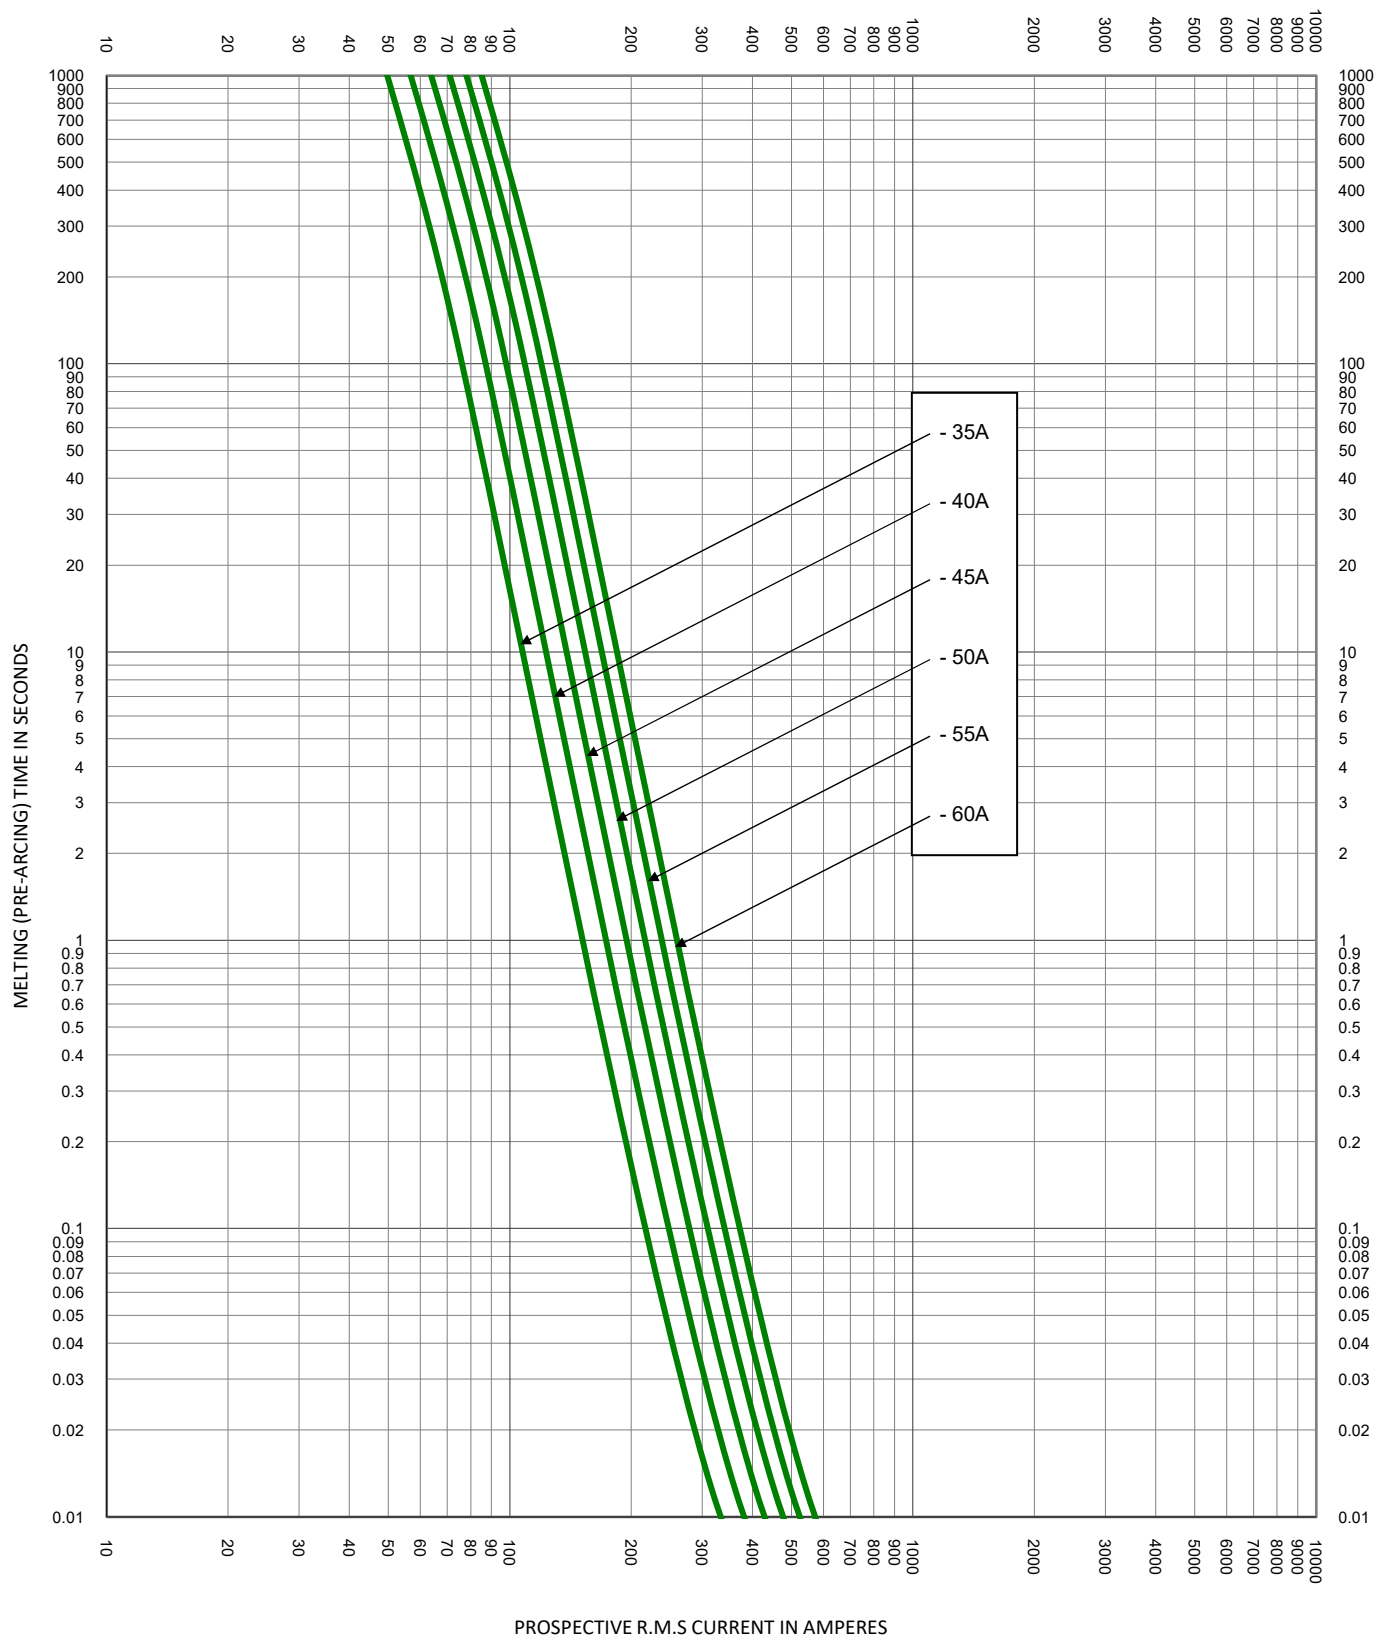

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A

 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA	DRAWN BY: LLL DATE: 03/15/2022 REVISION: J
	DRAWING NO.: SHEET 6 OF 6 <b>FCC01-SPXI</b>

**TIME CURRENT CHARACTERISTIC CURVES**