



CURRENT IN AMPERES

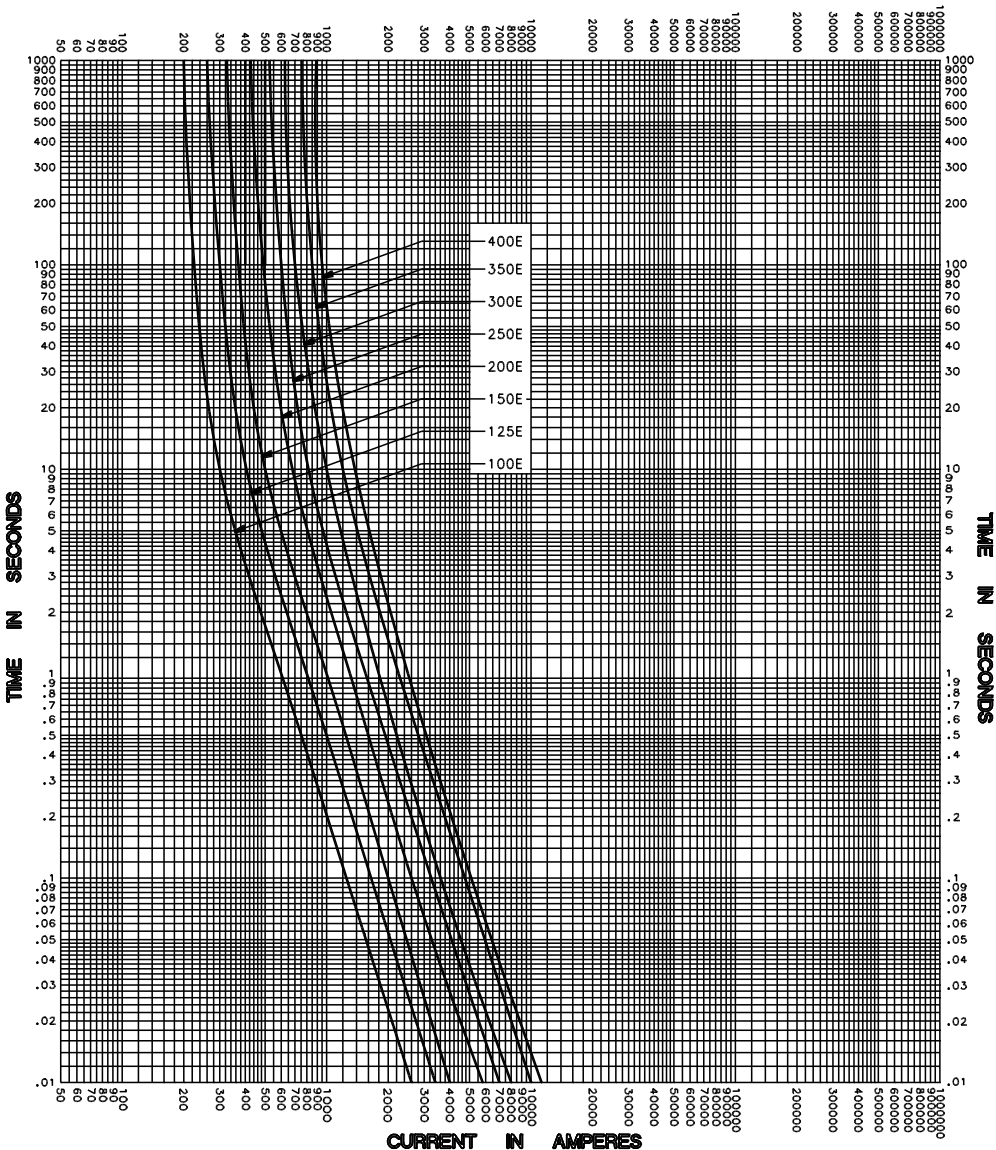

MELTING TIME CHARACTERISTIC

|  |                                    |   |
|--|------------------------------------|---|
| TEST VOLTAGE _____   | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER<br>8.25kV E-RATED 100E-400E |
| BASIS FOR DATA _____   |                                    |   |
| <br>DES PLAINES, ILLINOIS 60016 |                                    | DRAWN BY <u>LLL</u>                             |
|  |                                    | DATE <u>07/26/04</u>                            |
| <b>TIME CURRENT CHARACTERISTIC CURVES</b>  |                                    | CHECKED BY <u>MP</u>                            |
|  |                                    | DRAWING NO. <u>A-FCC002</u>                     |

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT