
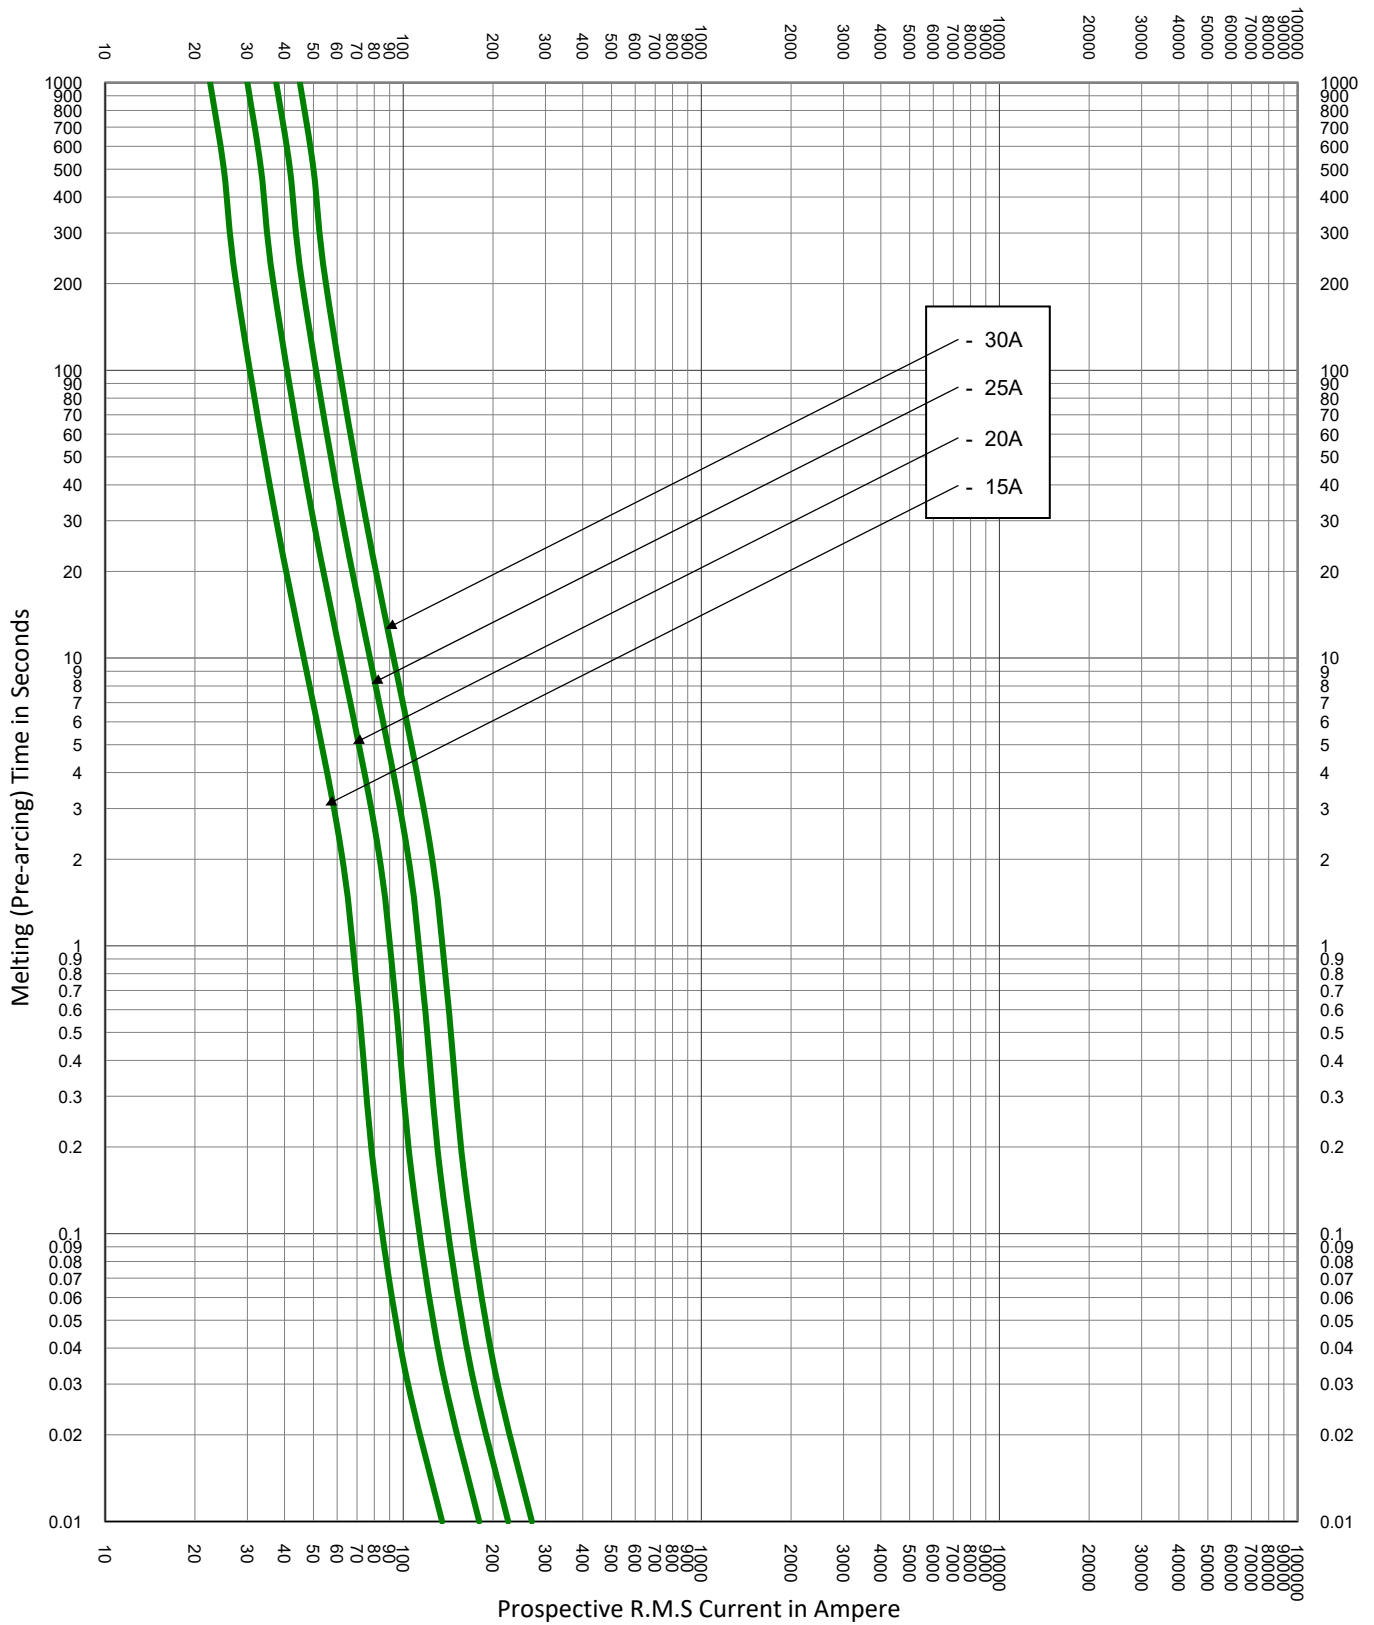

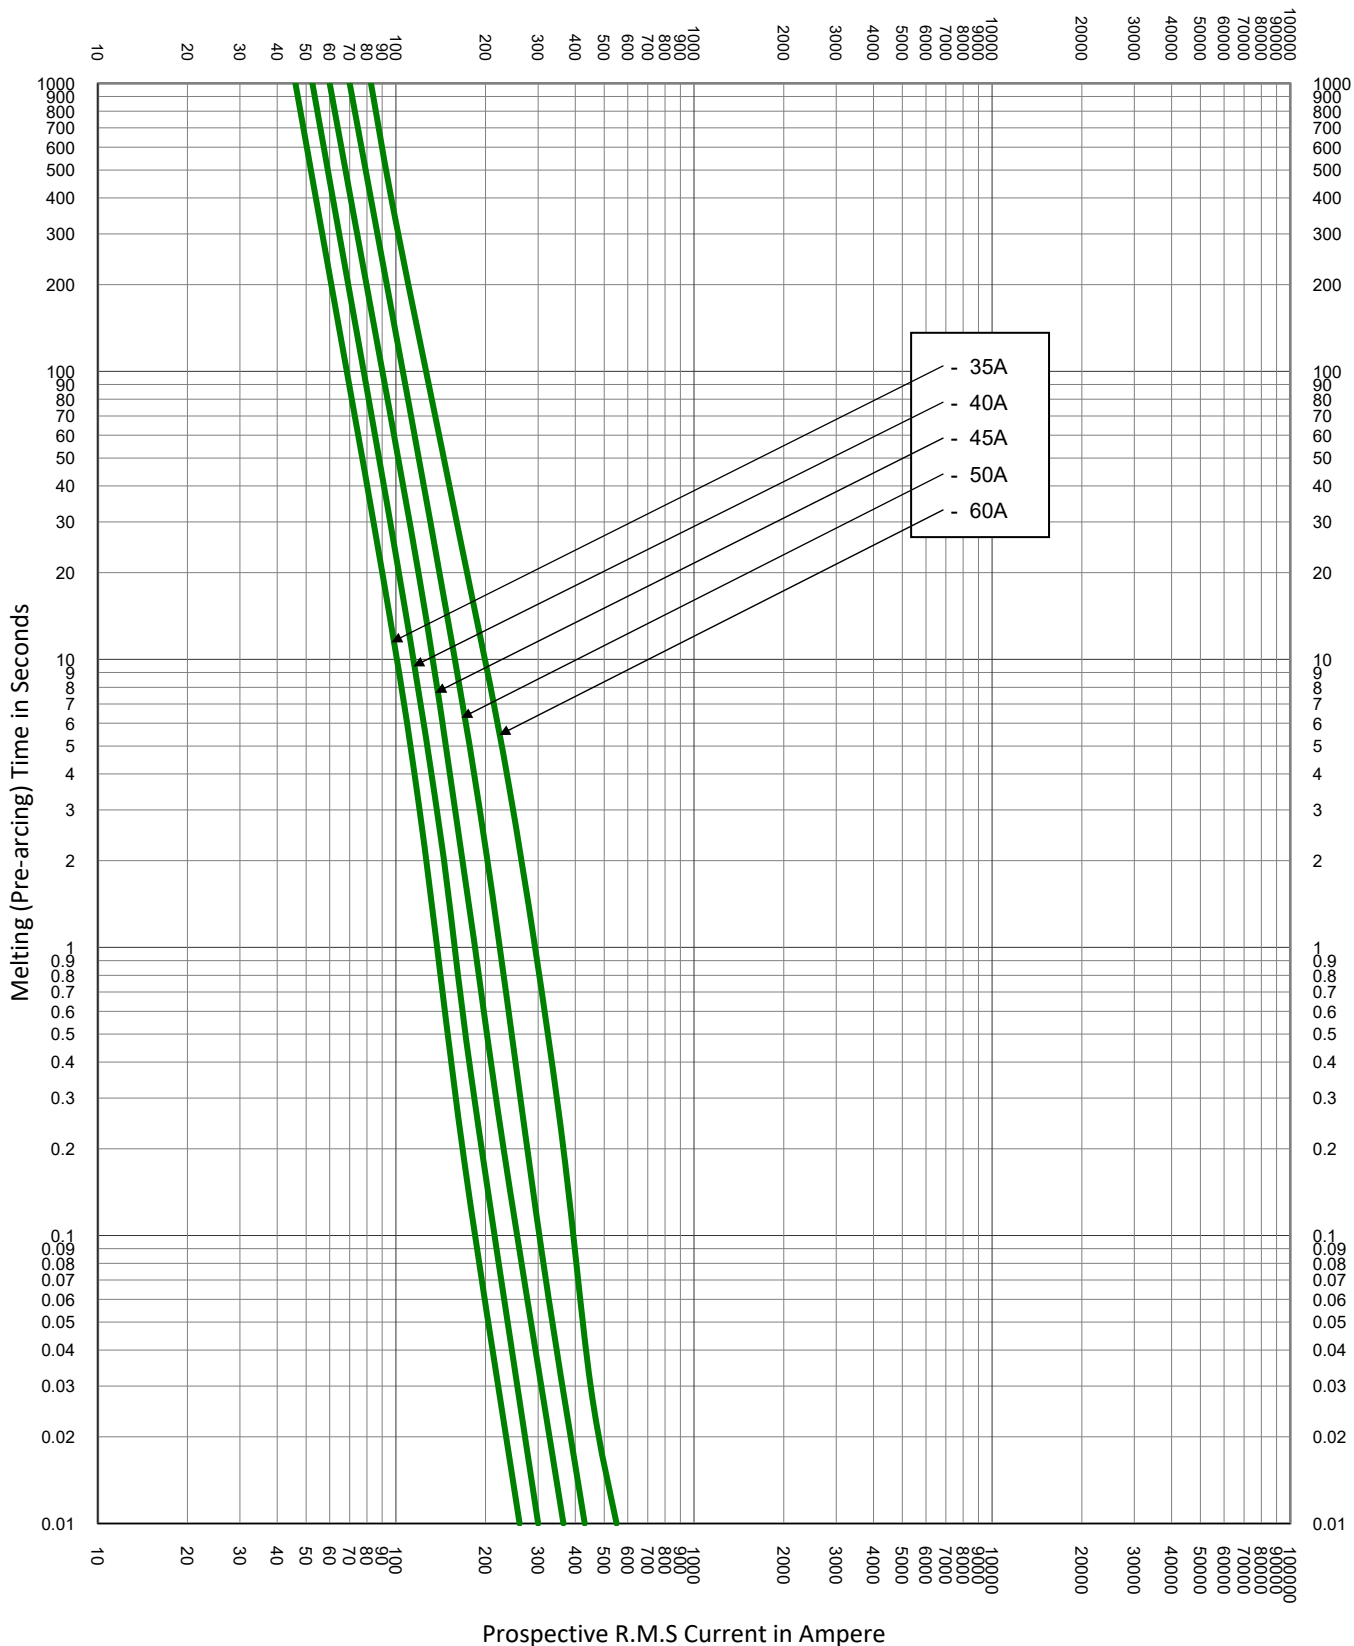



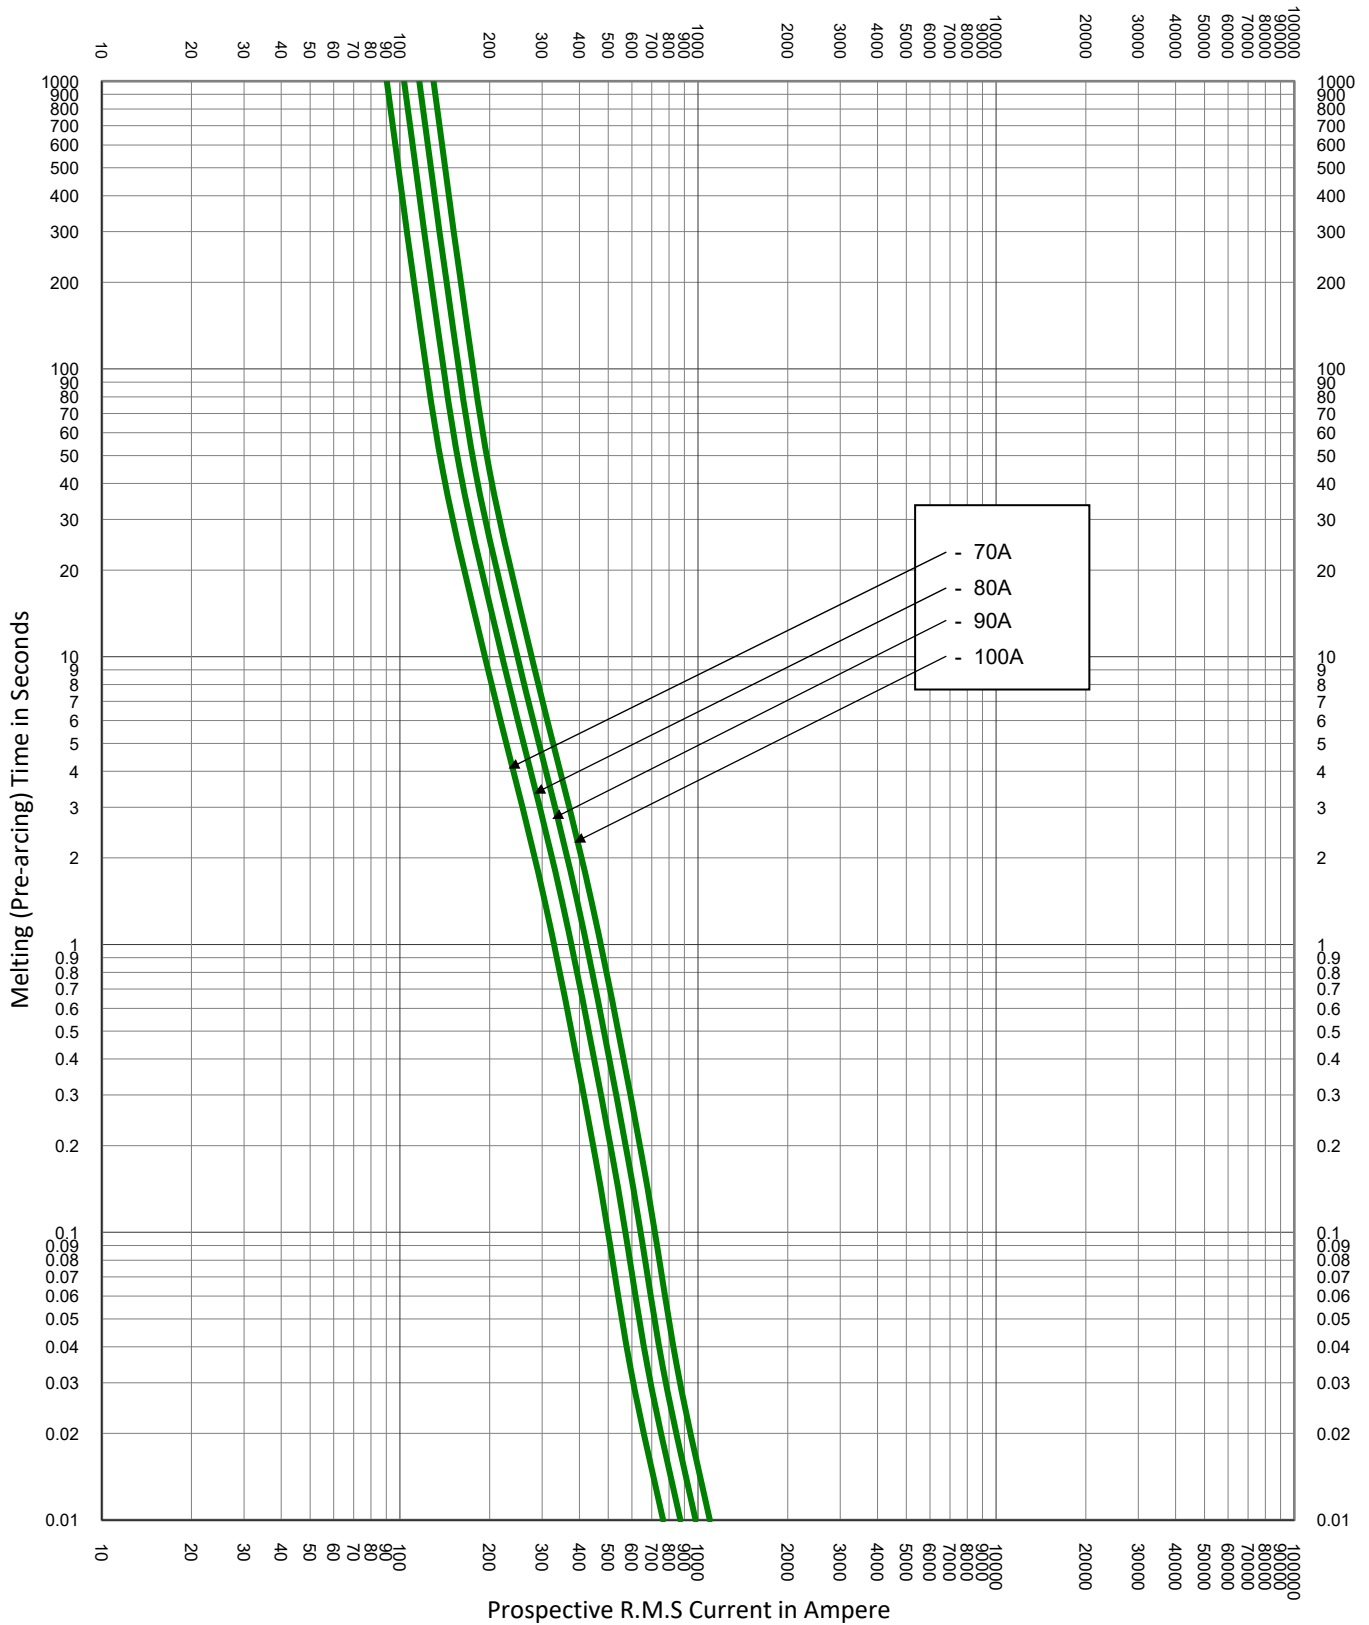
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLS 1A - 600A
		DRAWN BY: LLL DATE: 08/02/2022 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-JLS SHEET 2 OF 8




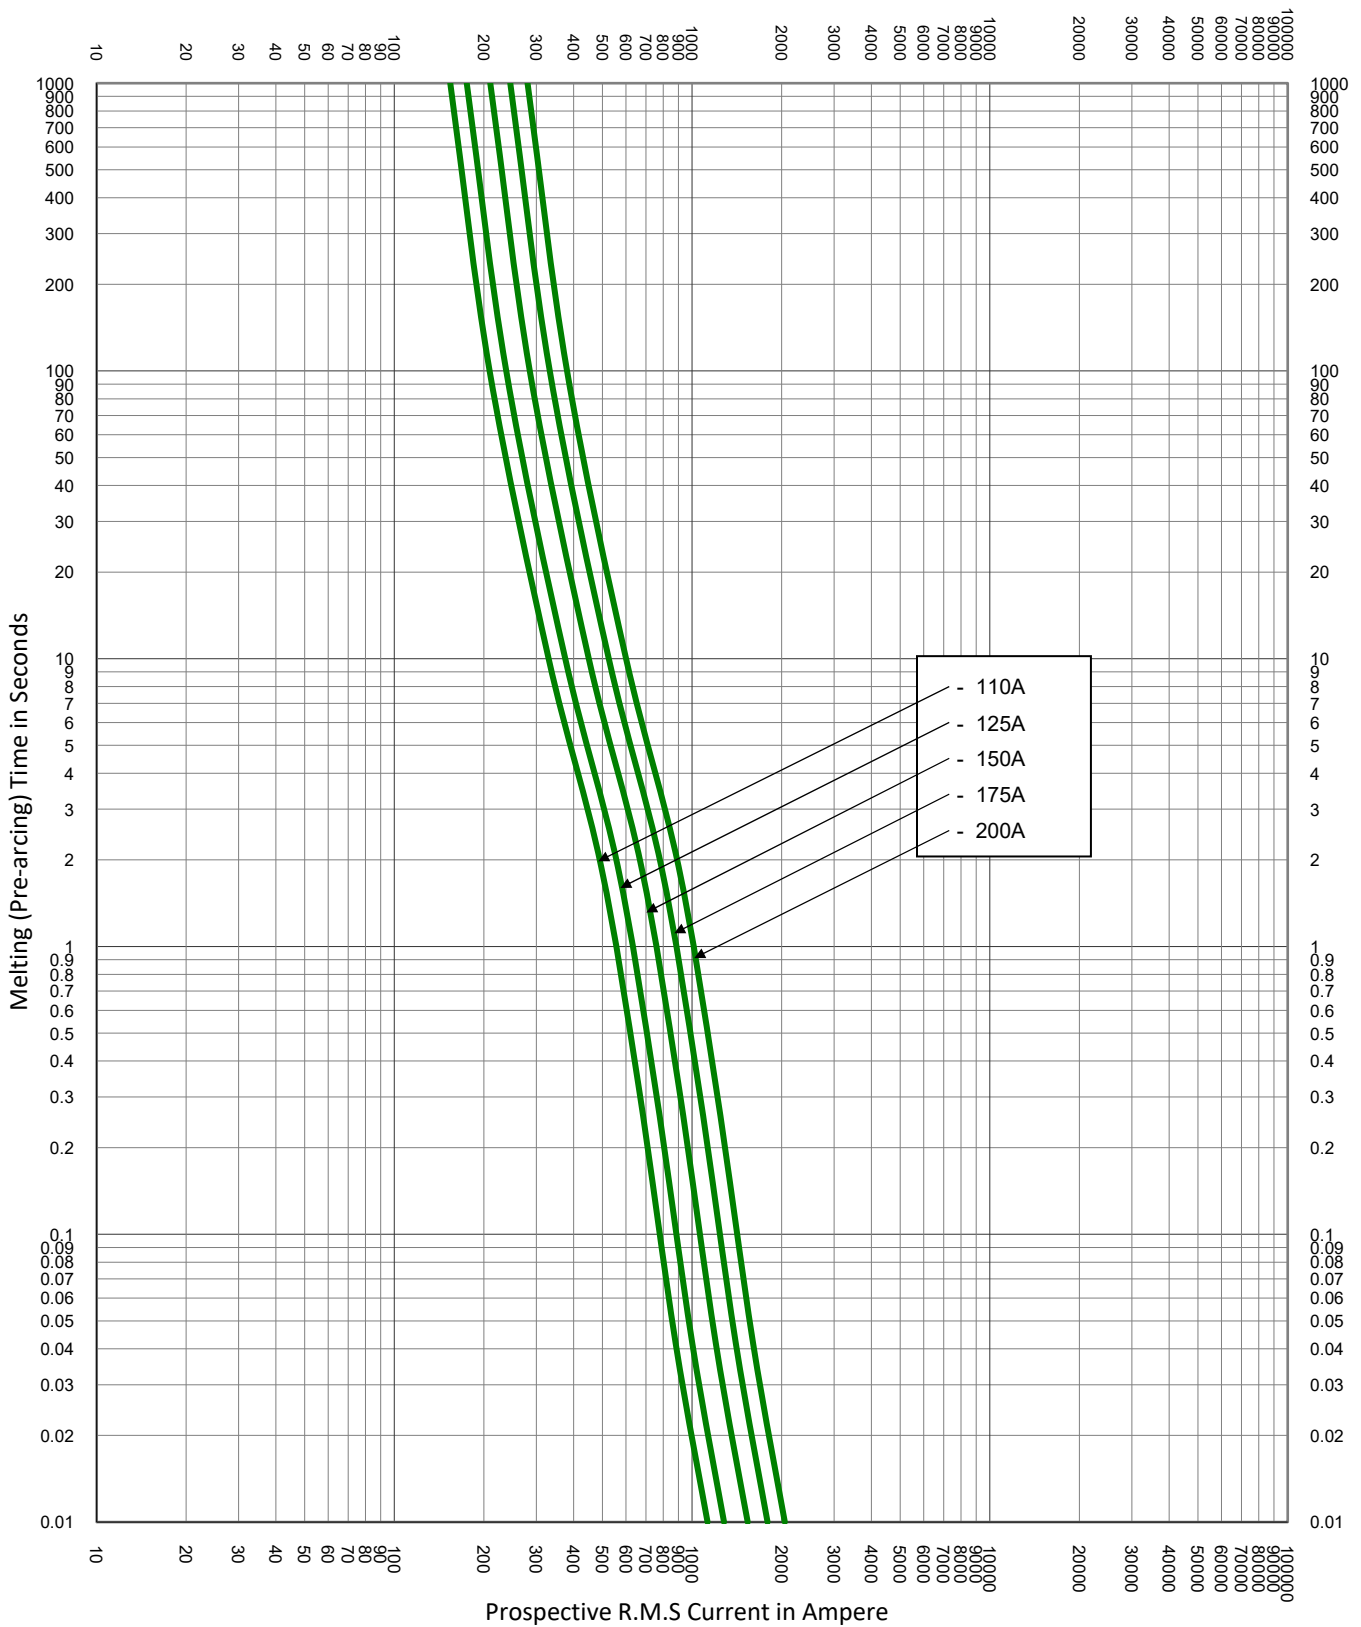
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLS 1A - 600A
		DRAWN BY: LLL
		DATE: 08/02/2022
		REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-JLS SHEET 3 OF 8




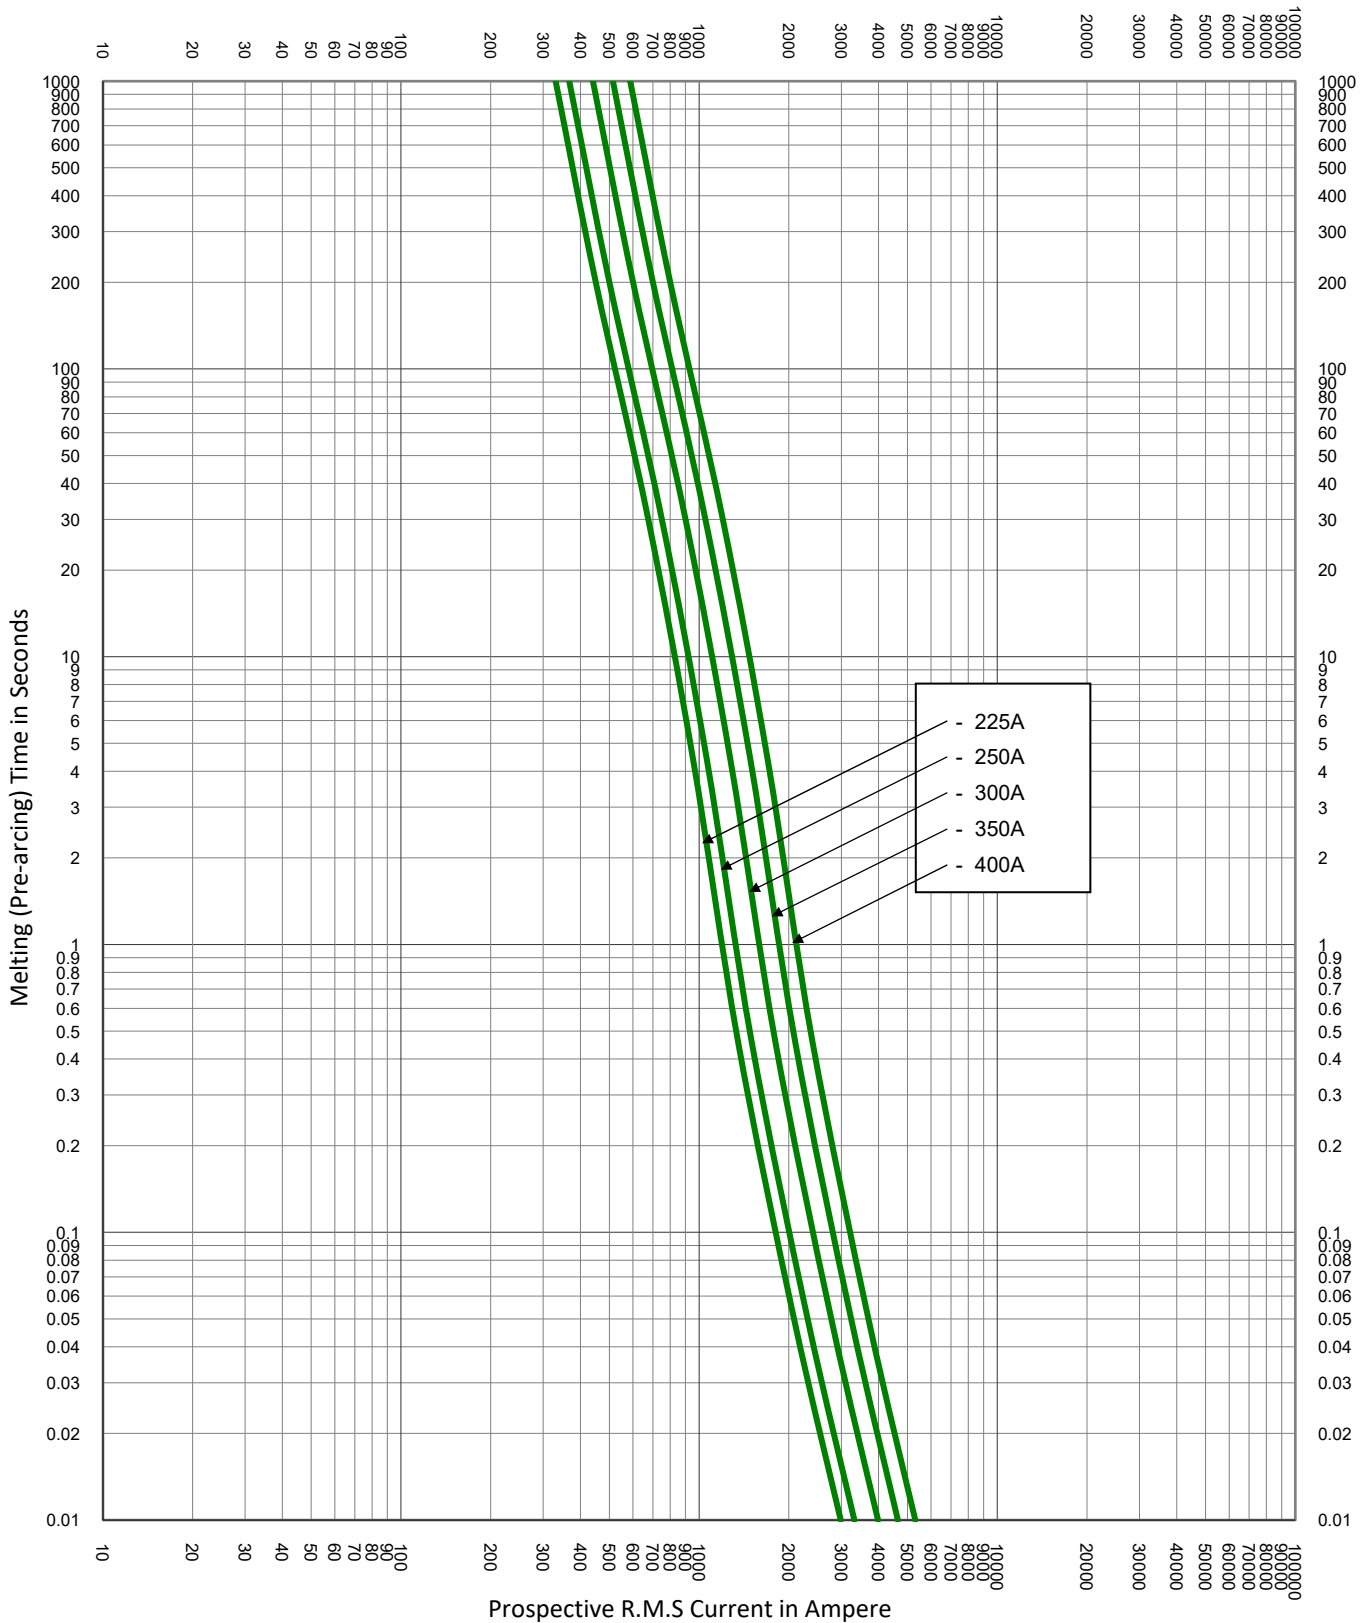
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLS 1A - 600A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 08/02/2022 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-JLS SHEET 4 OF 8




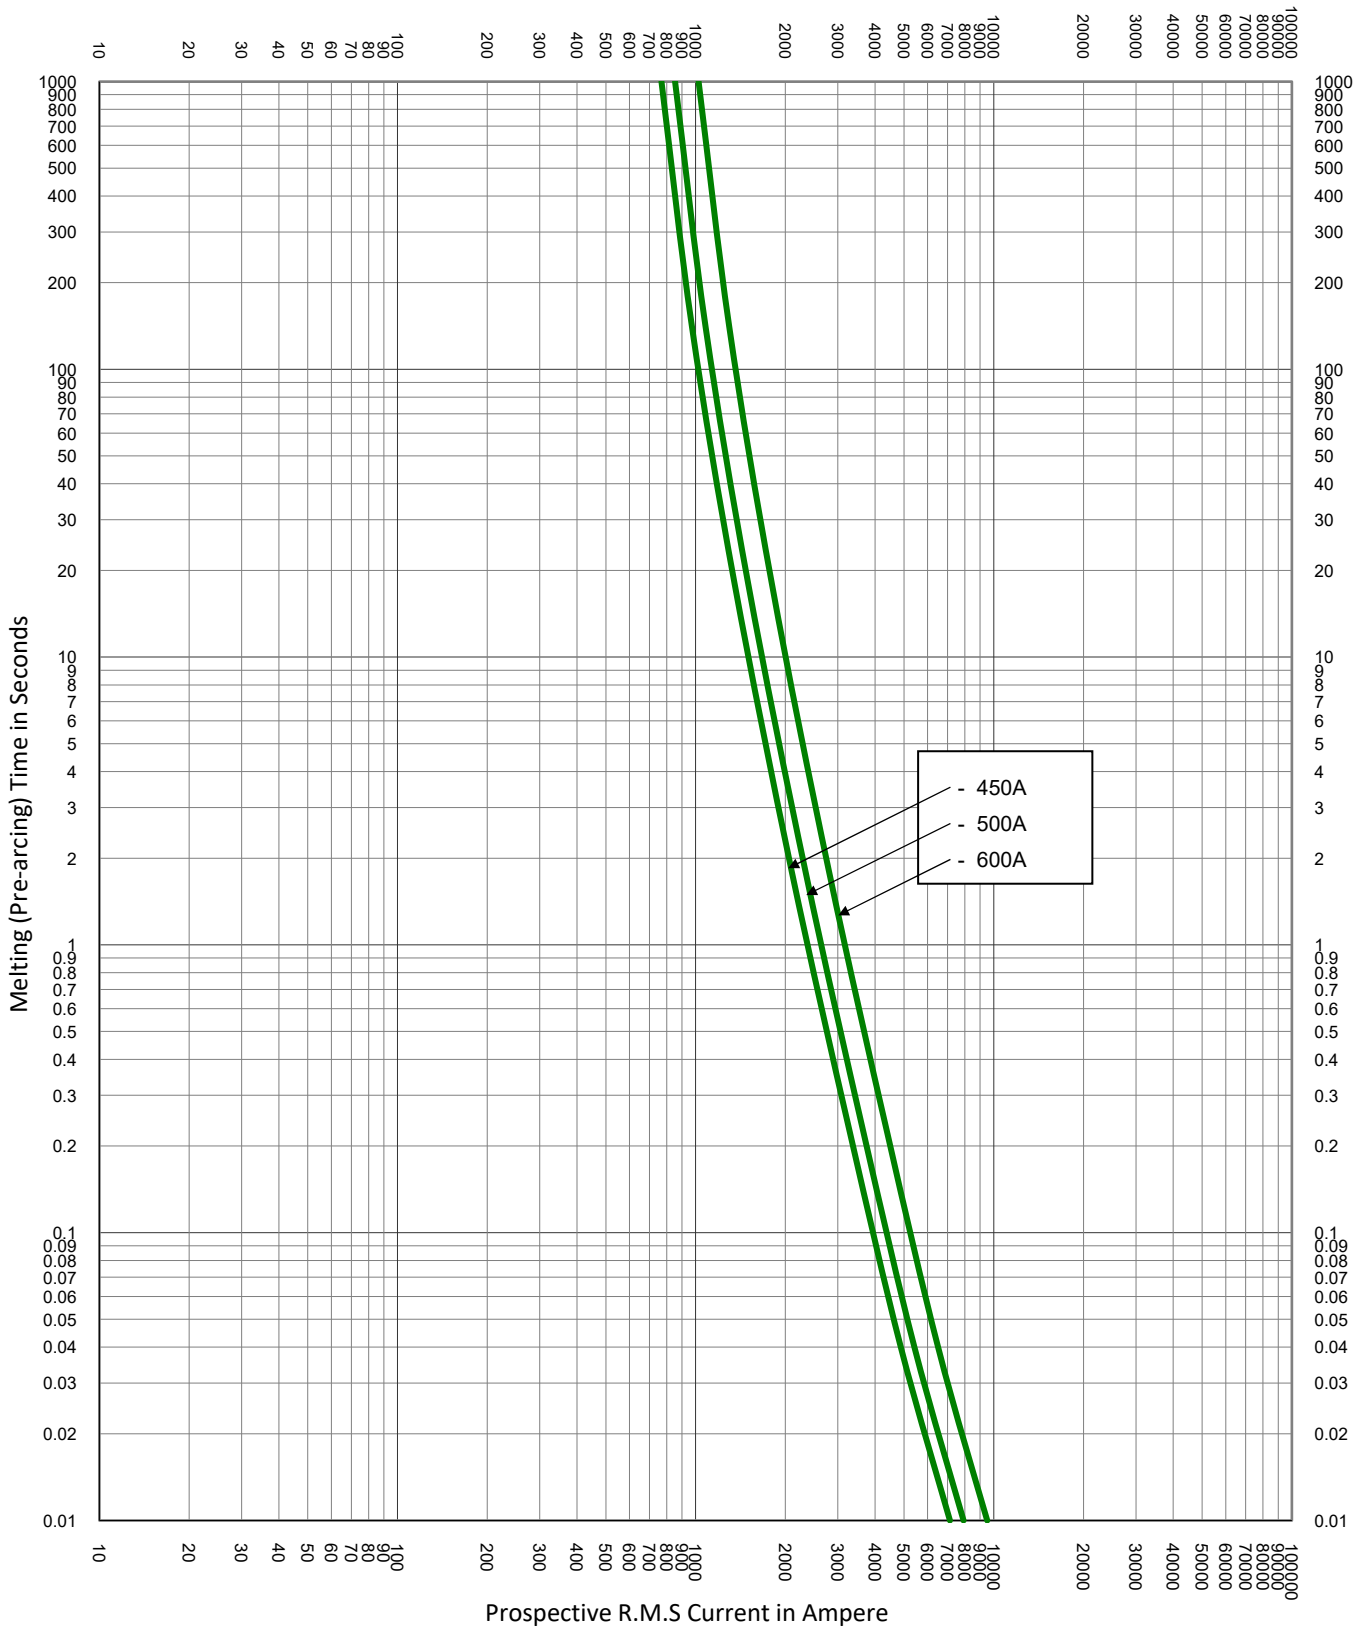
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLS 1A - 600A
		DRAWN BY: LLL
		DATE: 08/02/2022
		REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-JLS SHEET 5 OF 8




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLS 1A - 600A
		DRAWN BY: LLL
		DATE: 08/02/2022
TIME CURRENT CHARACTERISTIC CURVES		REVISION: A
		DRAWING NO.: FCC01-JLS SHEET 6 OF 8



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLS 1A - 600A
		DRAWN BY: LLL
		DATE: 08/02/2022
TIME CURRENT CHARACTERISTIC CURVES		REVISION: A
		DRAWING NO.: FCC01-JLS SHEET 7 OF 8



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLS 1A - 600A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL
		DATE: 08/02/2022
TIME CURRENT CHARACTERISTIC CURVES		REVISION: A
		DRAWING NO.: FCC01-JLS SHEET 8 OF 8