


CURRENT IN AMPERES



CLEARING TIME CHARACTERISTIC

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 2.75kV E-RATED 100E-400E
BASIS FOR DATA _____		

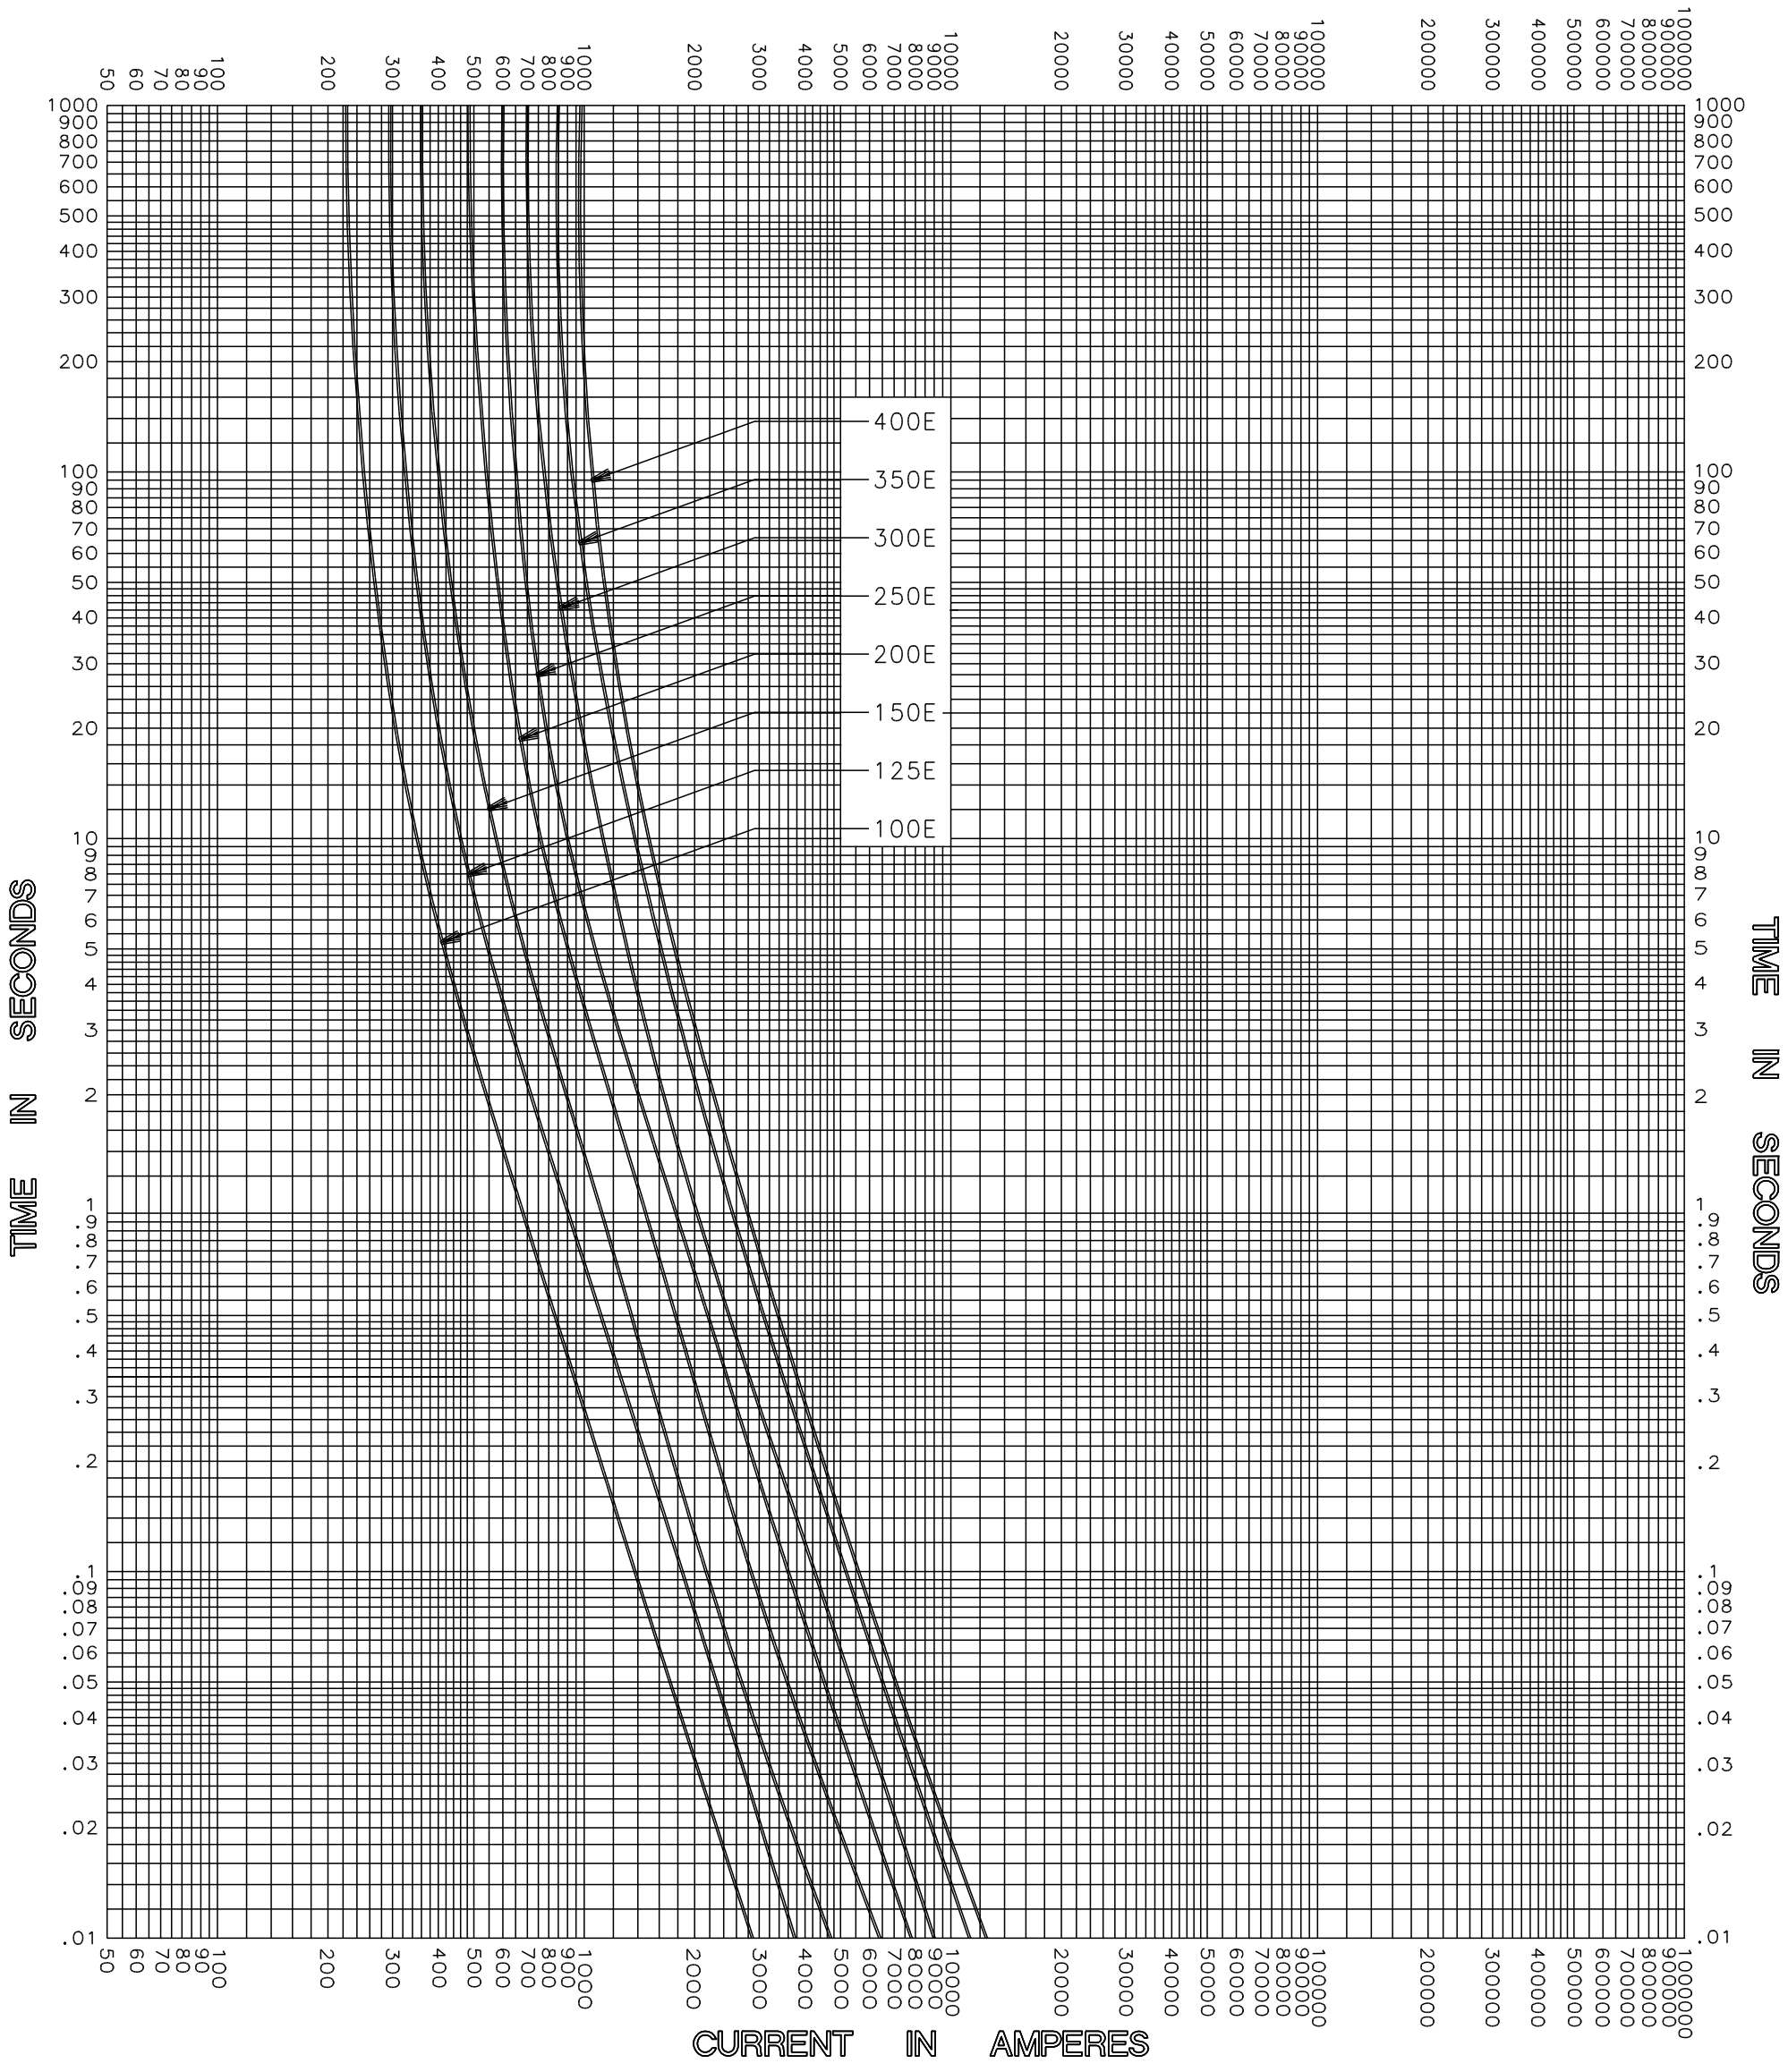

DRAWN BY LLL
DATE 04/26/04
CHECKED BY MP
DRAWING NO. A-FCC04-2.75E-002

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT