


CURRENT IN AMPERES

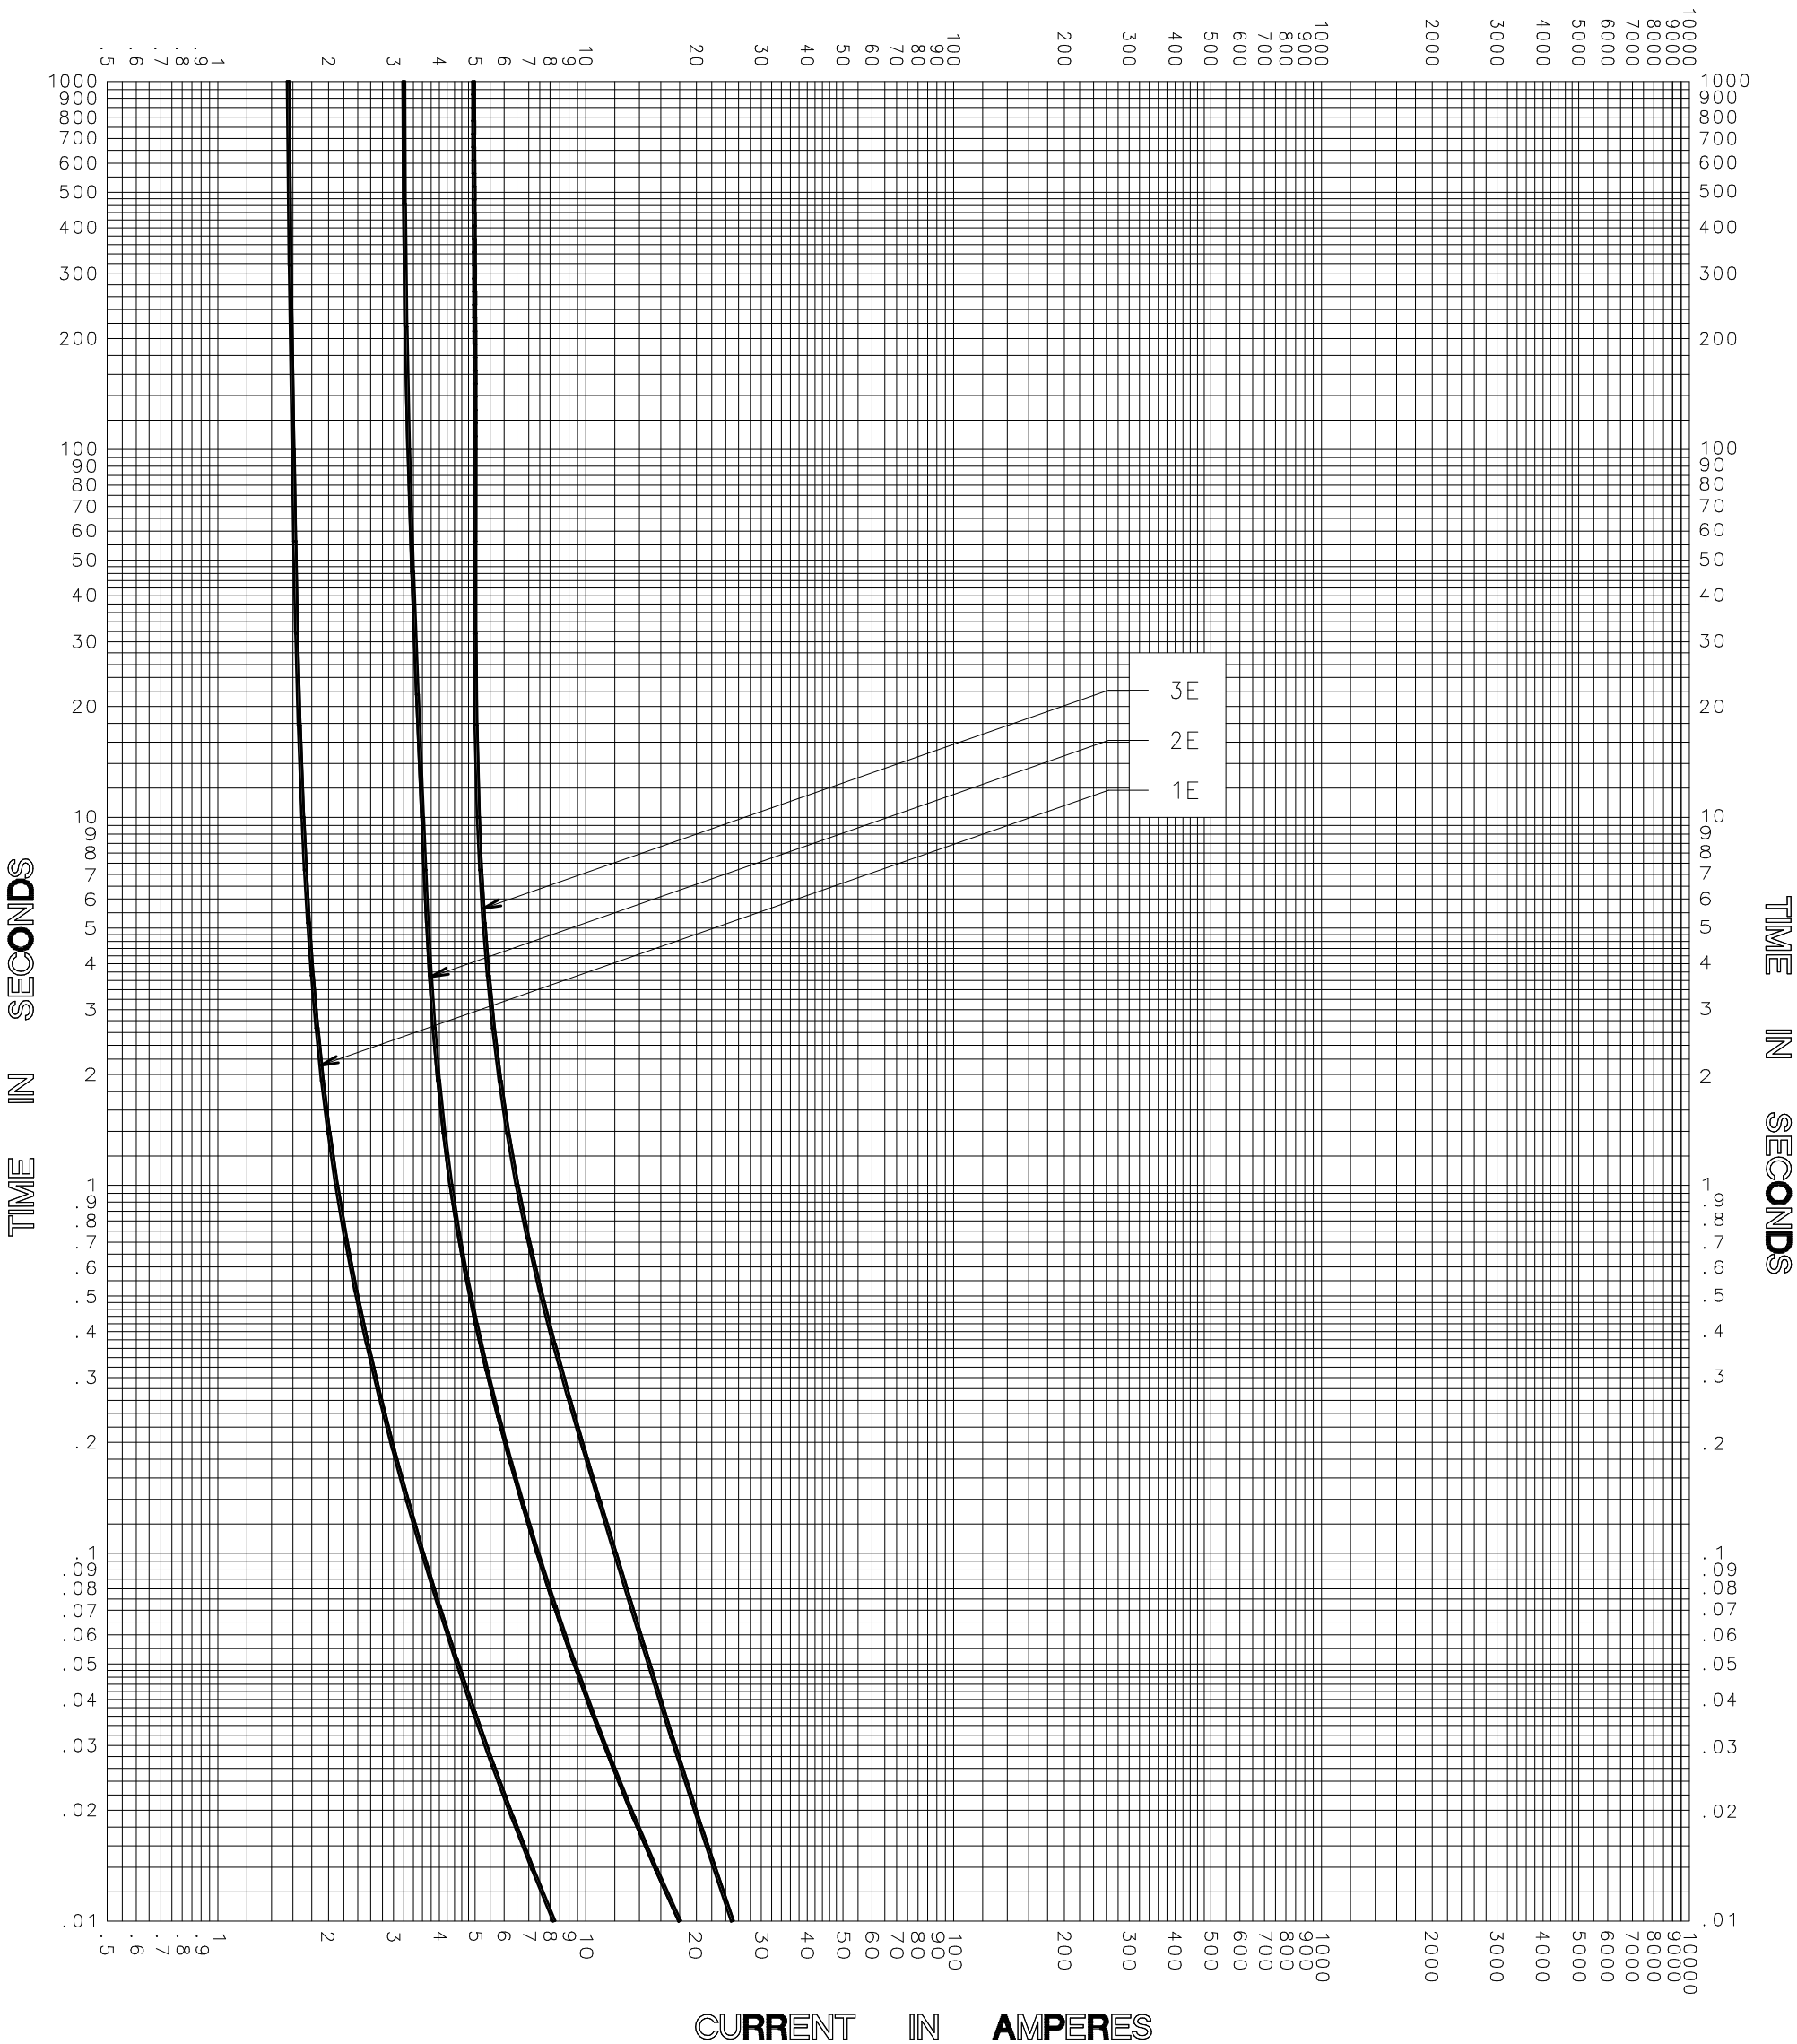

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	1E-6PT-2.75 thru 3E-6PT-2.75 1E-8PT-2.75 thru 3E-8PT-2.75

 DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u>
	DATE <u>10/17/05</u>
	CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>A FCC01-55-001</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT