
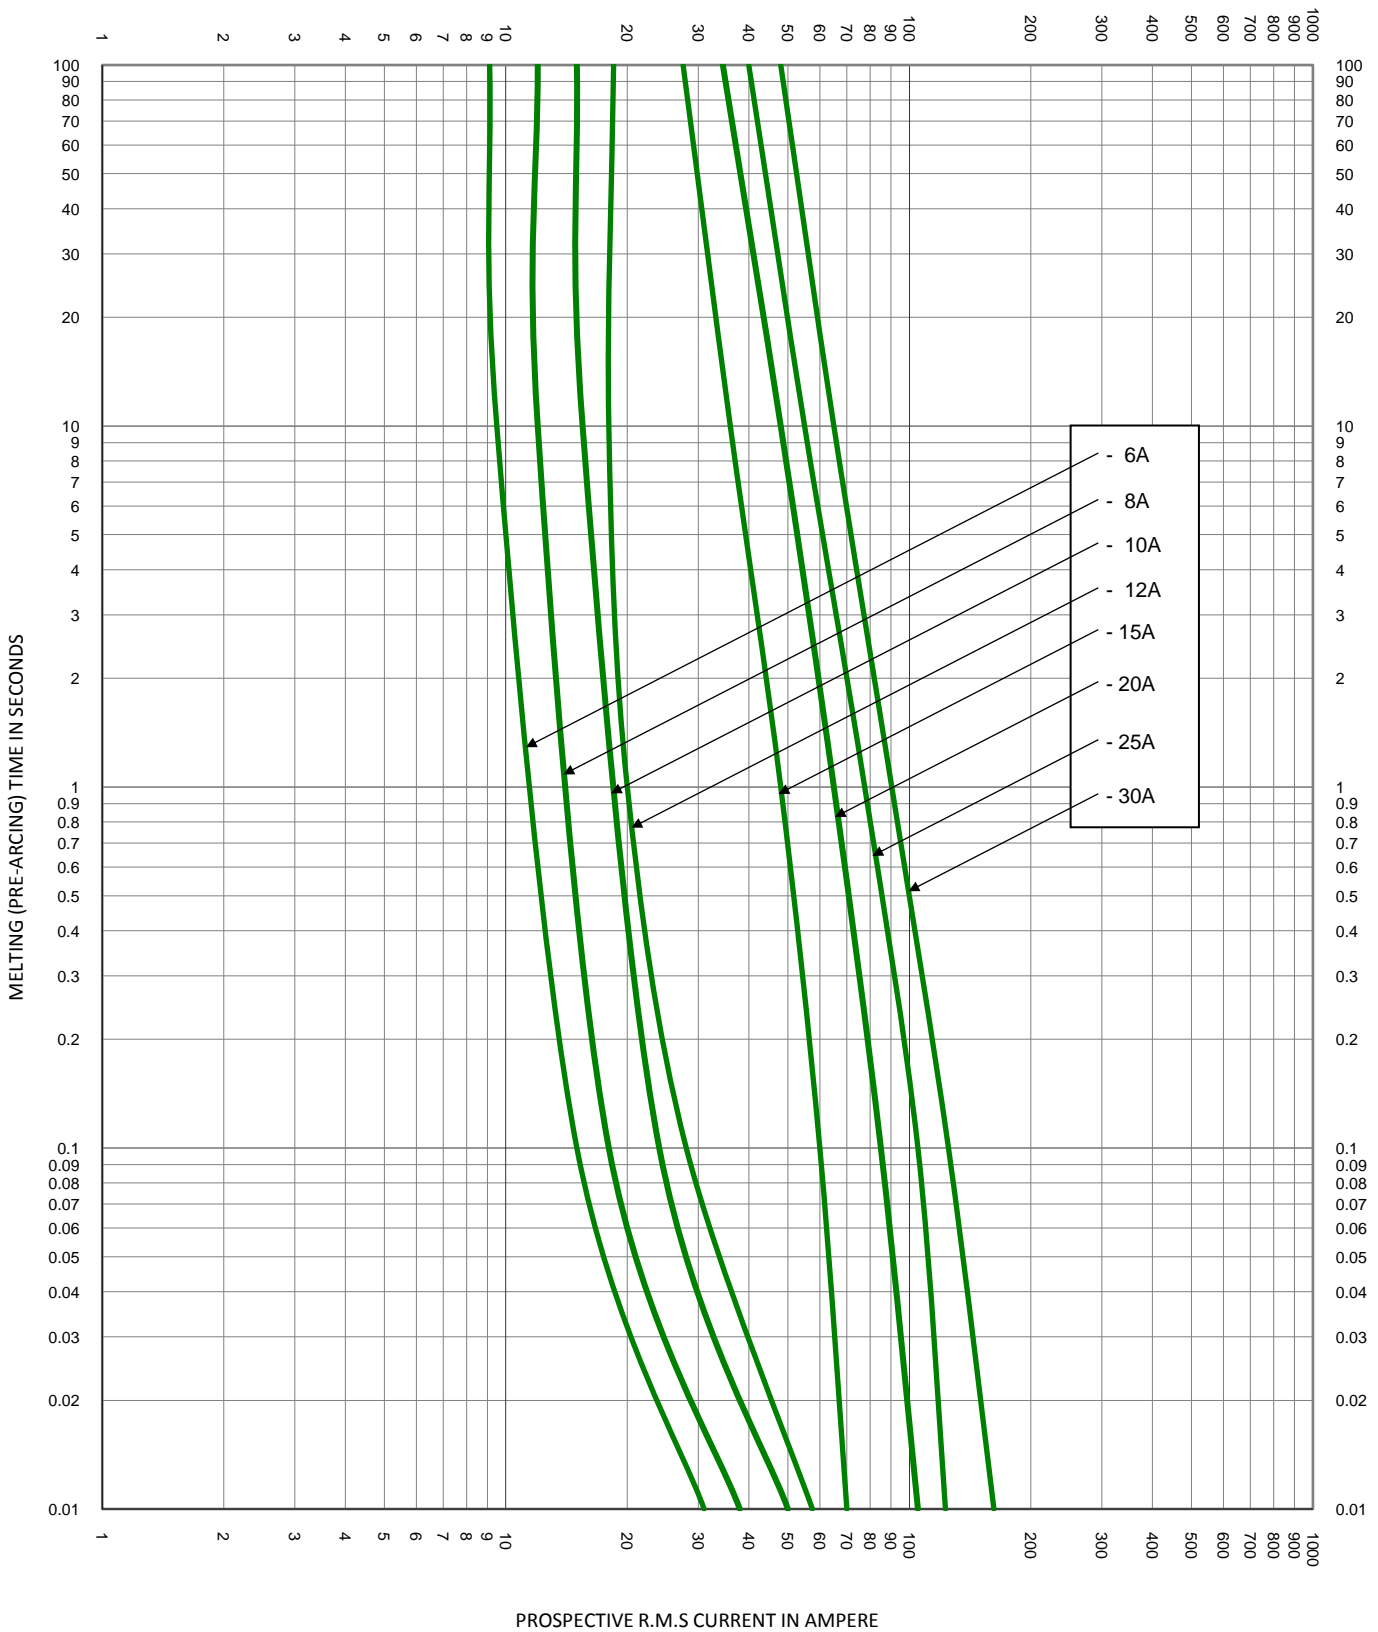

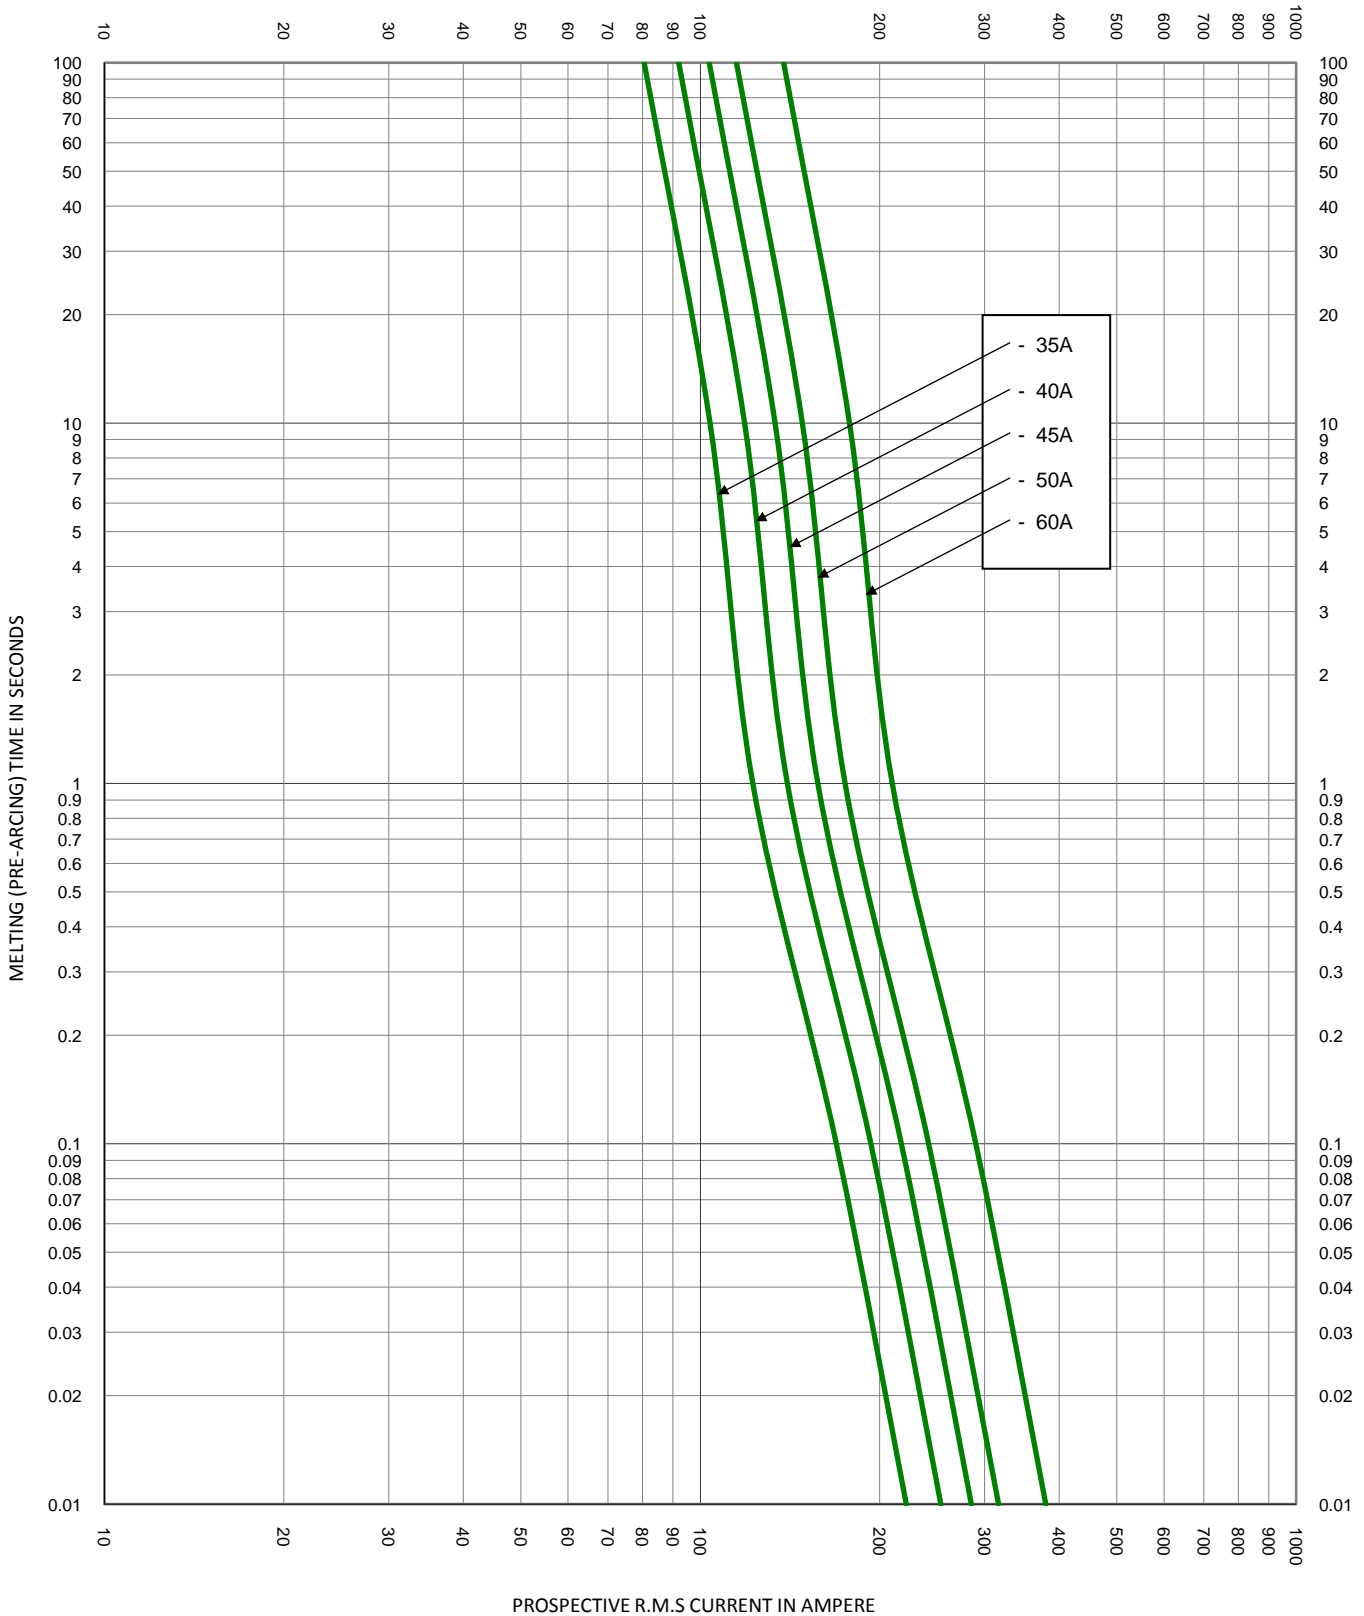



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L25S 1A - 800A
		DRAWN BY: LLL DATE: 11/08/2017 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-L25S SHEET 2 OF 7





TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L25S 1A - 800A
		DRAWN BY: LLL DATE: 11/08/2017 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-L25S      SHEET 3 OF 7





TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L25S 1A - 800A
		DRAWN BY: LLL DATE: 11*08/2017 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-L25S SHEET 4 OF 7


- THIS DATA IS GENERATED IN EXCEL -

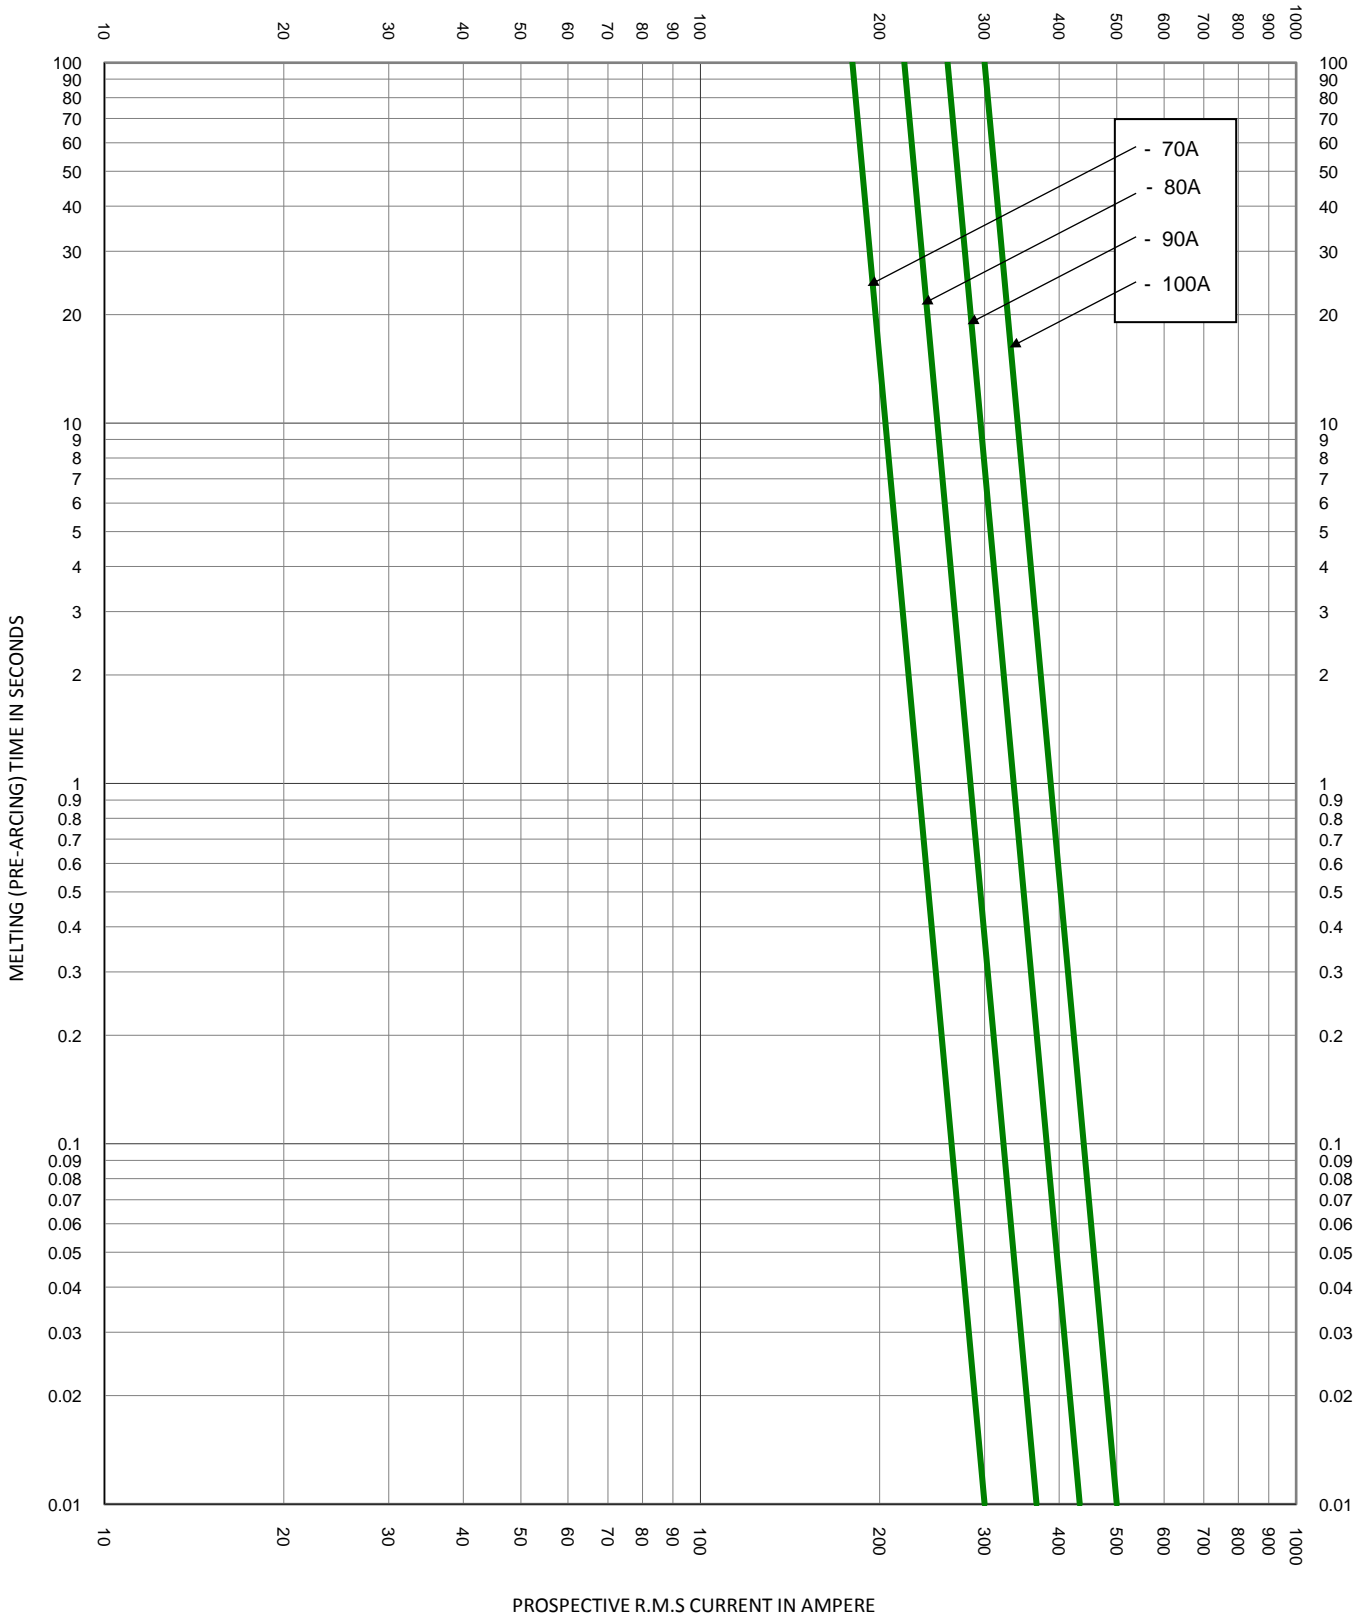


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L25S 1A - 800A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 11/08/2017 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-L25S SHEET 5 OF 7

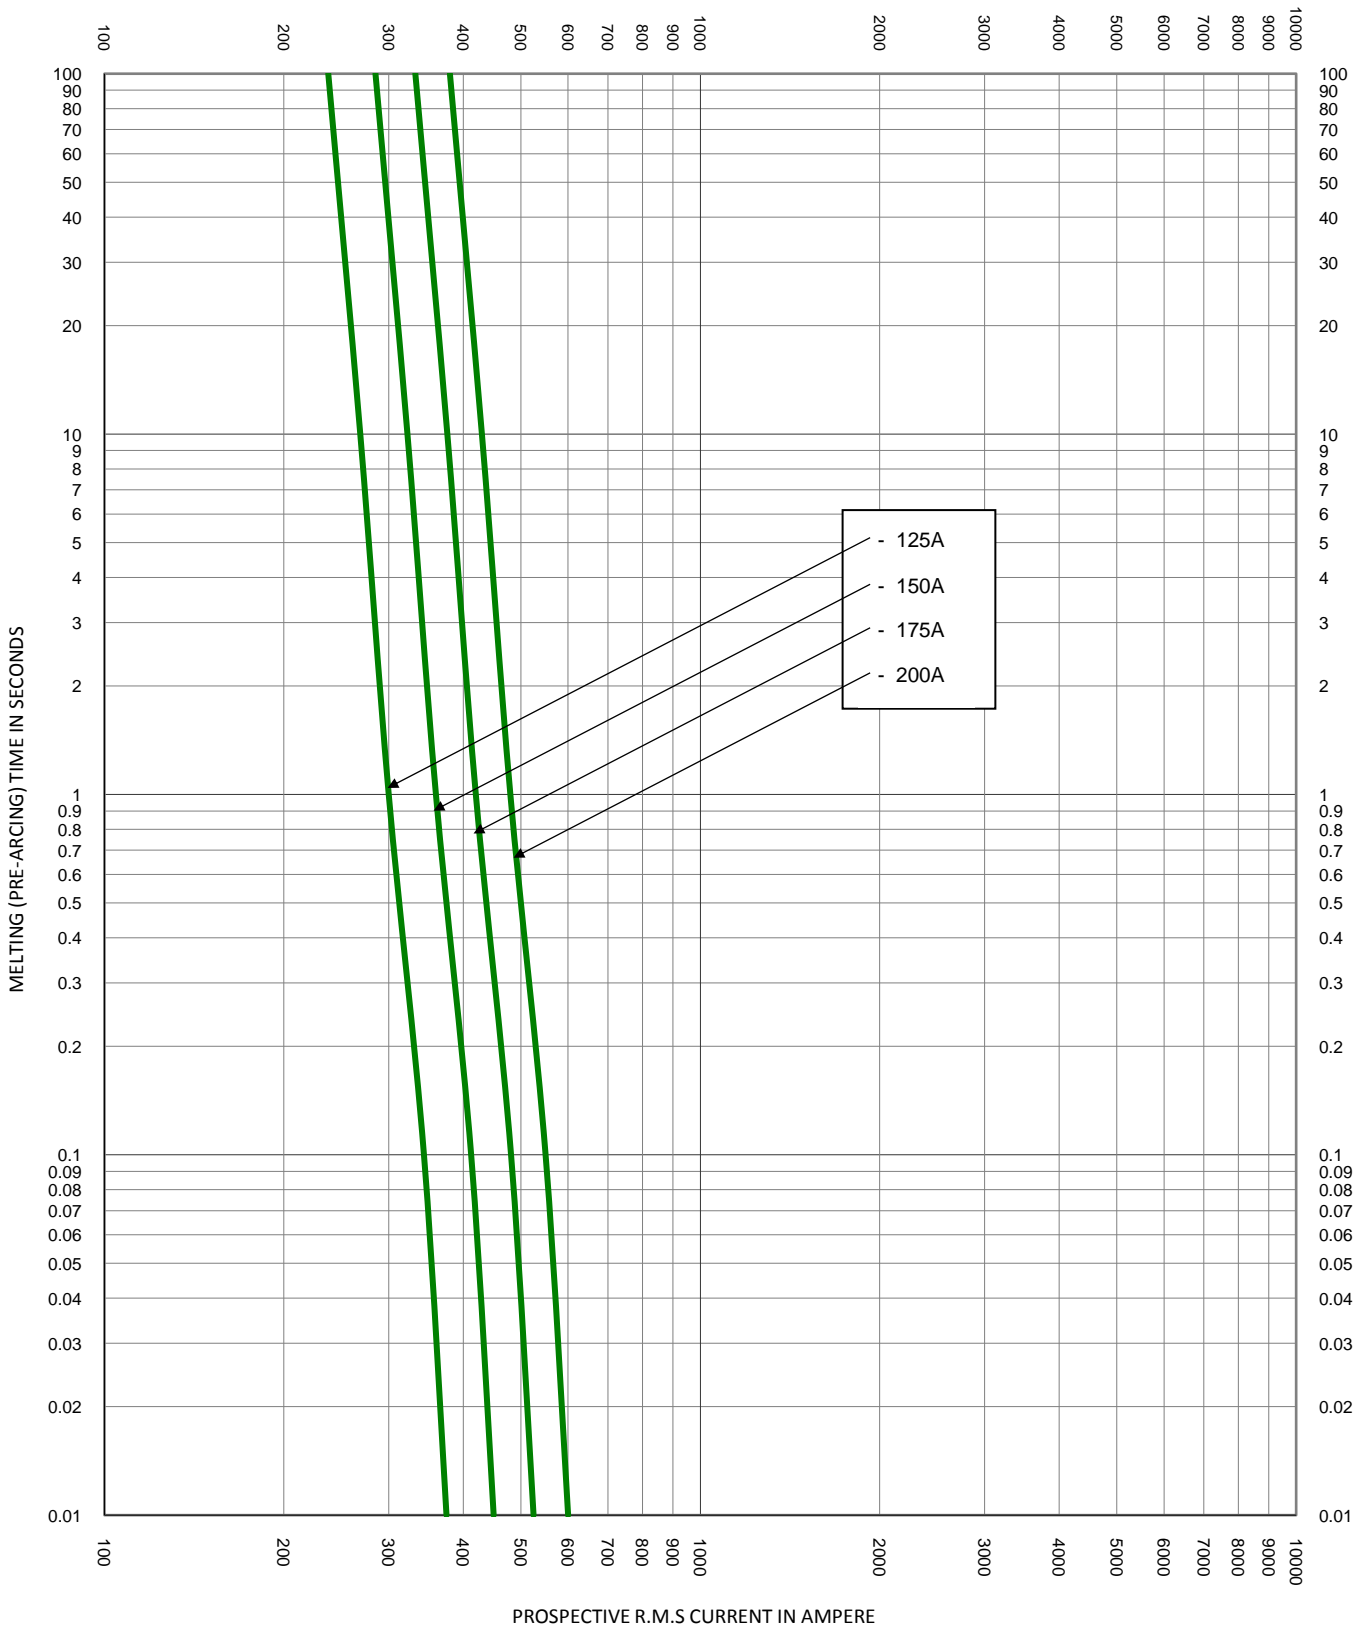

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L25S 1A - 800A
		DRAWN BY: LLL DATE: 11/08/2017 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-L25S SHEET 6 OF 7

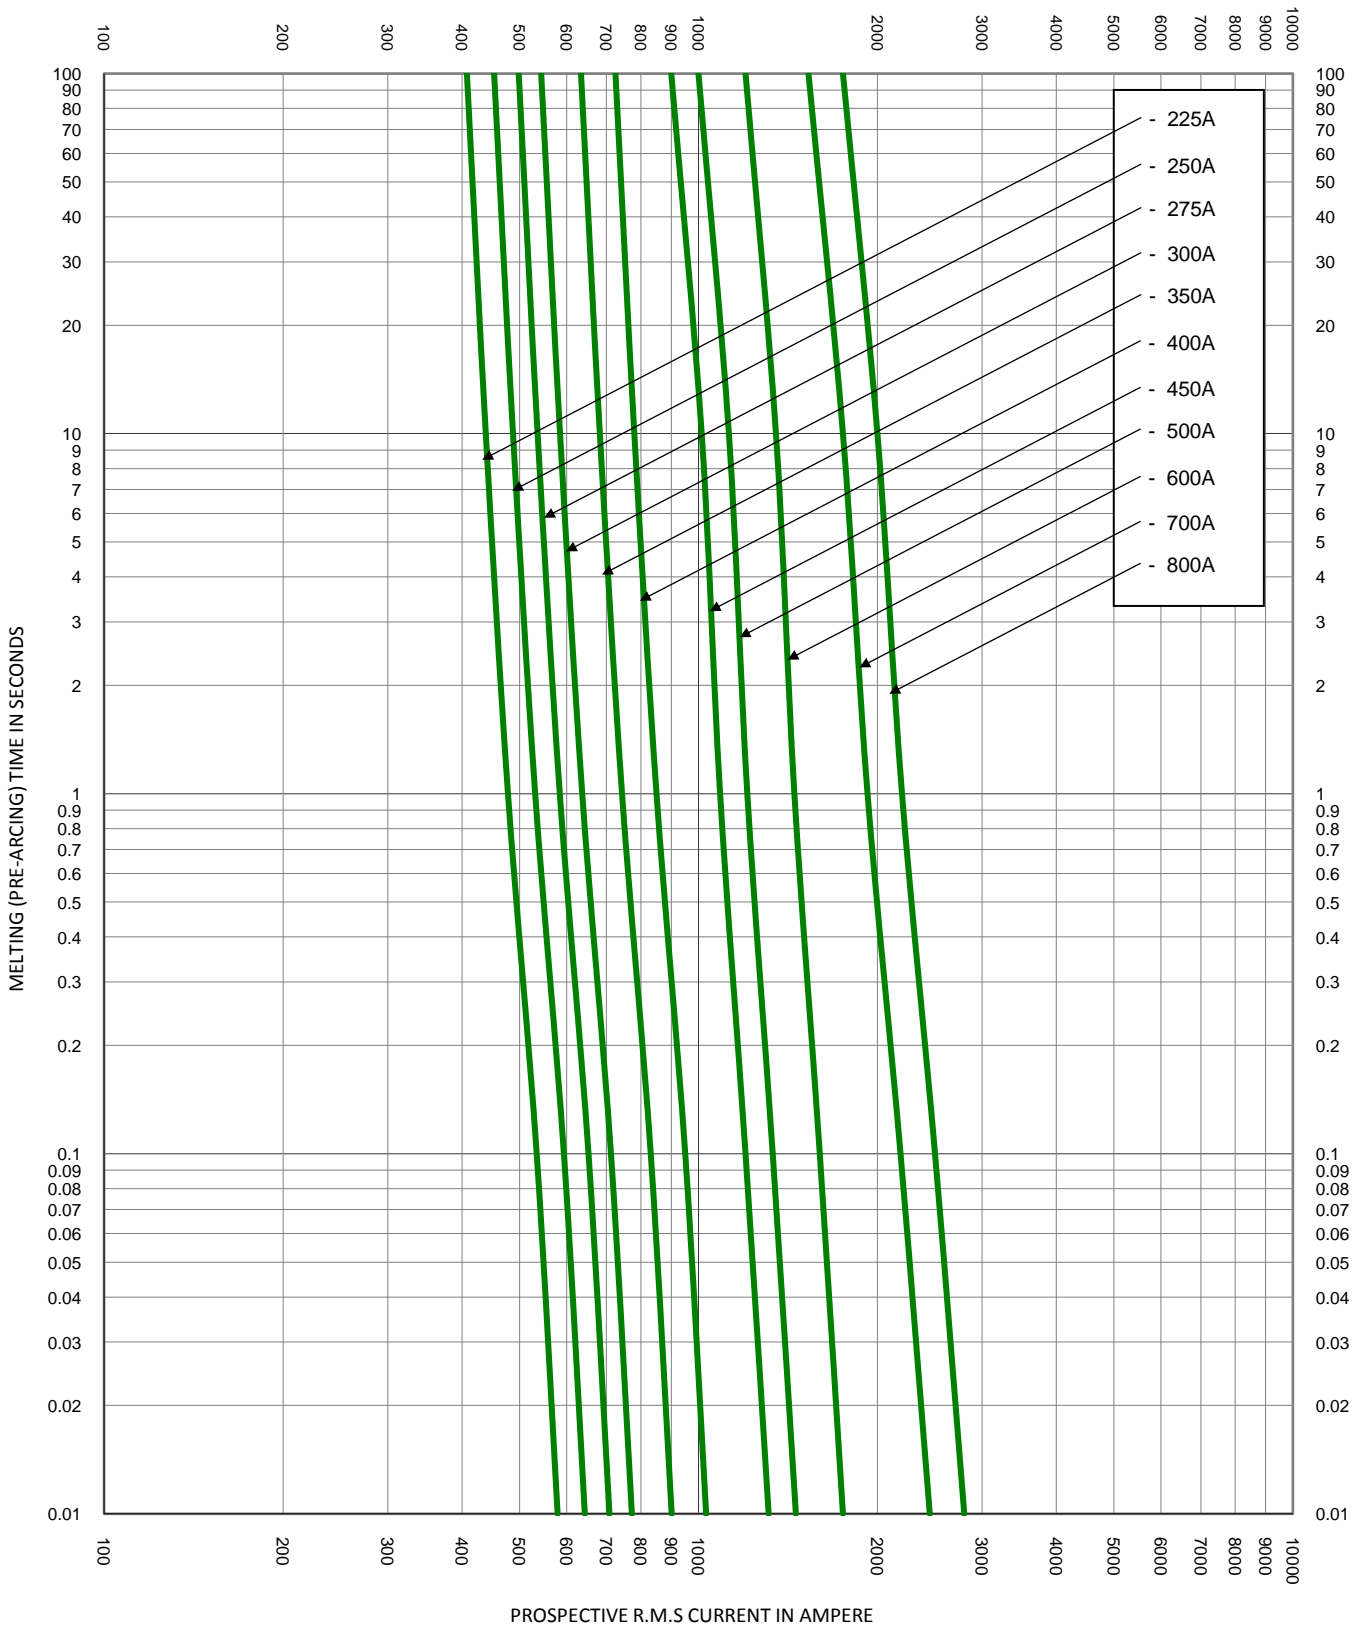

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L25S 1A - 800A
		DRAWN BY: LLL DATE: 11/08/2017 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-L25S SHEET 7 OF 7