


CURRENT IN AMPERES

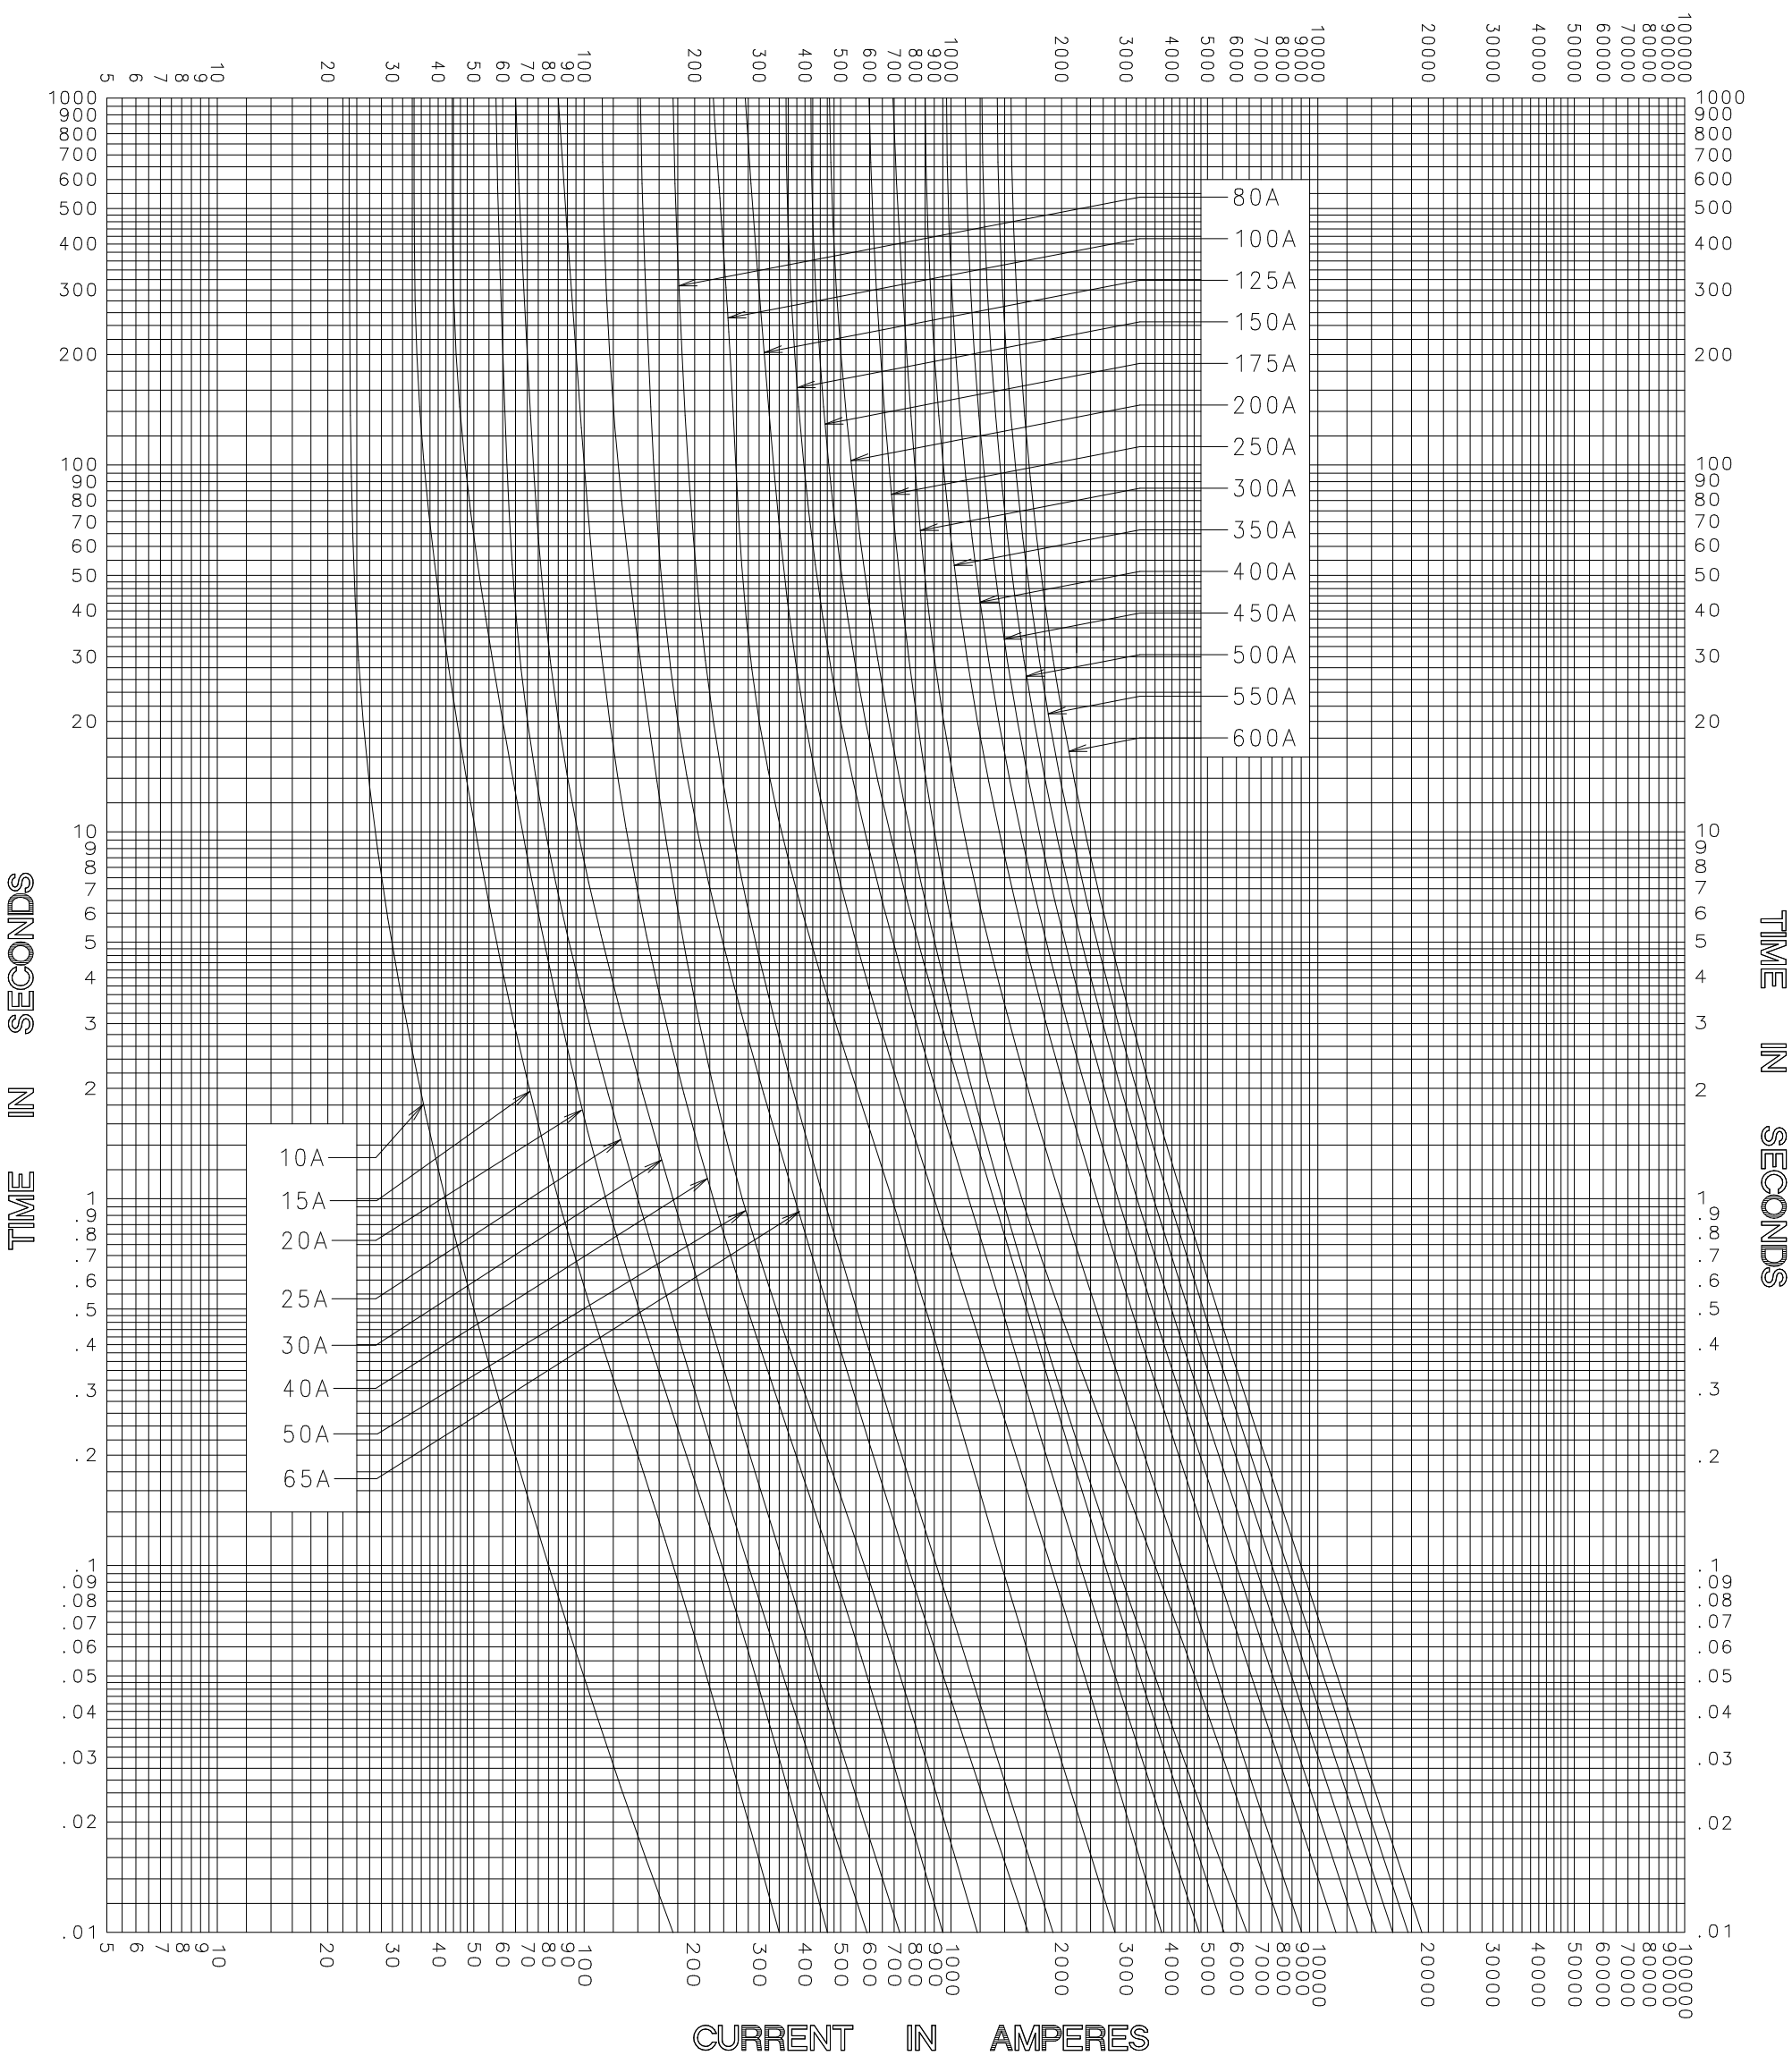

CLEARING TIME CURRENT CHARACTERISTIC CURVES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	5.5kV E-RATED 10E-600E

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>07/23/04</u> CHECKED BY <u>MP</u>
	DRAWING NO. <u>B-FCC055-1001</u>

TIME CURRENT CHARACTERISTIC CURVES

- THIS DATA GENERATED ON CAD -

UNCONTROLLED DOCUMENT