


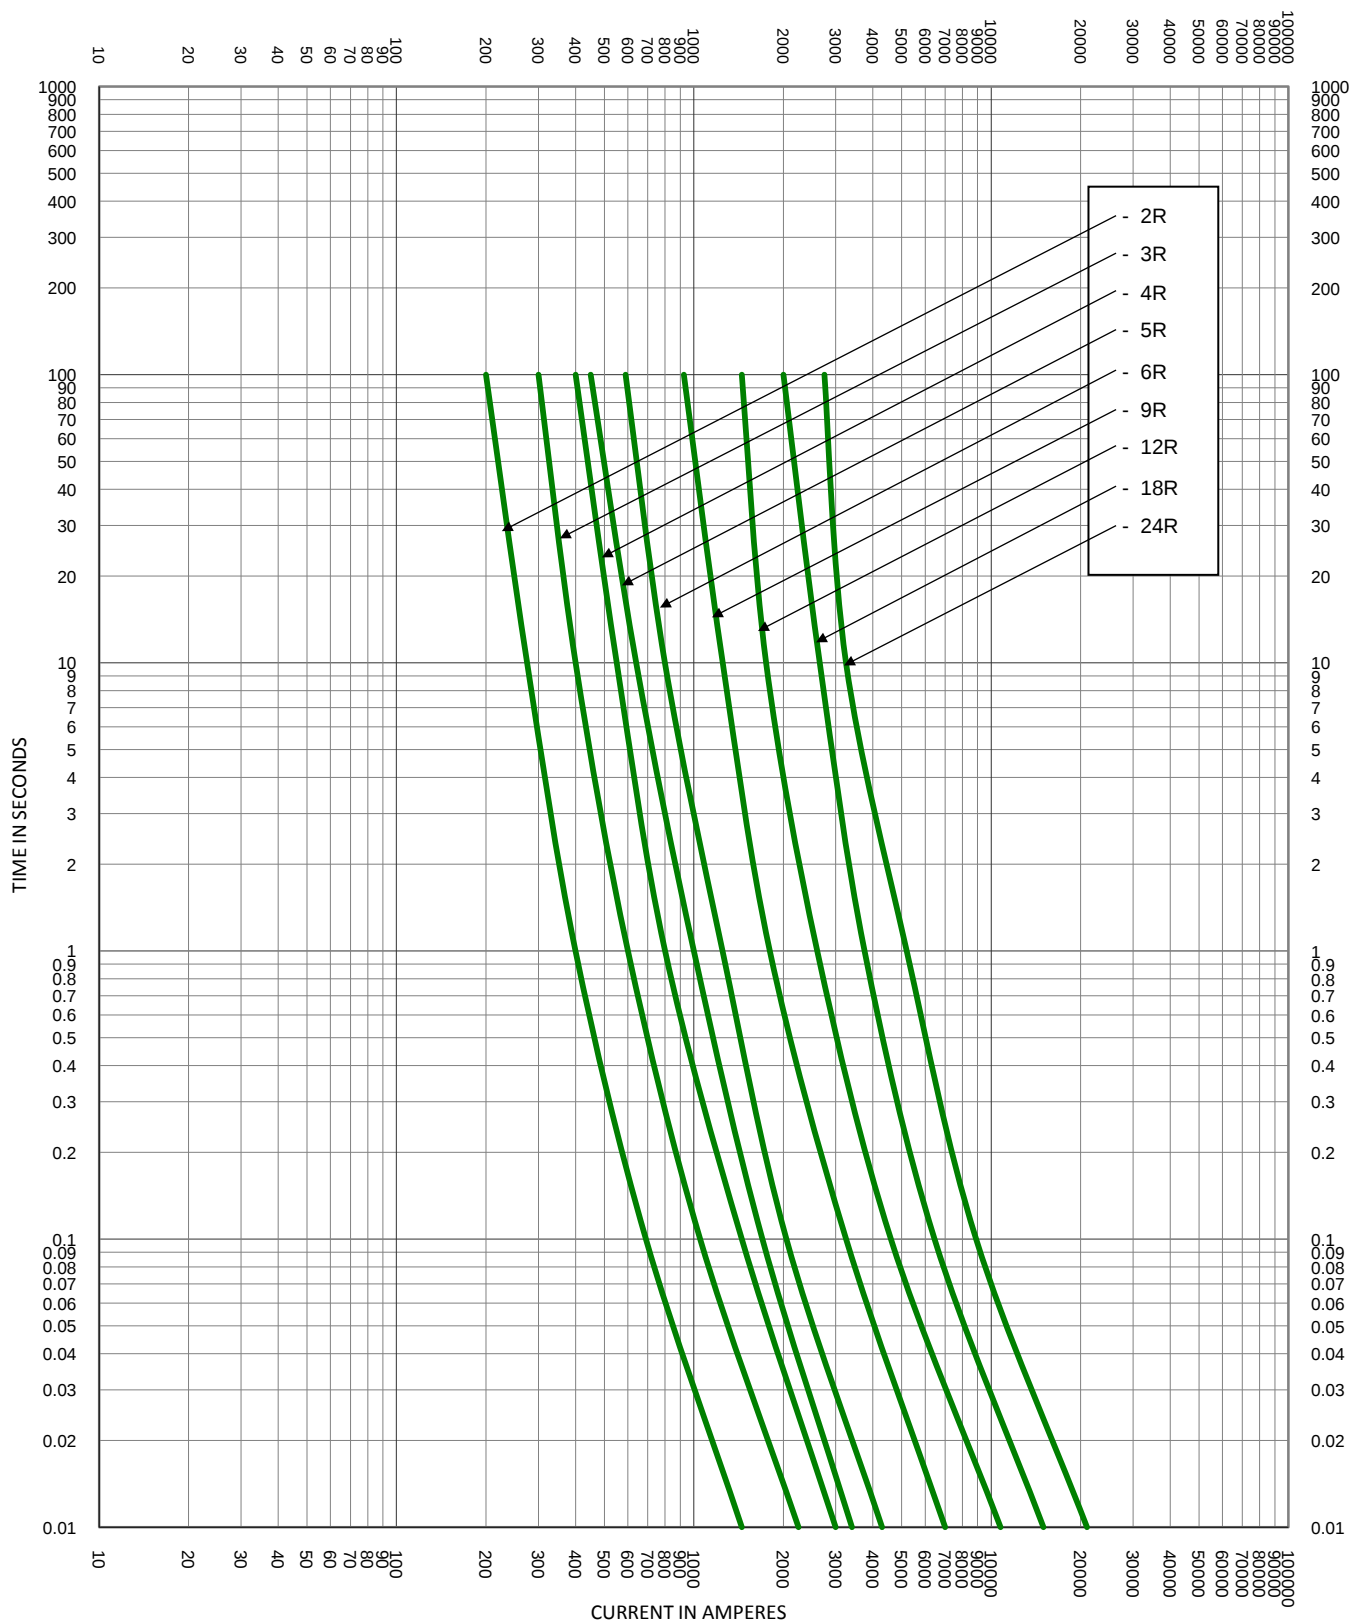

TEST VOLTAGE: 8.25kV BASIS FOR DATA:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER: CLEARING CURVES 8.25V R-RATED 2R - 24R
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 05/17/2013 REVISION: B DRAWING NO.: FCC04-8.25R-002 SHEET 2 OF 2

TIME CURRENT CHARACTERISTIC CURVES