
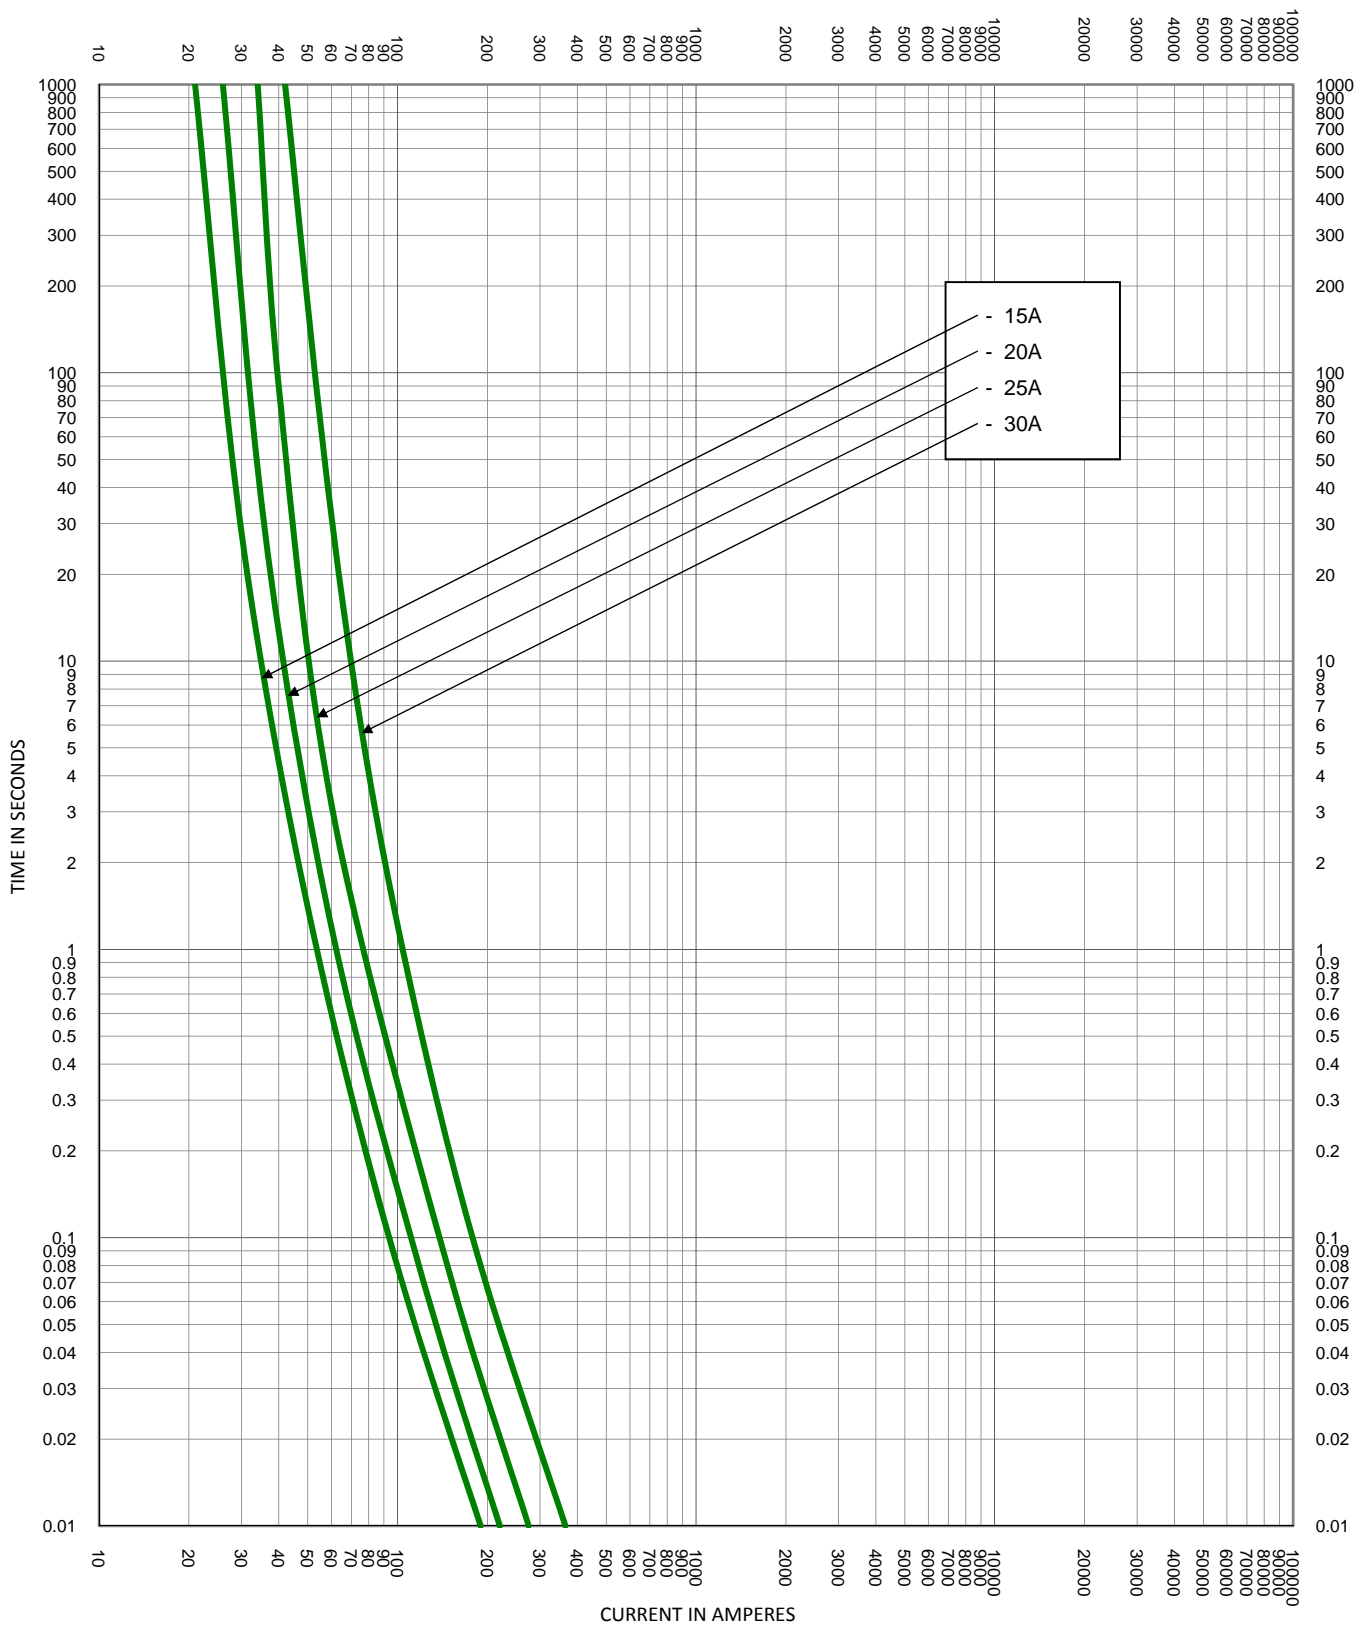

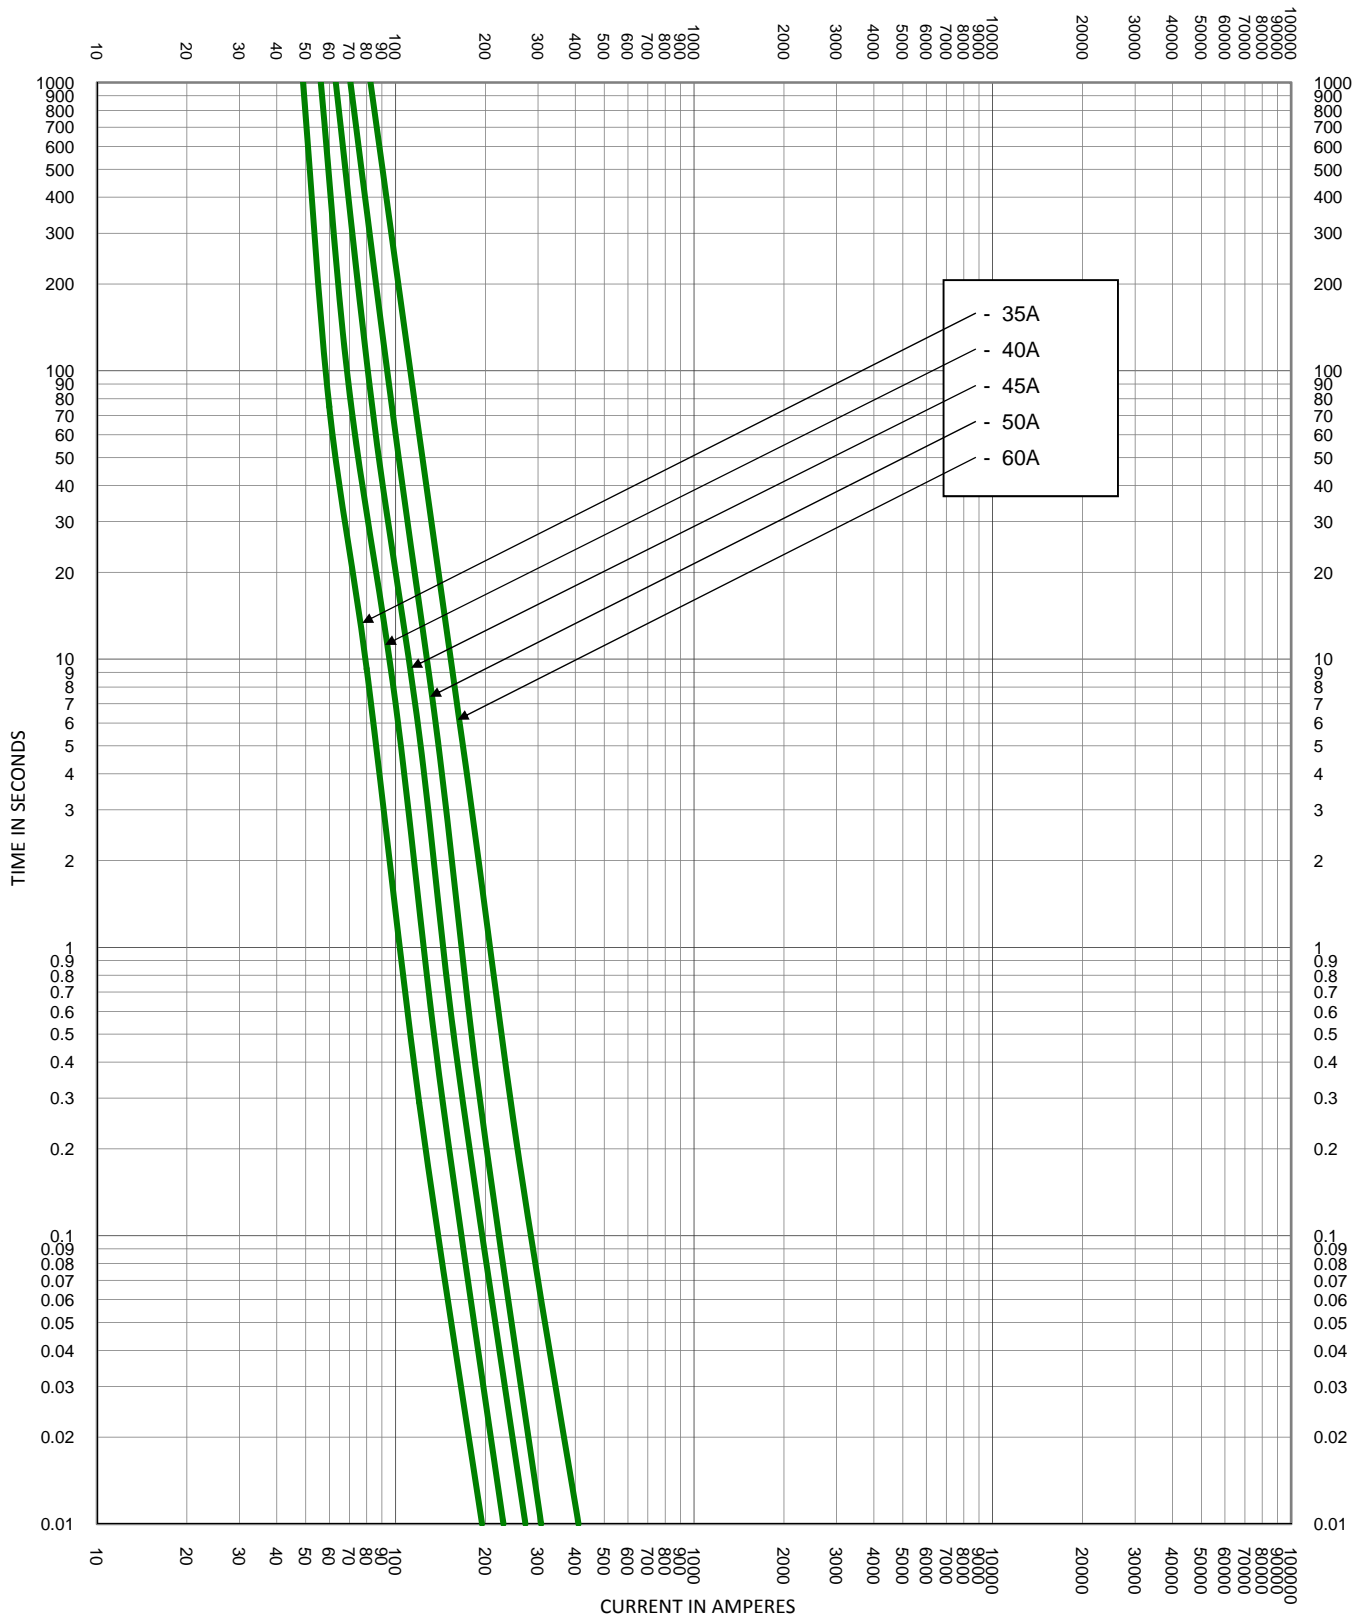



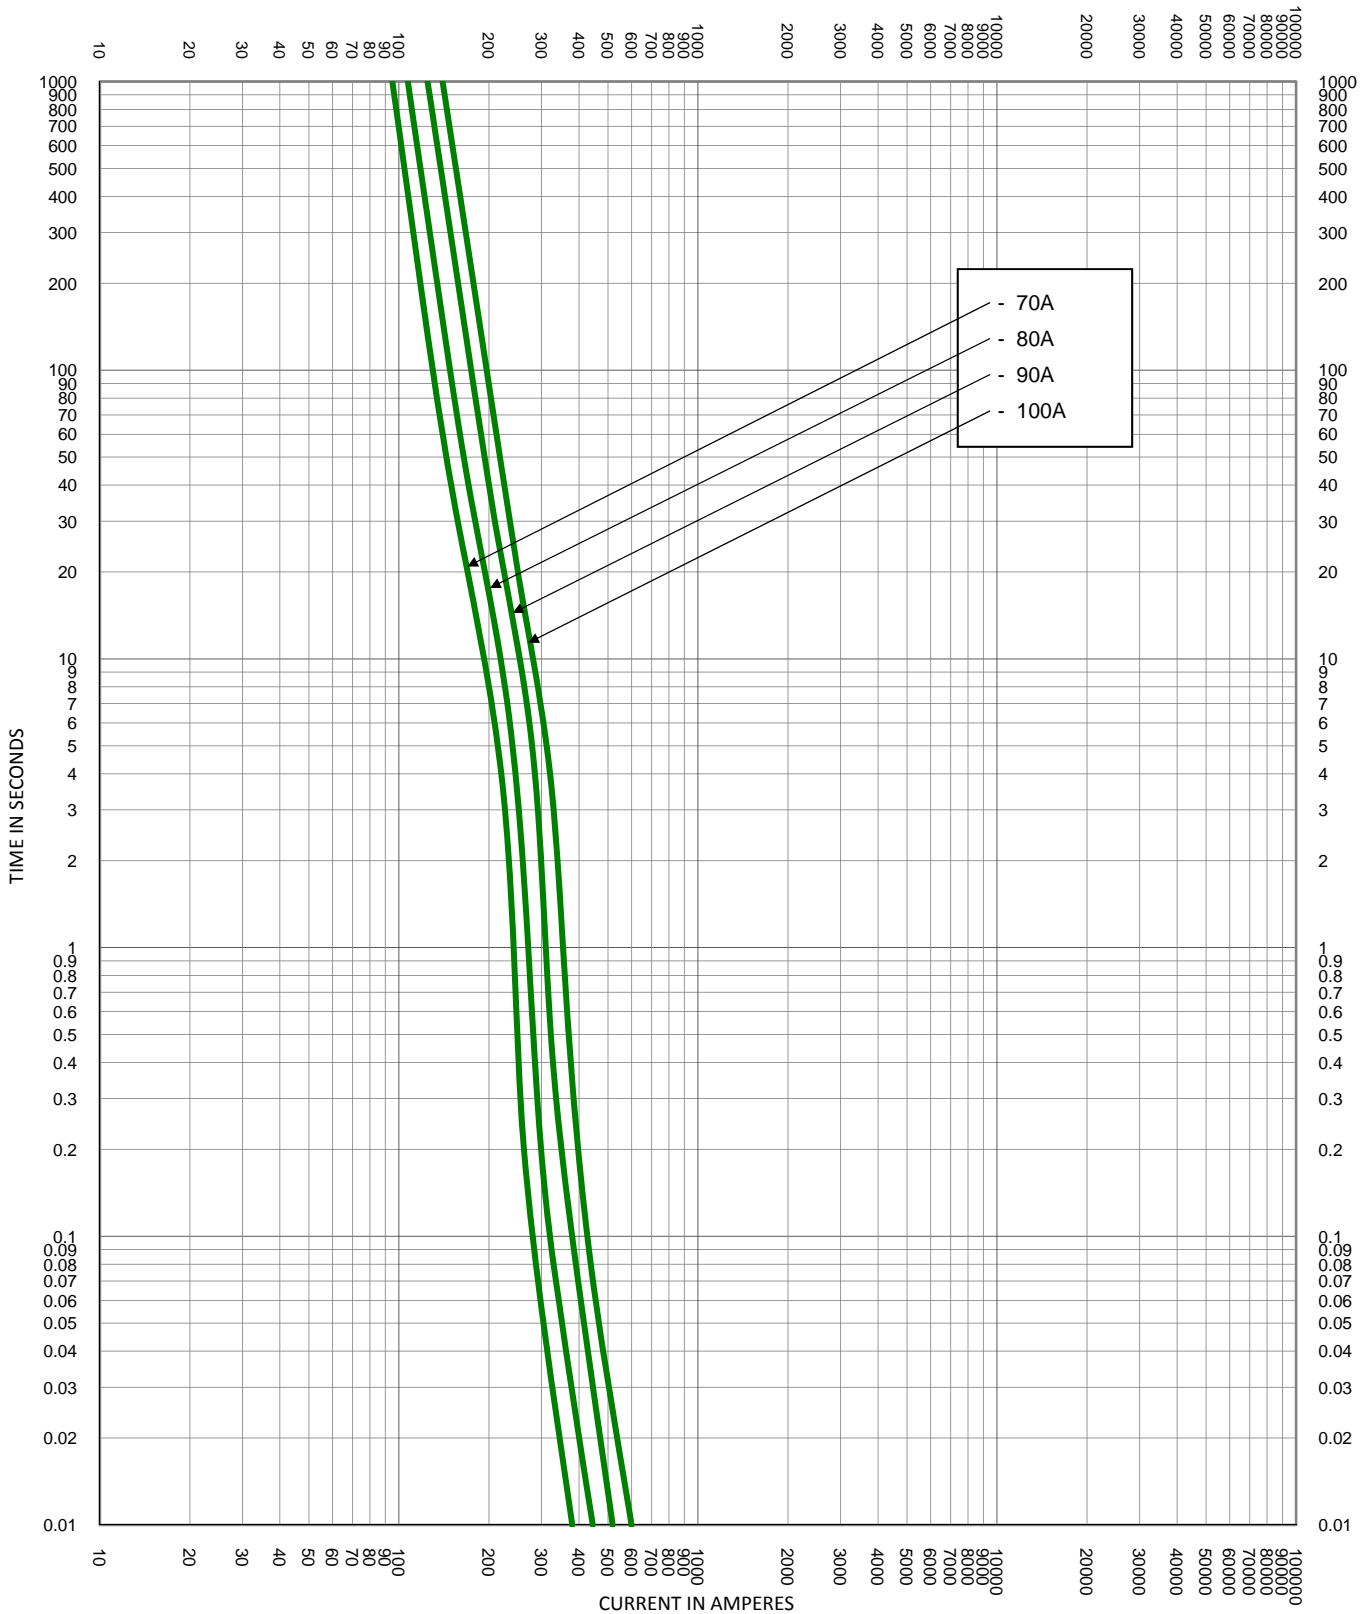
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLNP 1A - 1200A
		DRAWN BY: LLL
		DATE: 1/21/14
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		REVISION: B
		DRAWING NO.: FCC01-JLLNP SHEET 2 OF 8




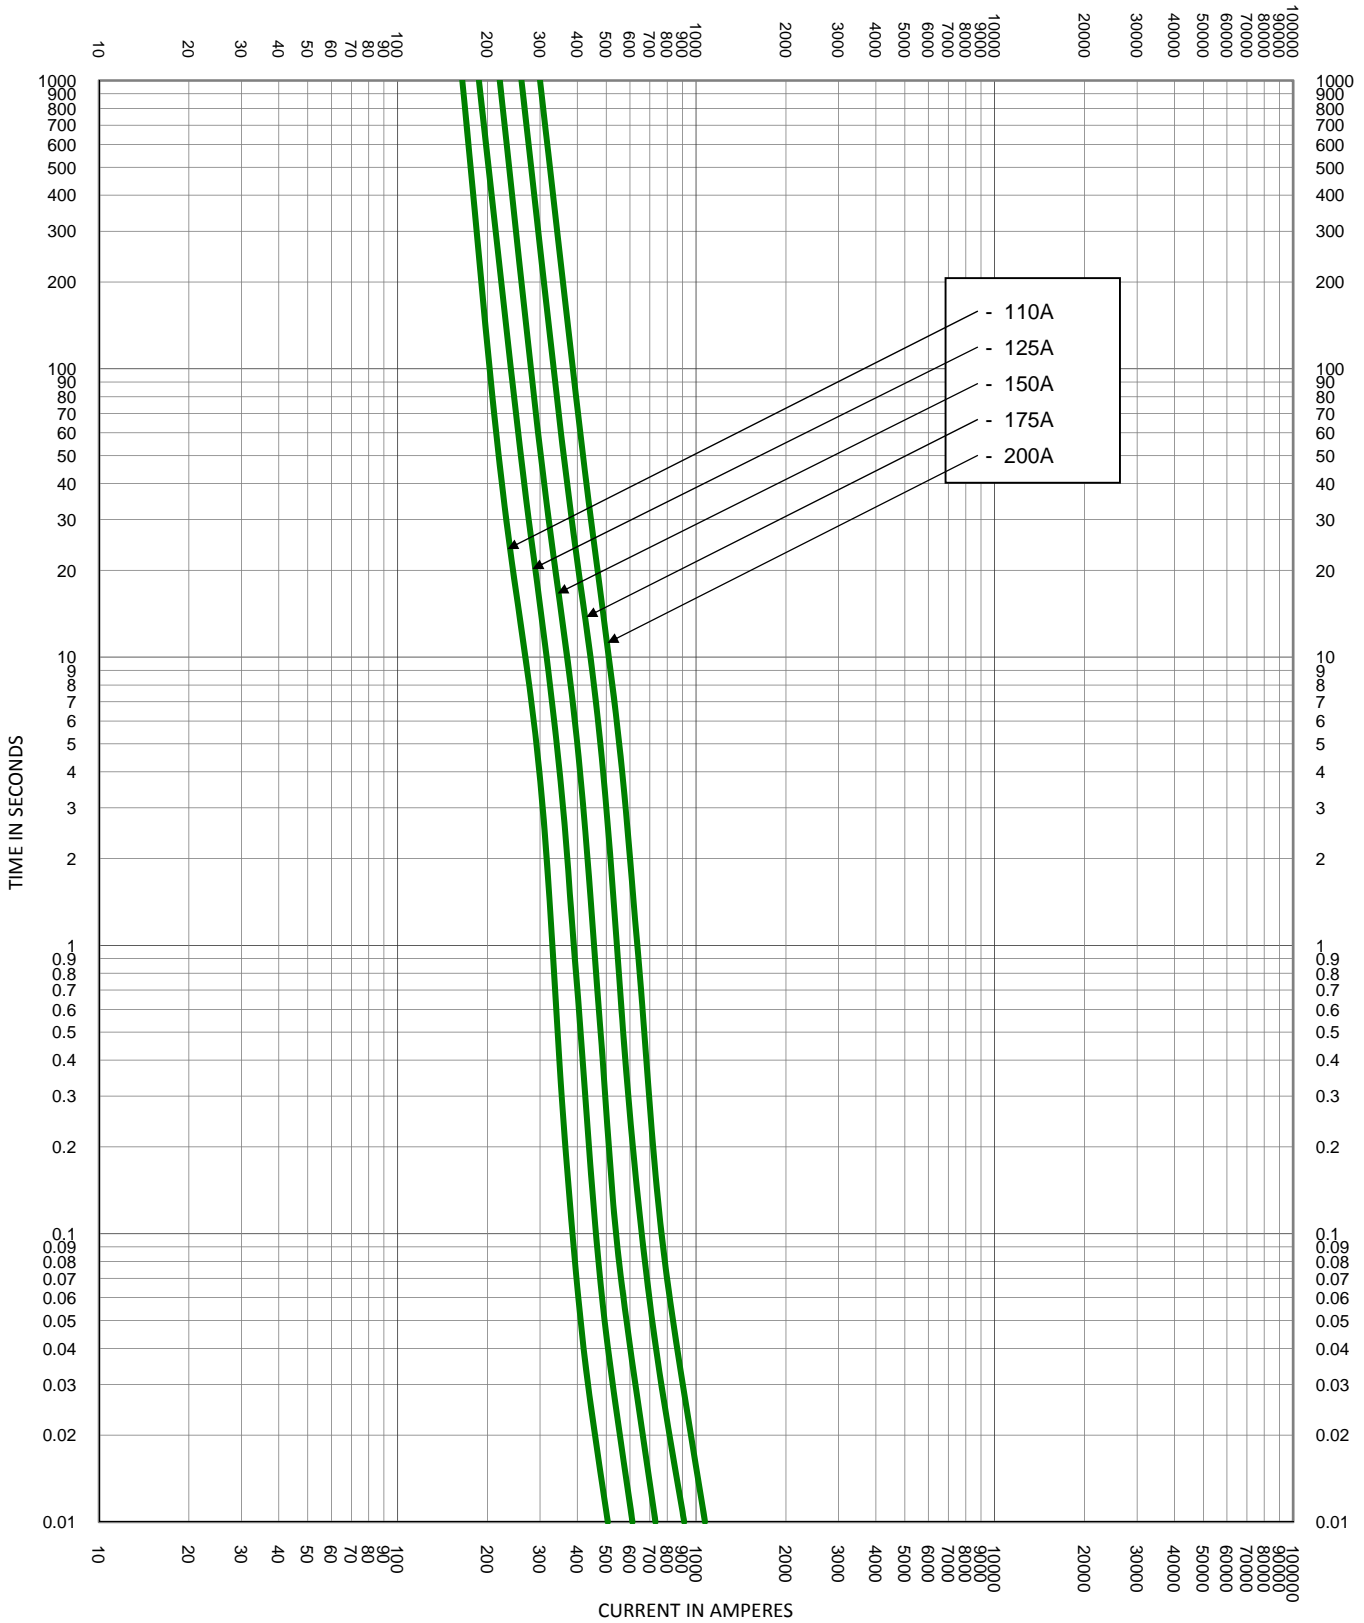
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLNP 1A - 1200A
		DRAWN BY: LLL
		DATE: 1/21/14
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		REVISION: B
		DRAWING NO.: FCC01-JLLNP SHEET 3 OF 8




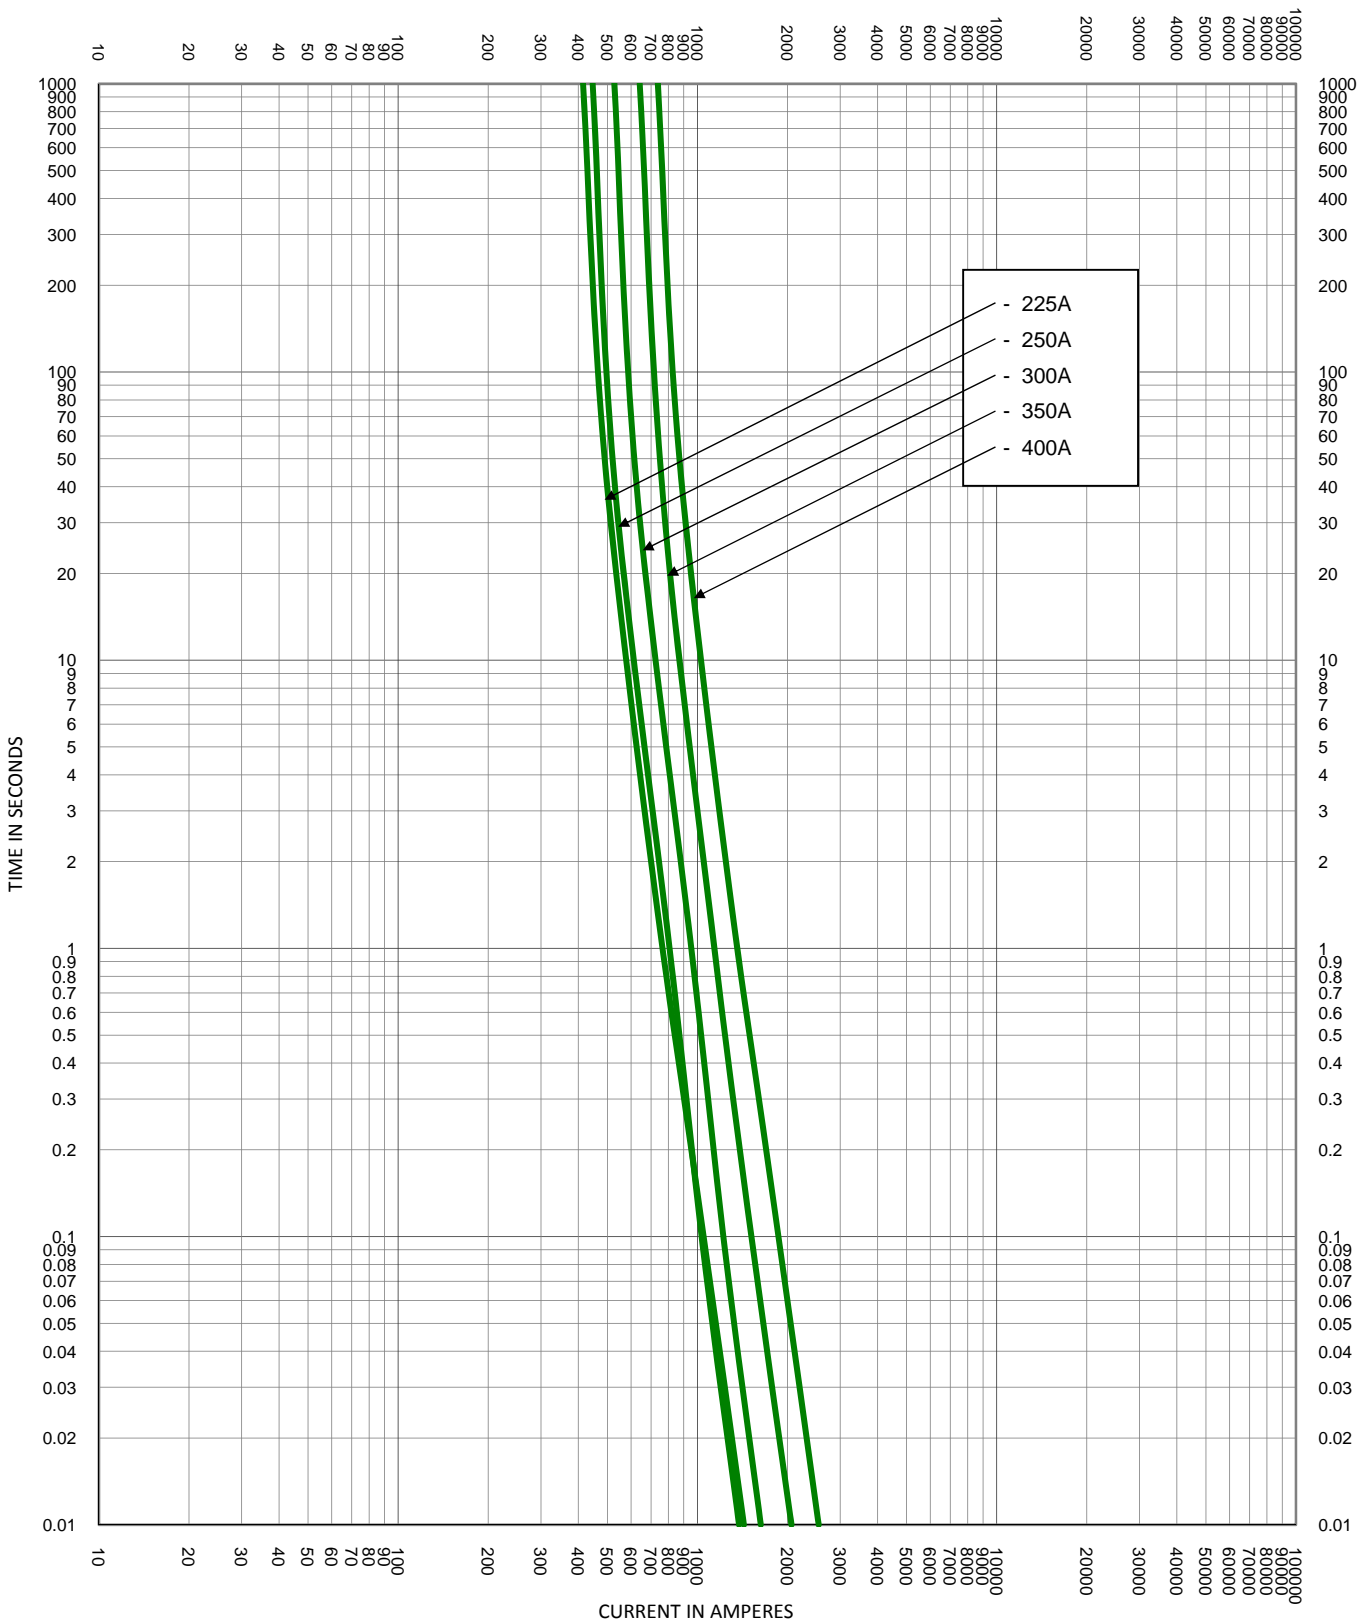
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLNP 1A - 1200A
		DRAWN BY: LLL
		DATE: 1/21/14
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		REVISION: B
		DRAWING NO.: FCC01-JLLNP SHEET 4 OF 8




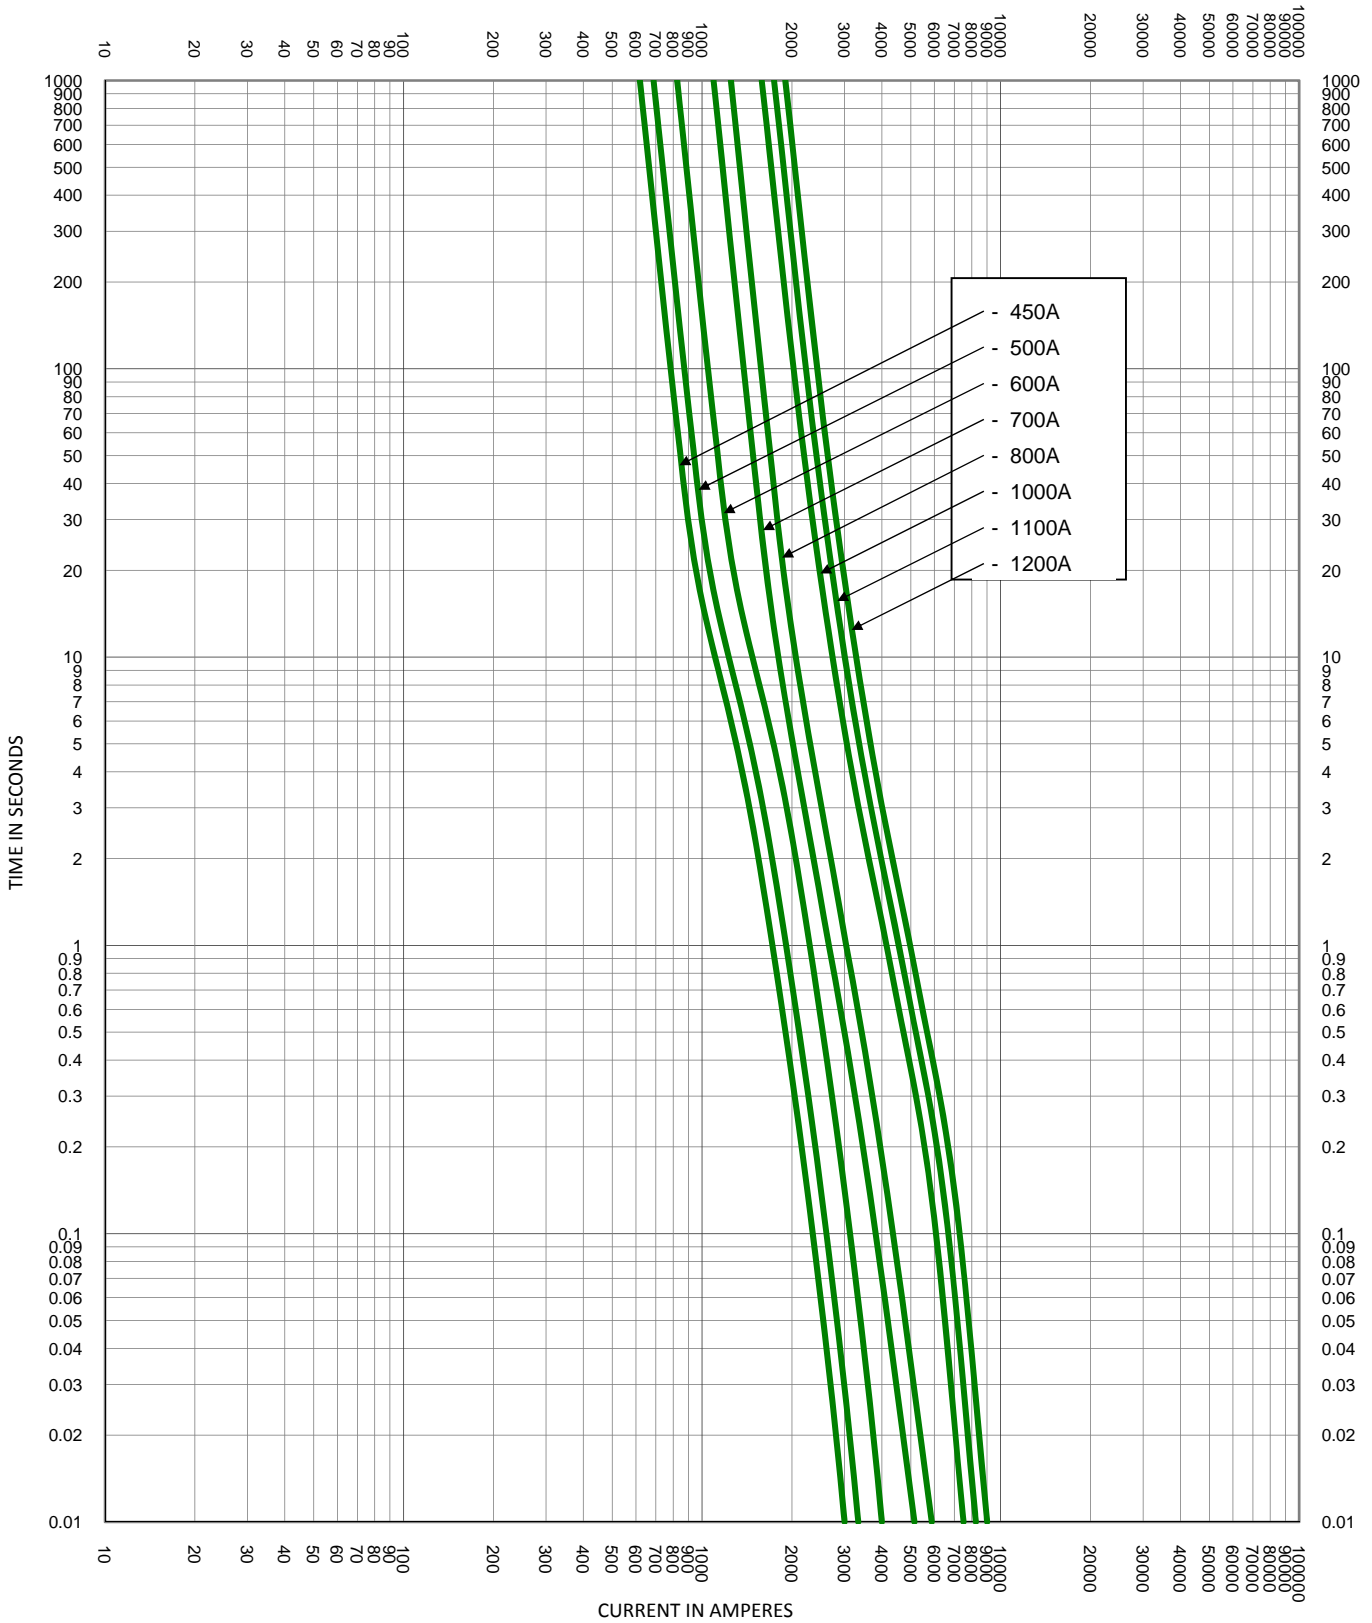
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLNP 1A - 1200A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 1/21/14 REVISION: B
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-JLLNP SHEET 5 OF 8




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLNP 1A - 1200A
		DRAWN BY: LLL DATE: 1/21/14 REVISION: B
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-JLLNP <span style="float: right;">SHEET 6 OF 8</span>



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLNP 1A - 1200A
		DRAWN BY: LLL DATE: 1/21/14 REVISION: B
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-JLLNP <span style="float: right;">SHEET 7 OF 8</span>



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLNP 1A - 1200A
		DRAWN BY: LLL
		DATE: 1/21/14
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		REVISION: B
		DRAWING NO.: FCC01-JLLNP SHEET 8 OF 8