
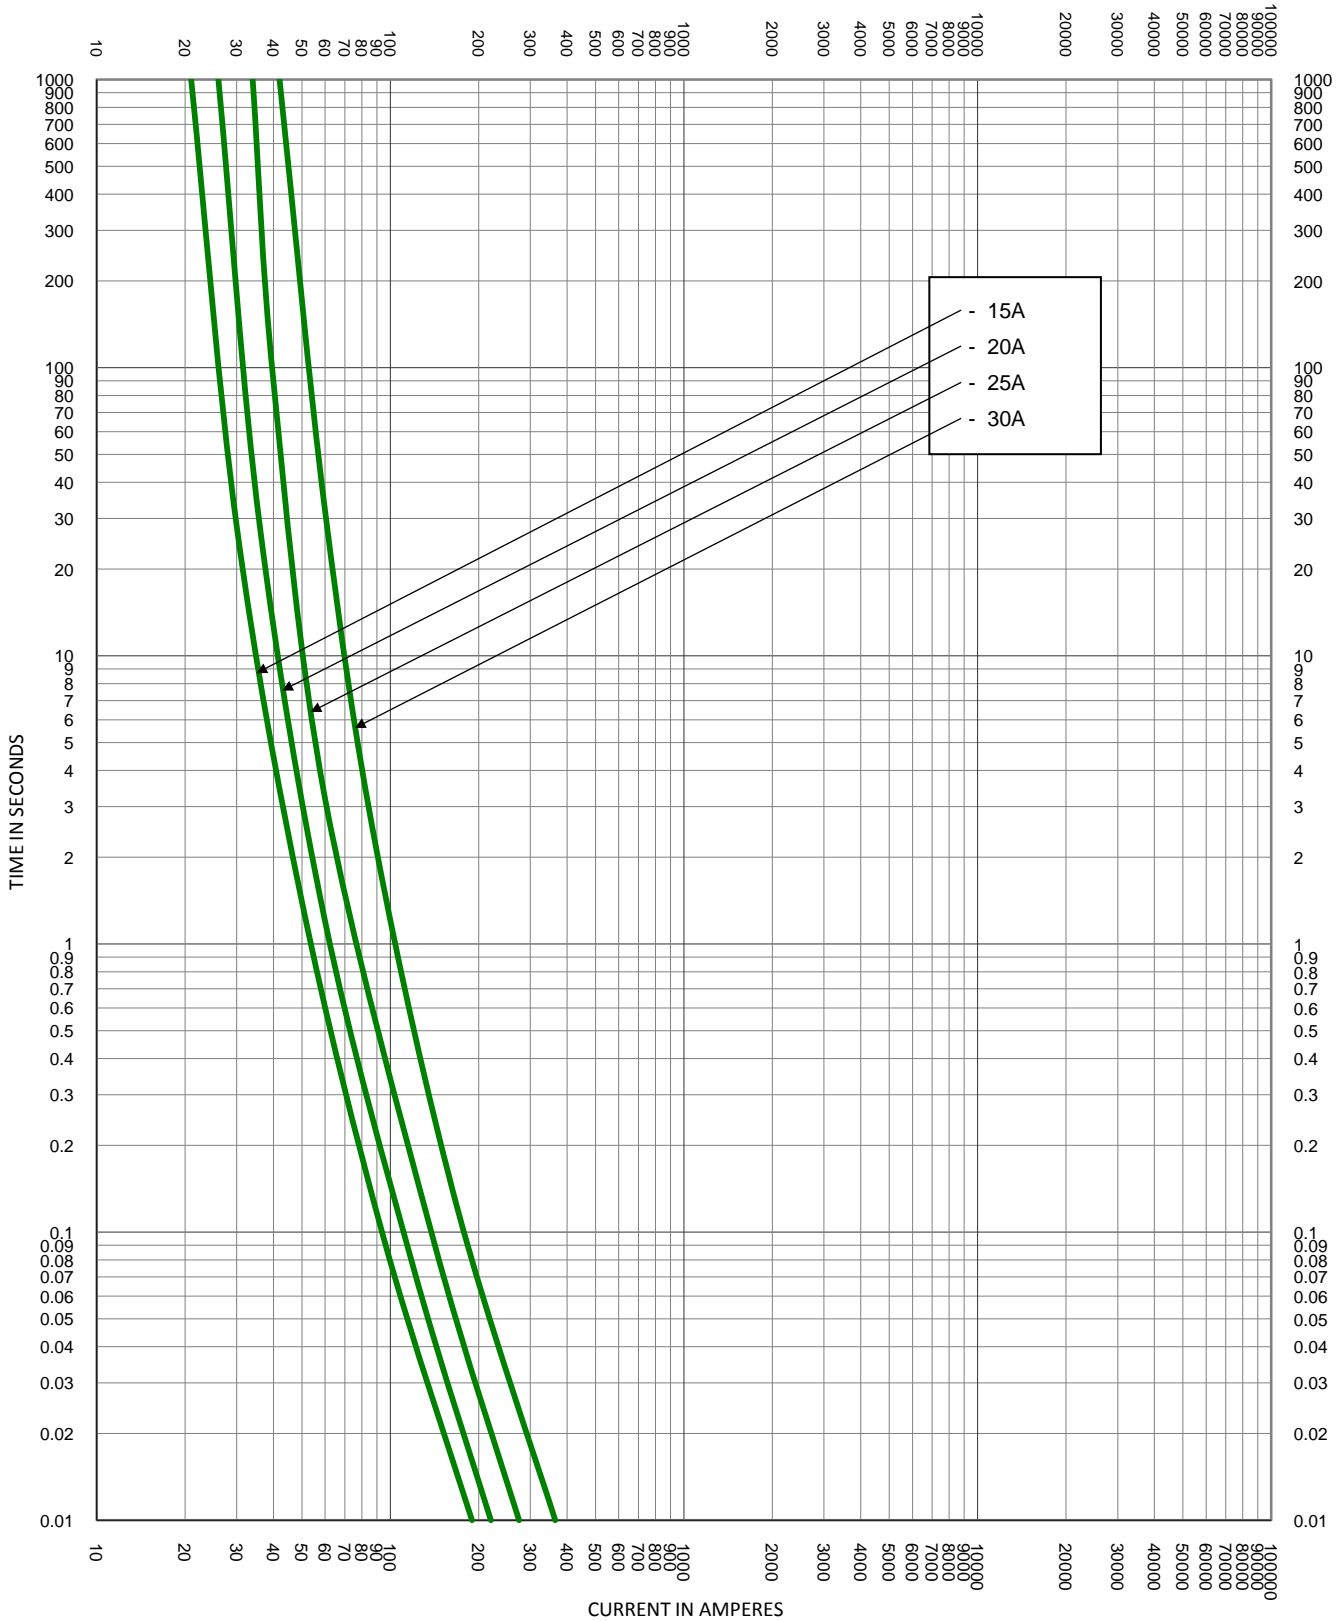

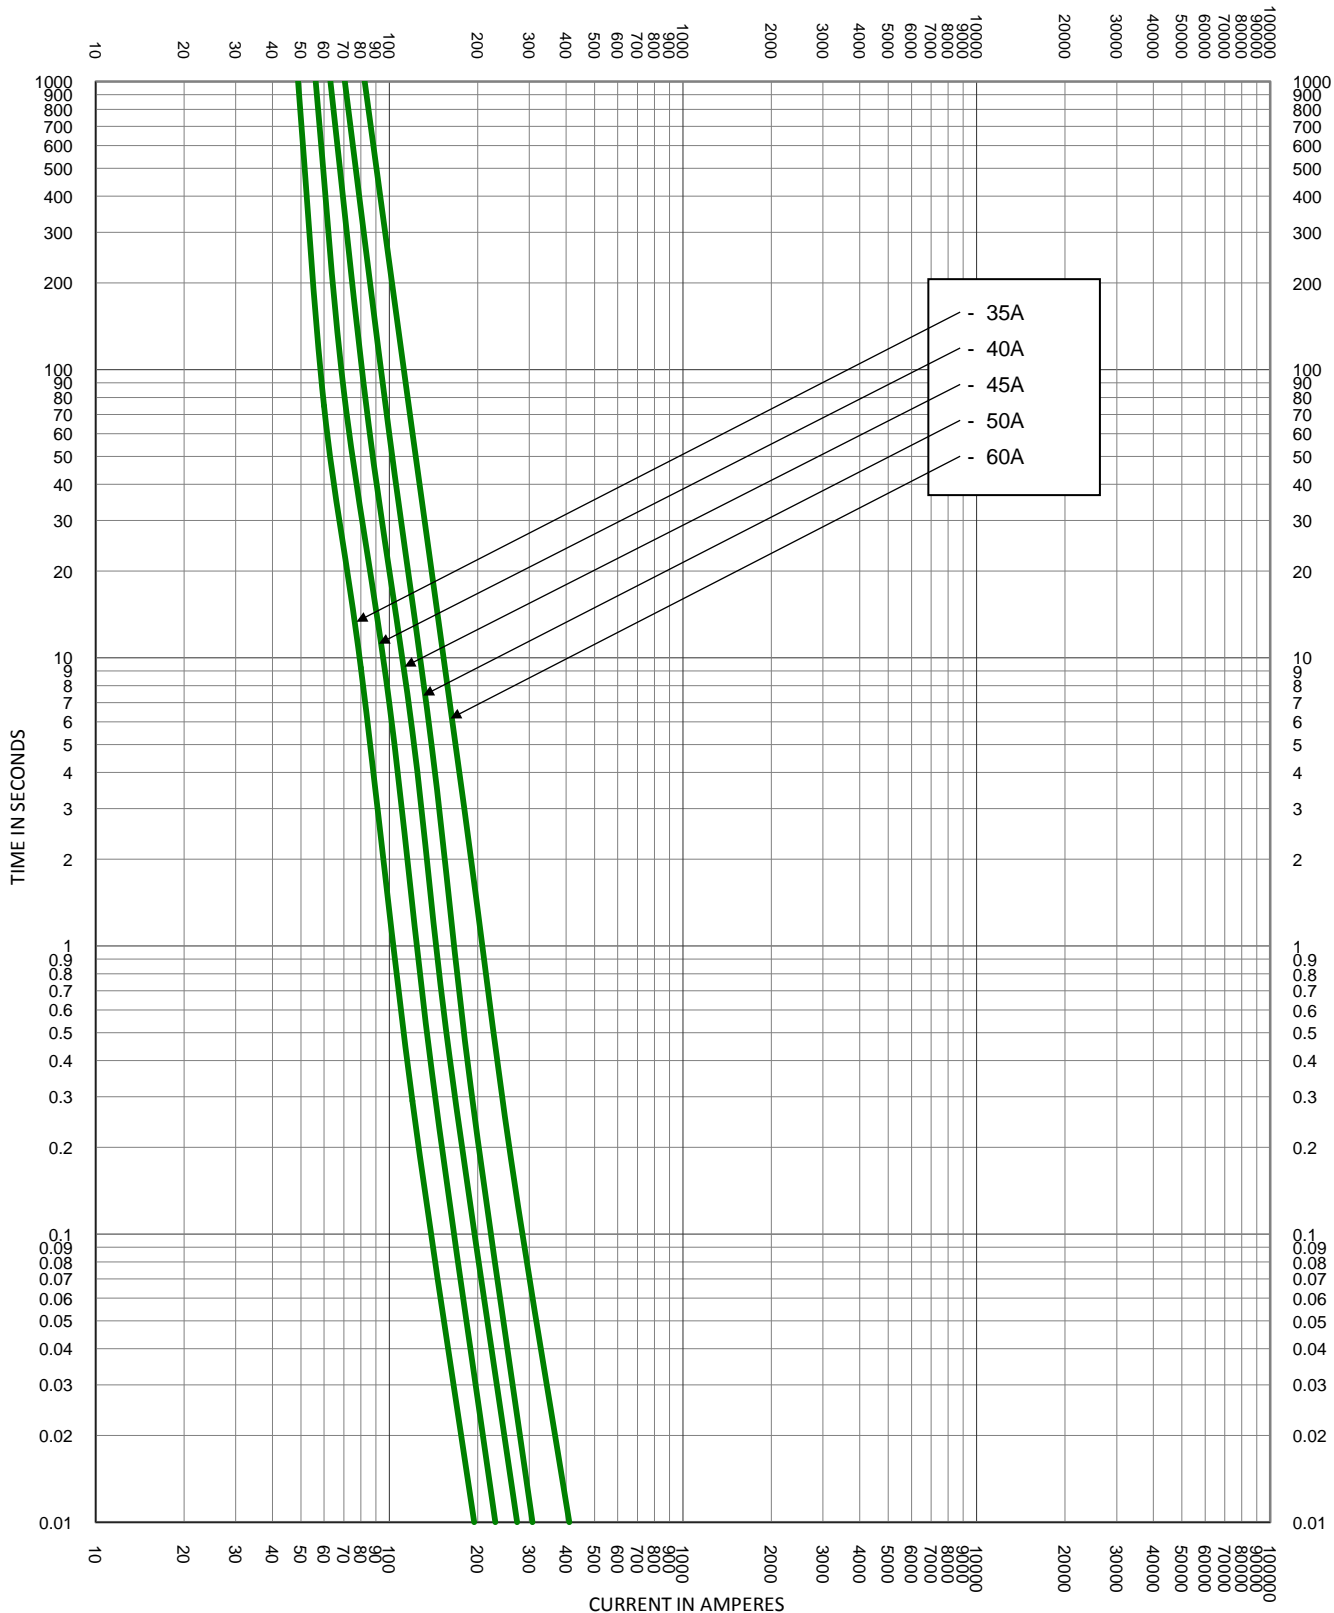



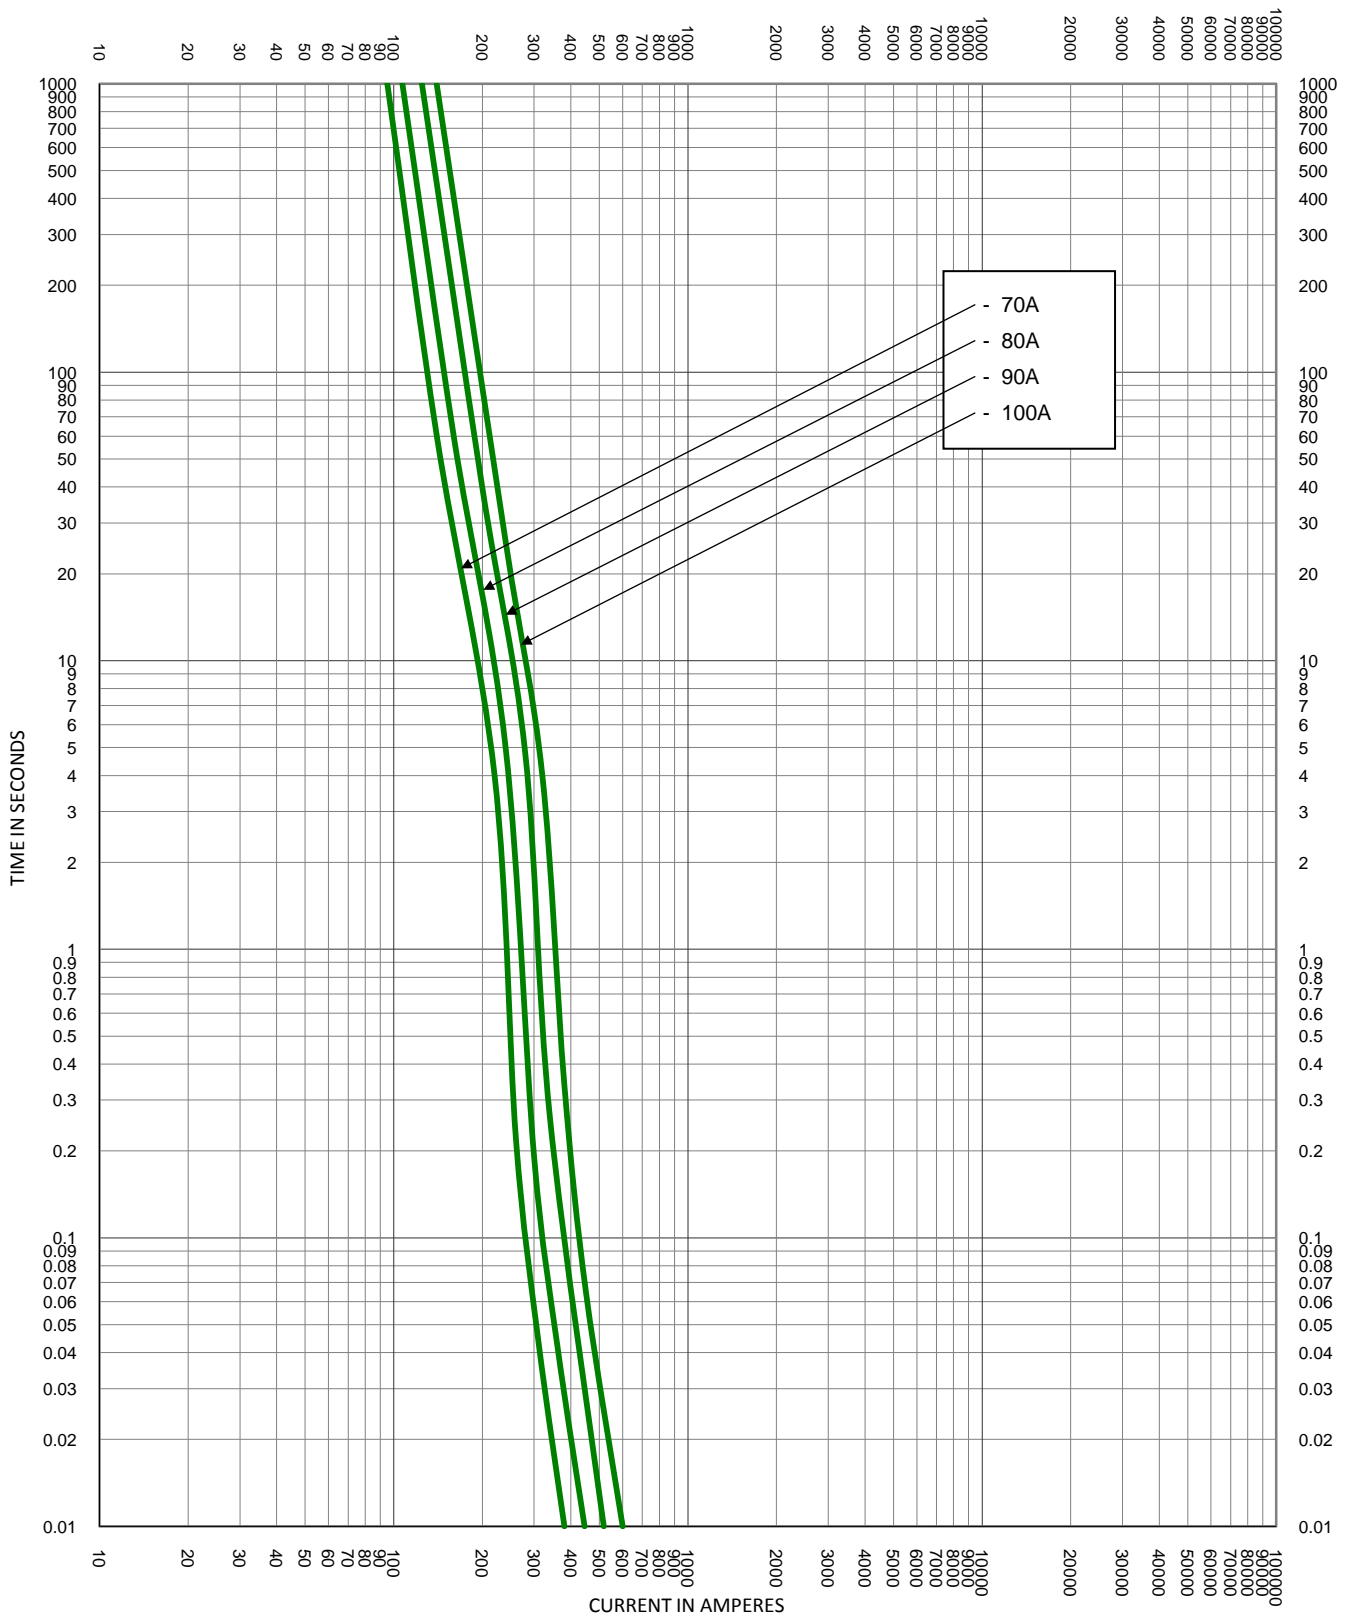
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A
		DRAWN BY: LLL DATE: 03/19/14 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-JLLN SHEET 2 OF 8




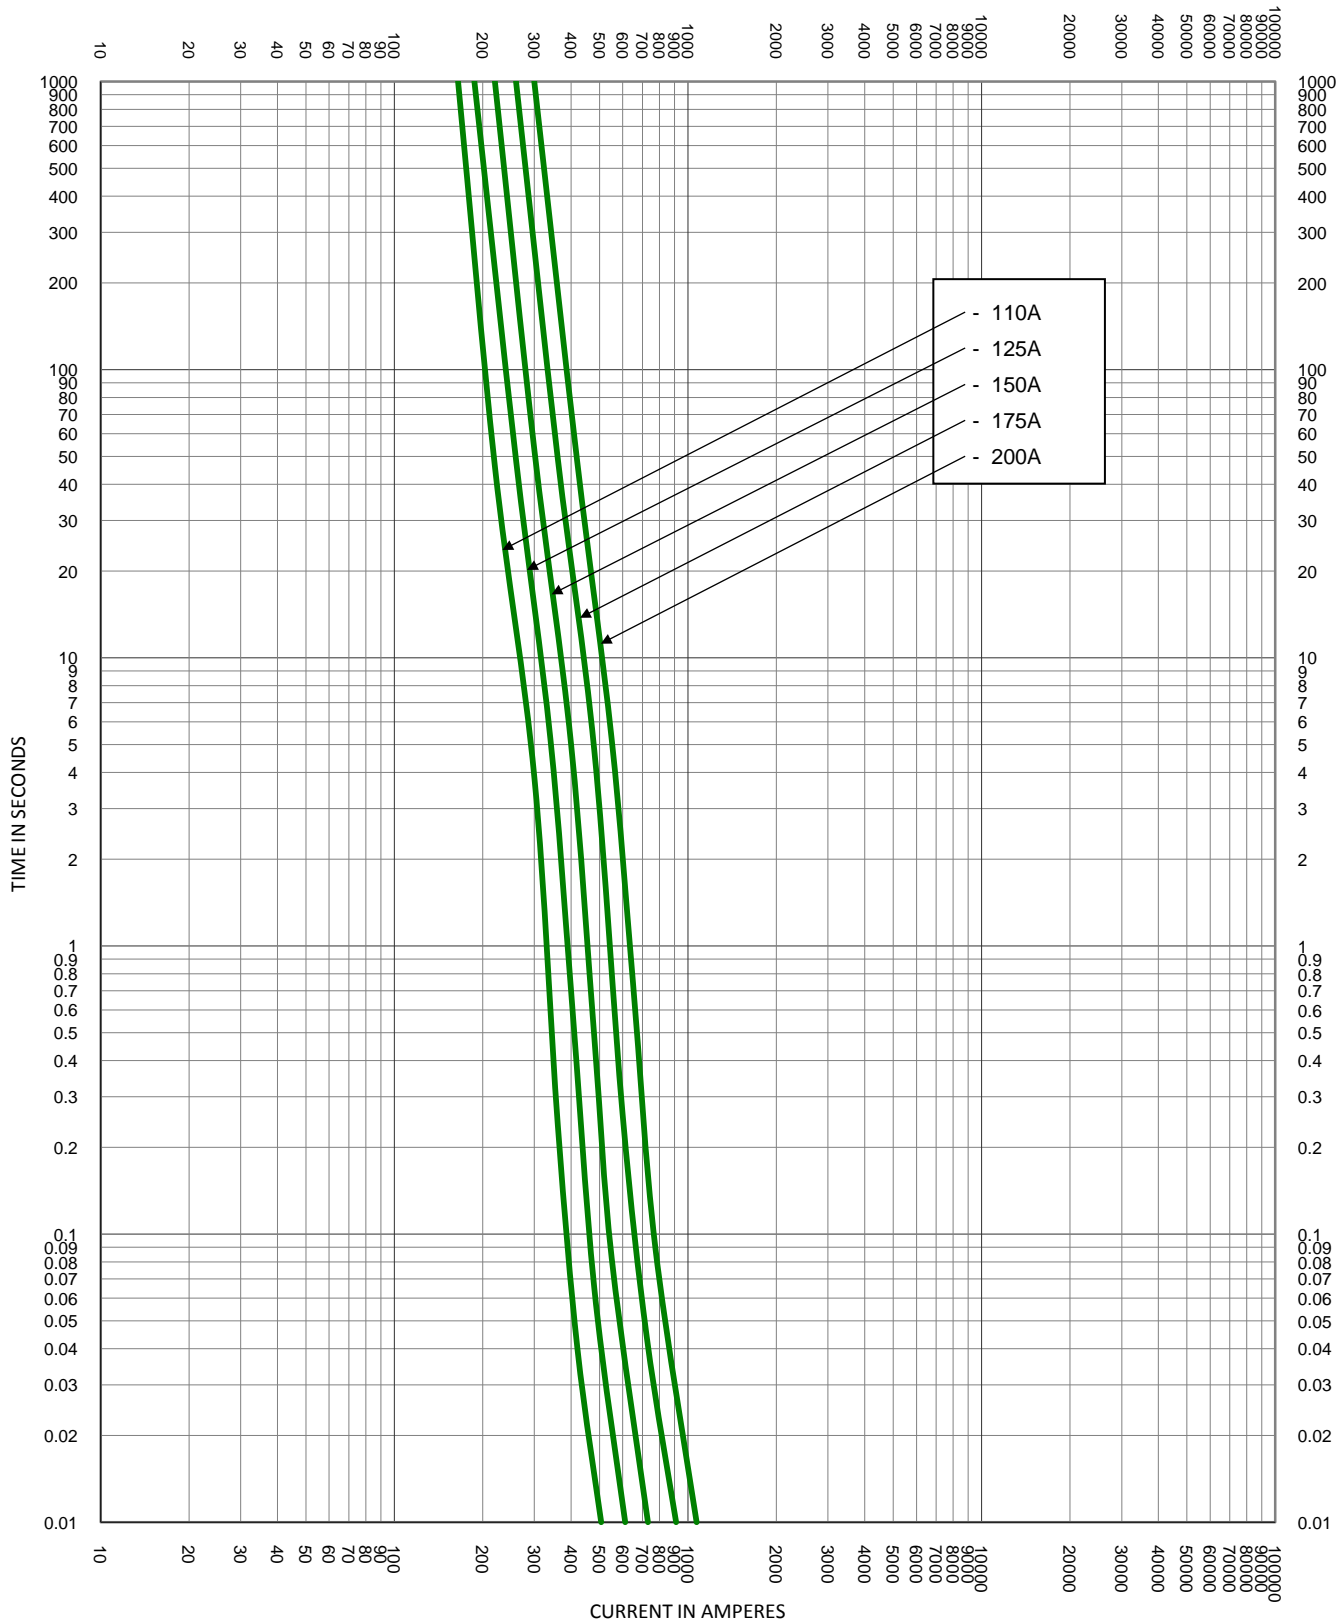
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A
		DRAWN BY: LLL
		DATE: 03/19/14
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		REVISION: A
		DRAWING NO.: SHEET 3 OF 8
		FCC01-JLLN




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A
		DRAWN BY: LLL DATE: 03/19/14 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-JLLN <span style="float: right;">SHEET 4 OF 8</span>




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A
		DRAWN BY: LLL DATE: 03/19/14 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-JLLN <span style="float: right;">SHEET 5 OF 8</span>




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A

	DRAWN BY: LLL DATE: 03/19/14 REVISION: A
	DRAWING NO.: FCC01-JLLN


**TIME CURRENT CHARACTERISTIC CURVES**

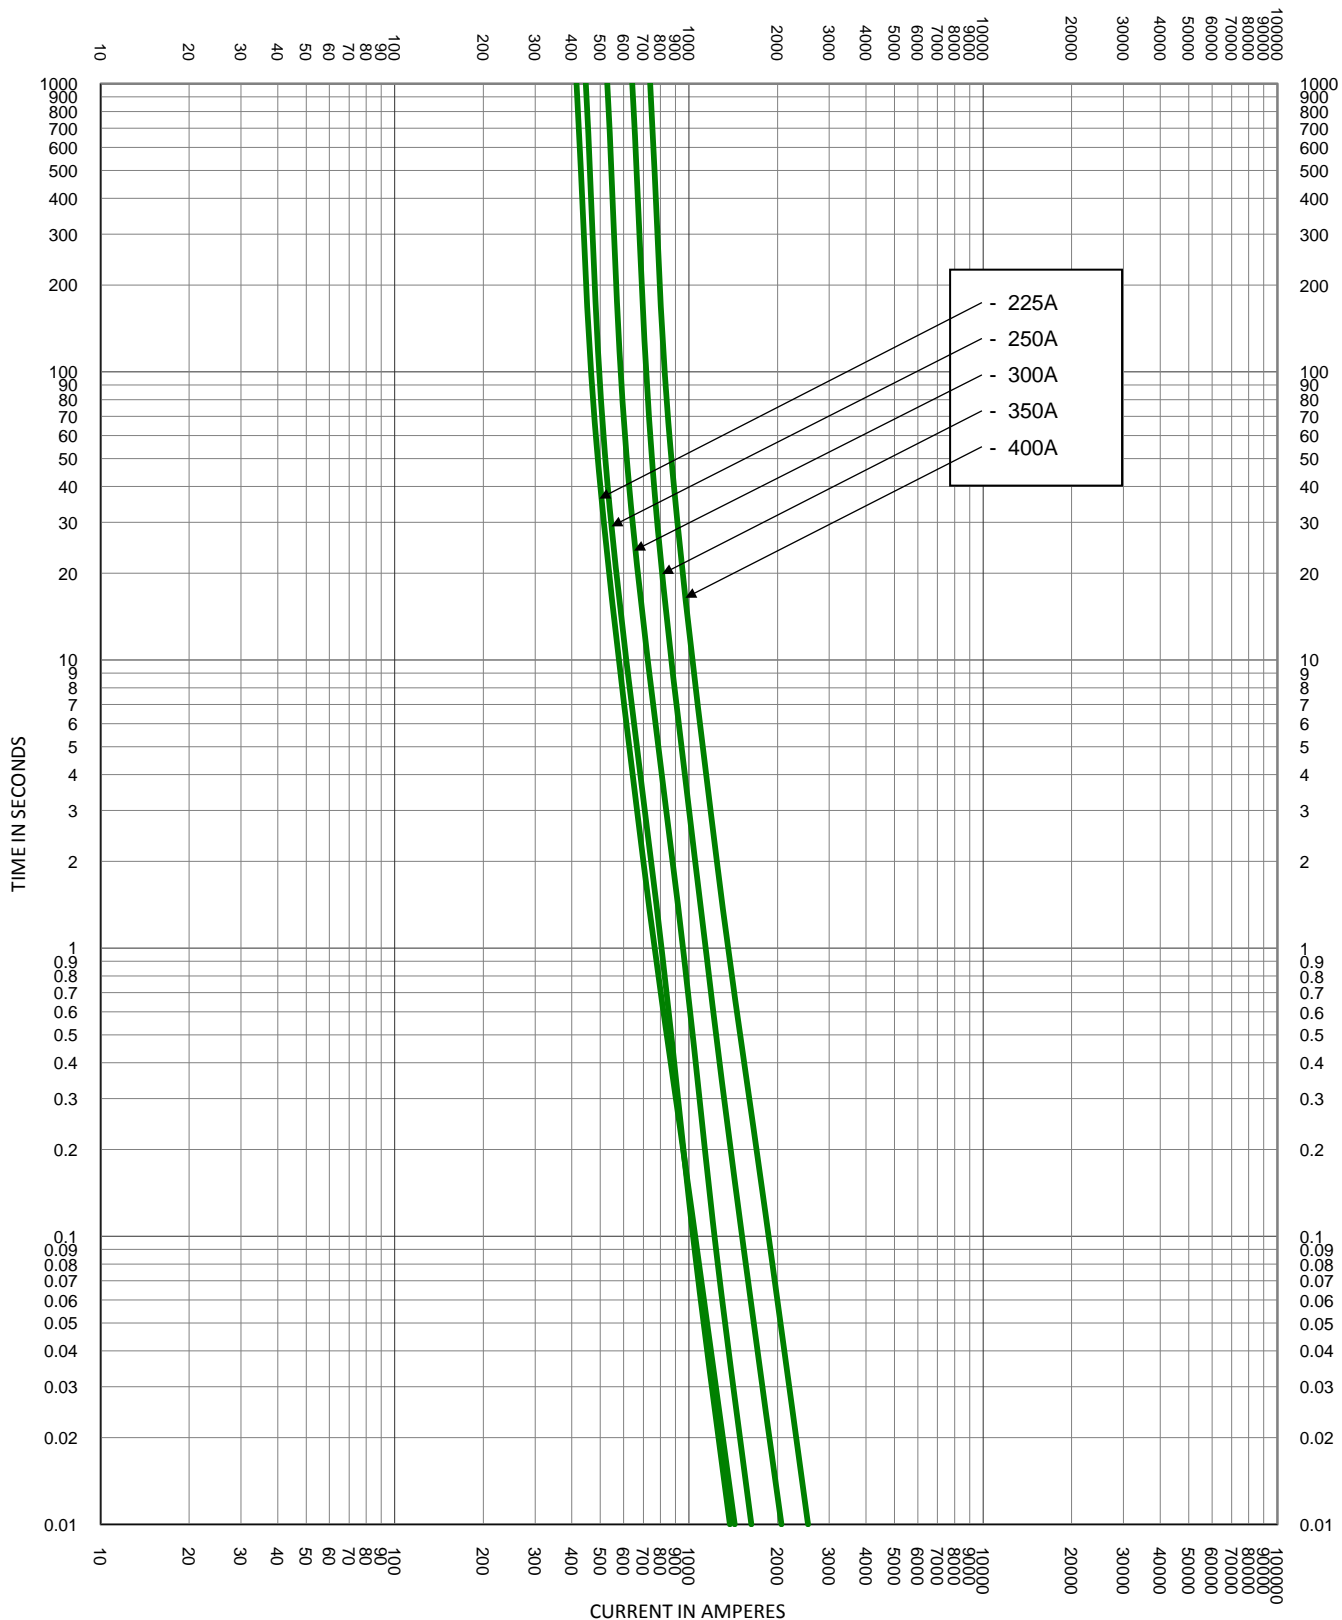


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A

	DRAWN BY: LLL DATE: 03/19/14 REVISION: A
	DRAWING NO.: FCC01-JLLN SHEET 7 OF 8

**TIME CURRENT CHARACTERISTIC CURVES**

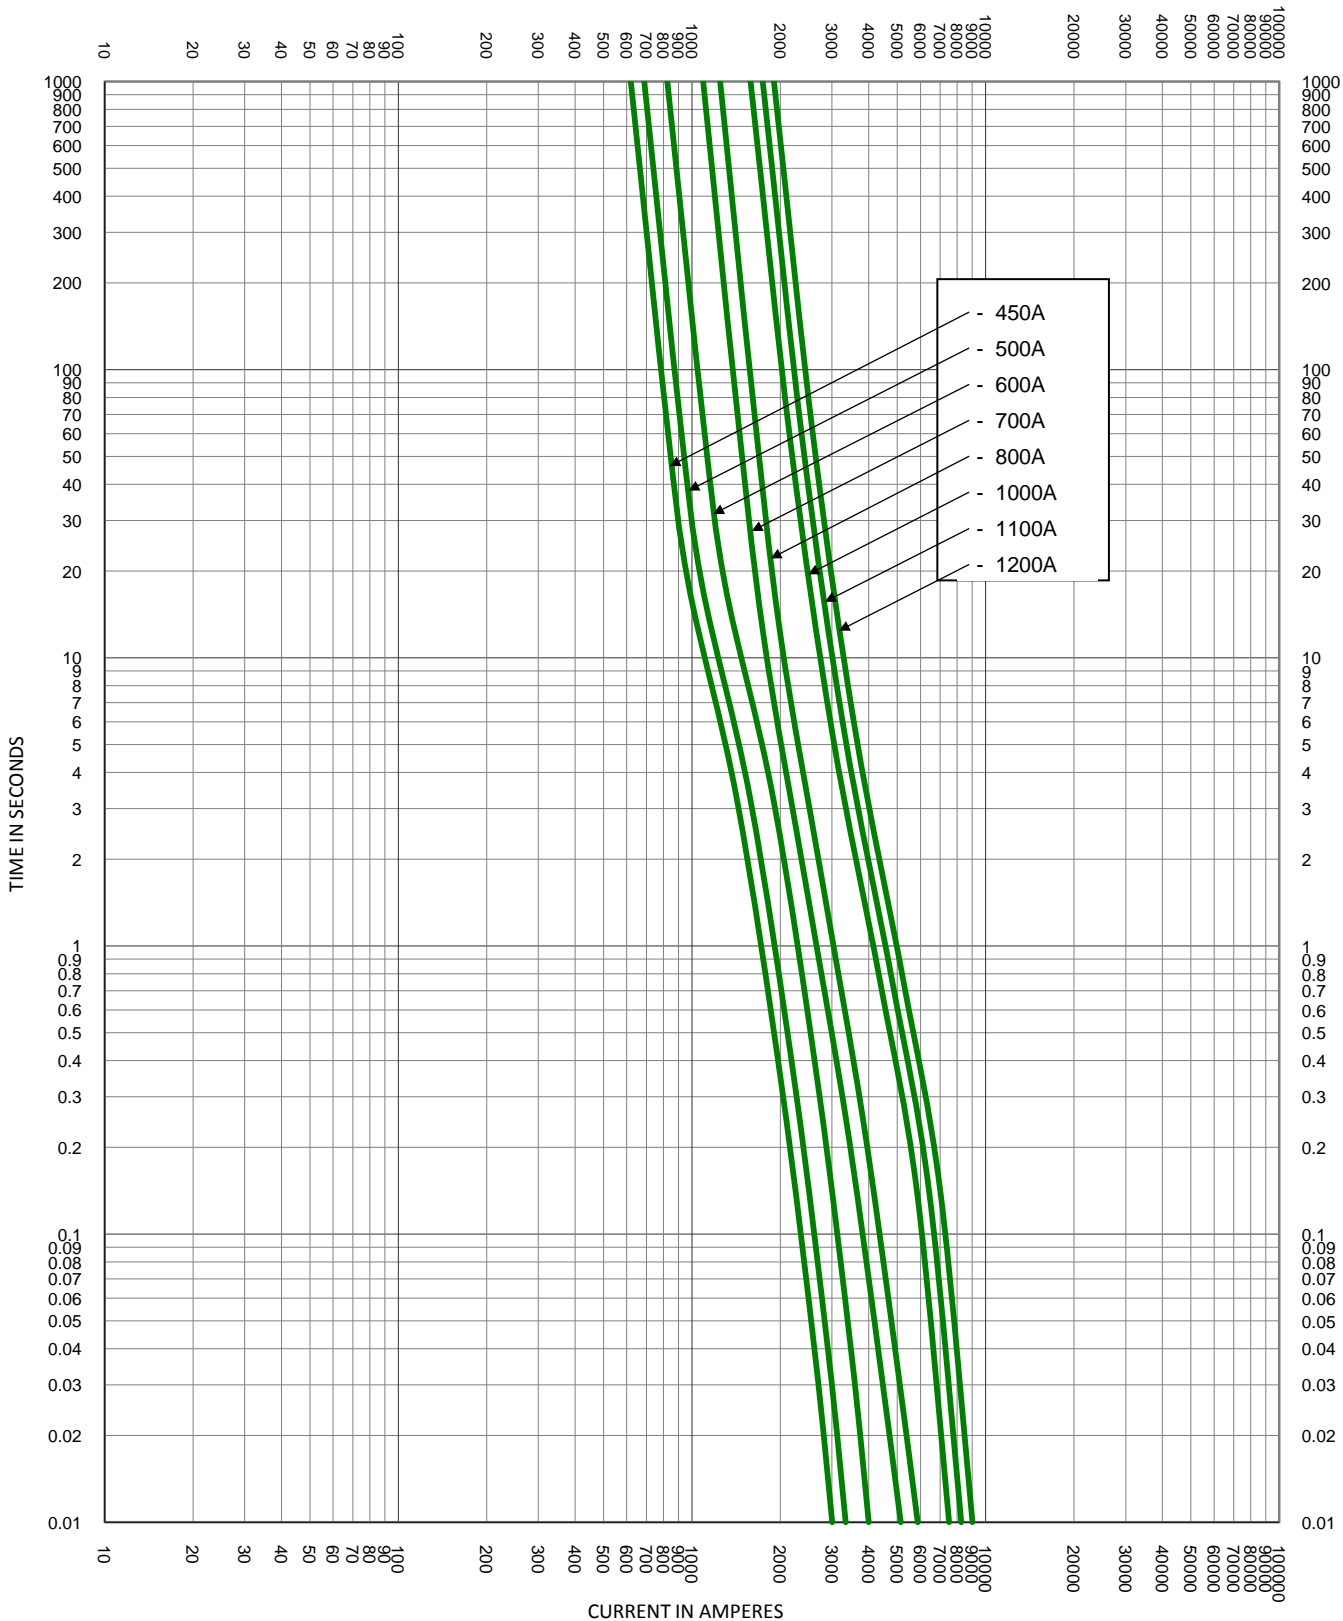

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 3/19/14 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-JLLN SHEET 8 OF 8