



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLLU 601A - 4000A

	DRAWN BY: LLL DATE: 05/31/2017 REVISION: A
	DRAWING NO.: FCC01-KLLU SHEET 2 OF 3

TIME CURRENT CHARACTERISTIC CURVES

- THIS DATA IS GENERATED IN EXCEL -

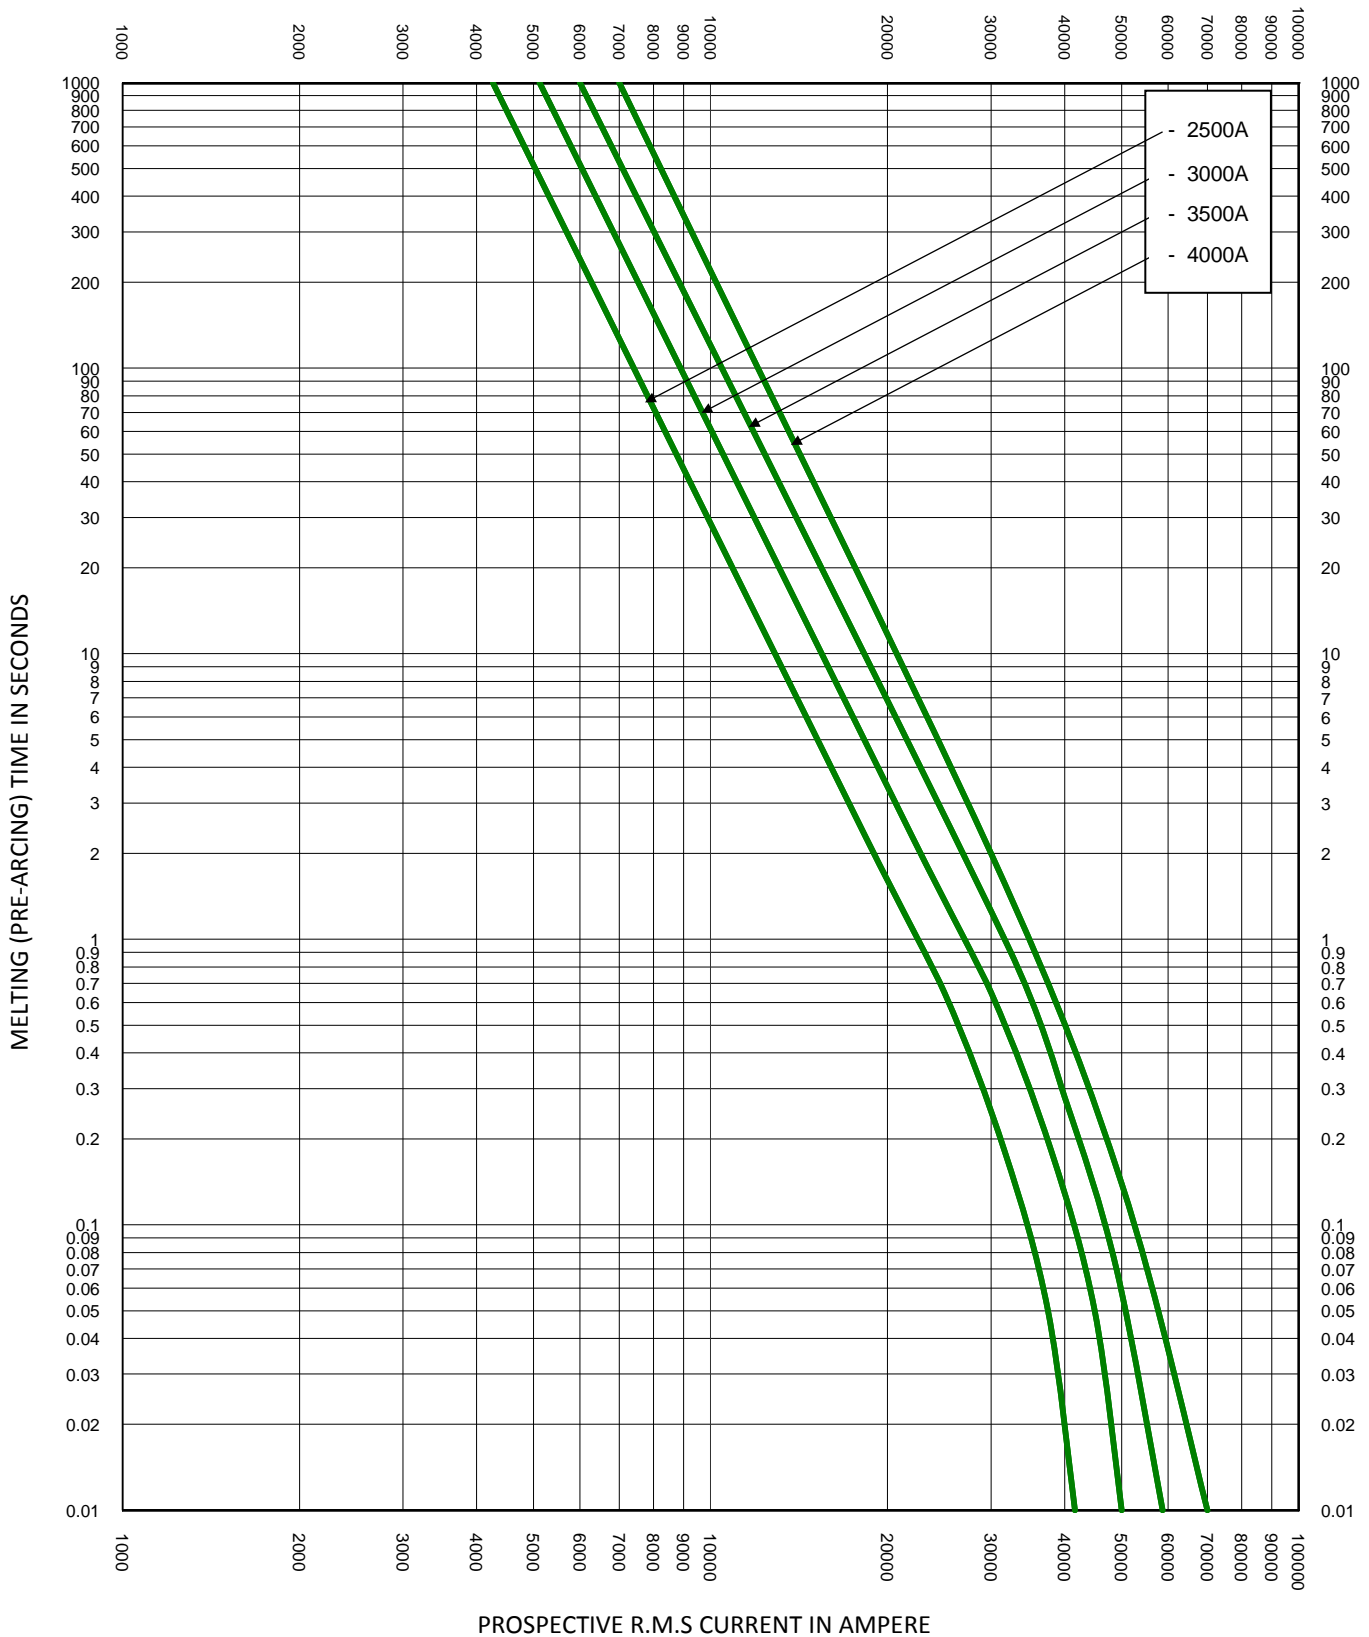

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLLU 601A - 4000A
		DRAWN BY: LLL
		DATE: 05/31/2017
		REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-KLLU SHEET 3 OF 3