
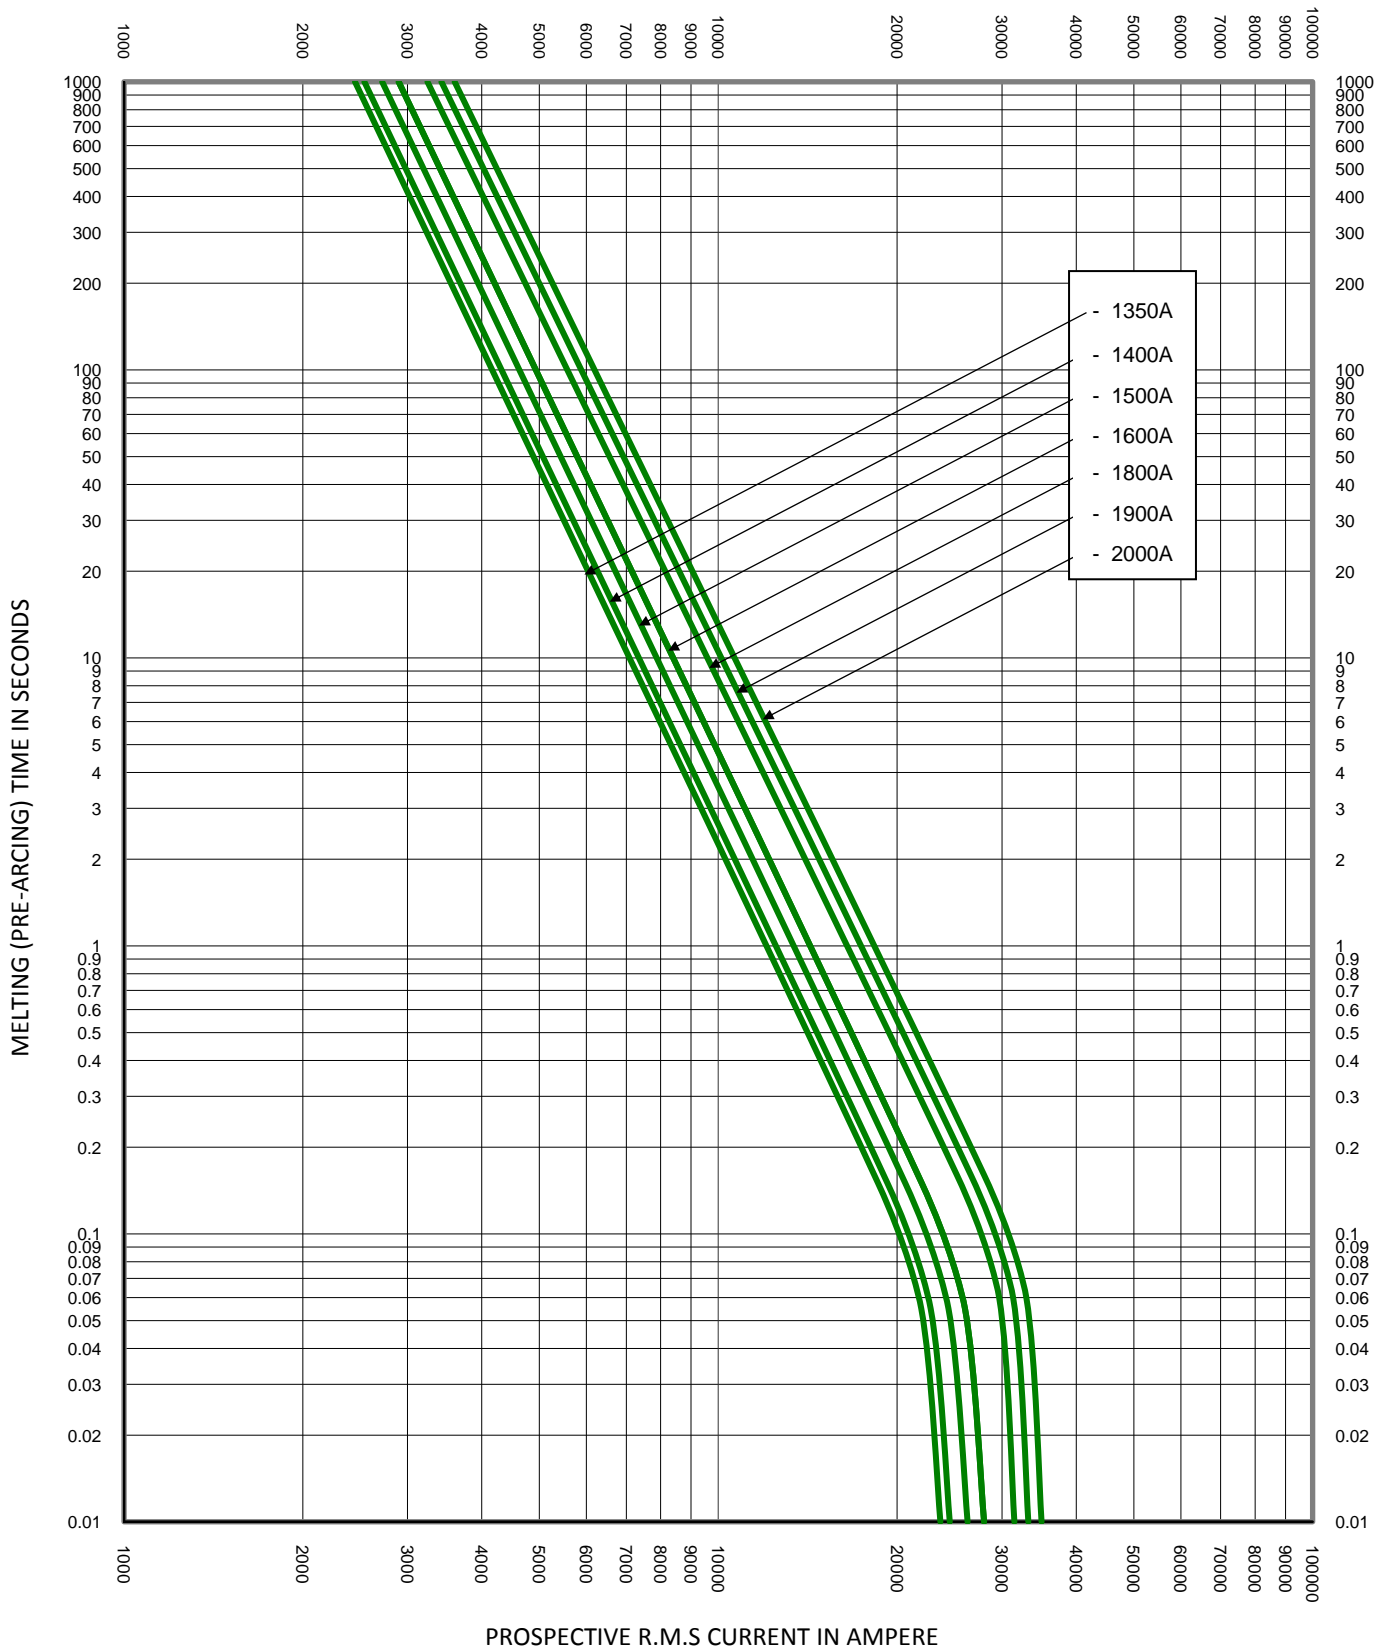

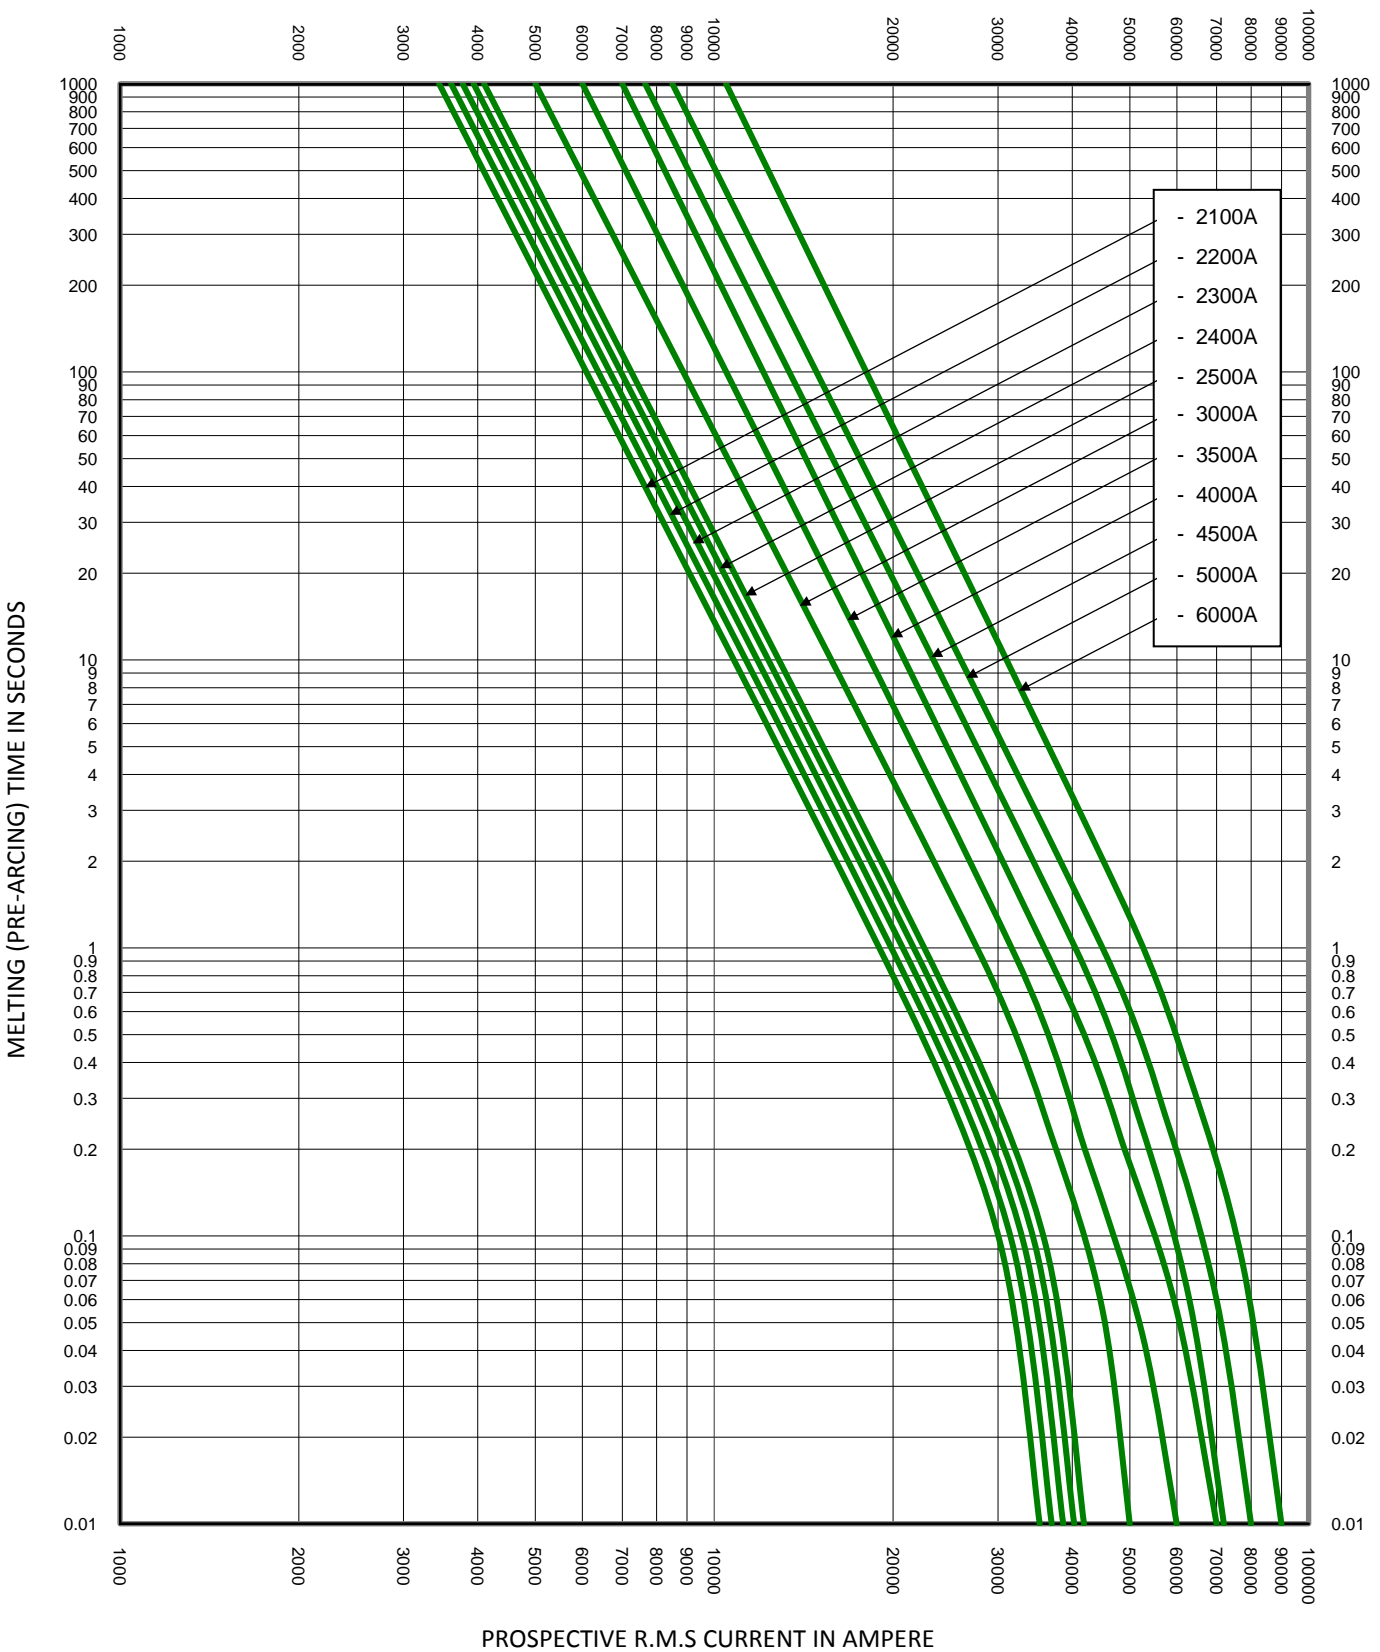



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLPC 200A-6000A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 02/06/2018 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-KLPC SHEET 2 OF 4



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLPC 200A-6000A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 02/06/2018 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-KLPC SHEET 3 OF 4



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLPC 200A-6000A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 02/06/2018 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-KLPC SHEET 4 OF 4