


# AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

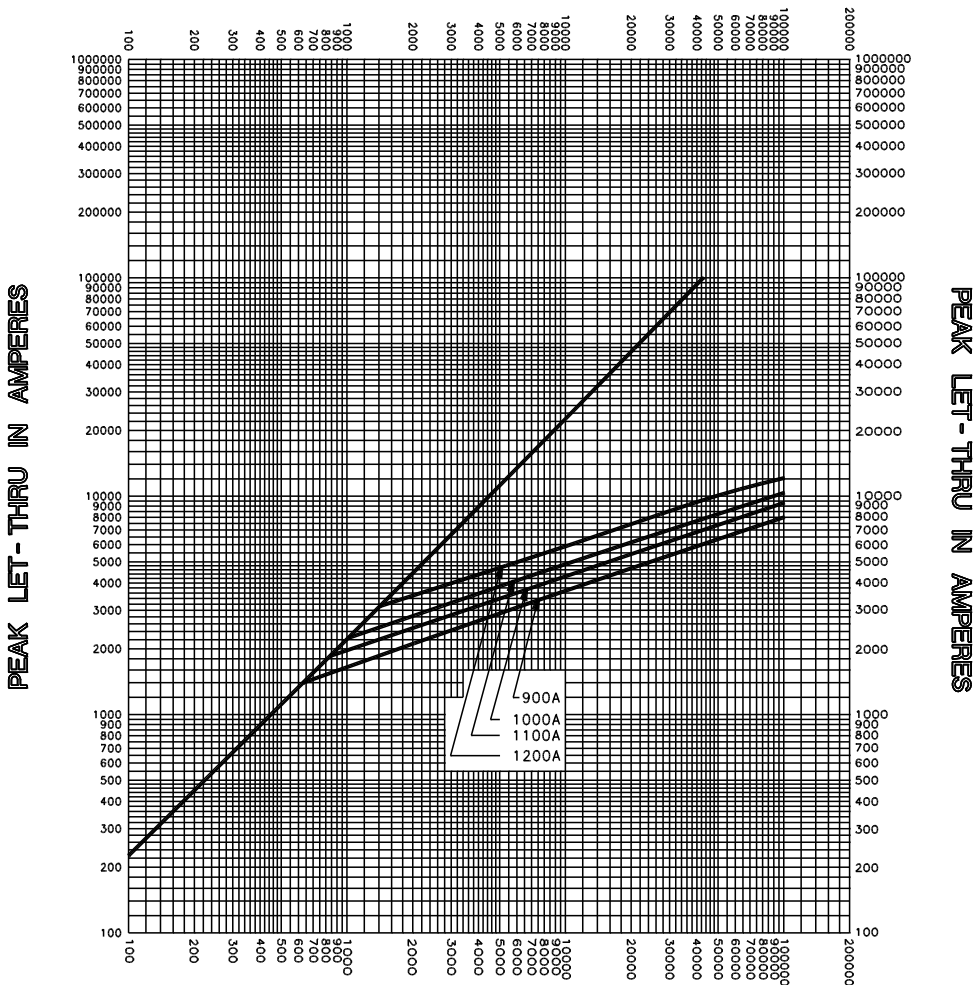

# AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L17T (900A,1000A,1100A,1200A)
BASIS FOR DATA _____		

<b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY: BJJ DATE: 9/25/01 CHECKED BY: _____ DRAWING NO. A-FCC00177
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>	

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

**AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES**

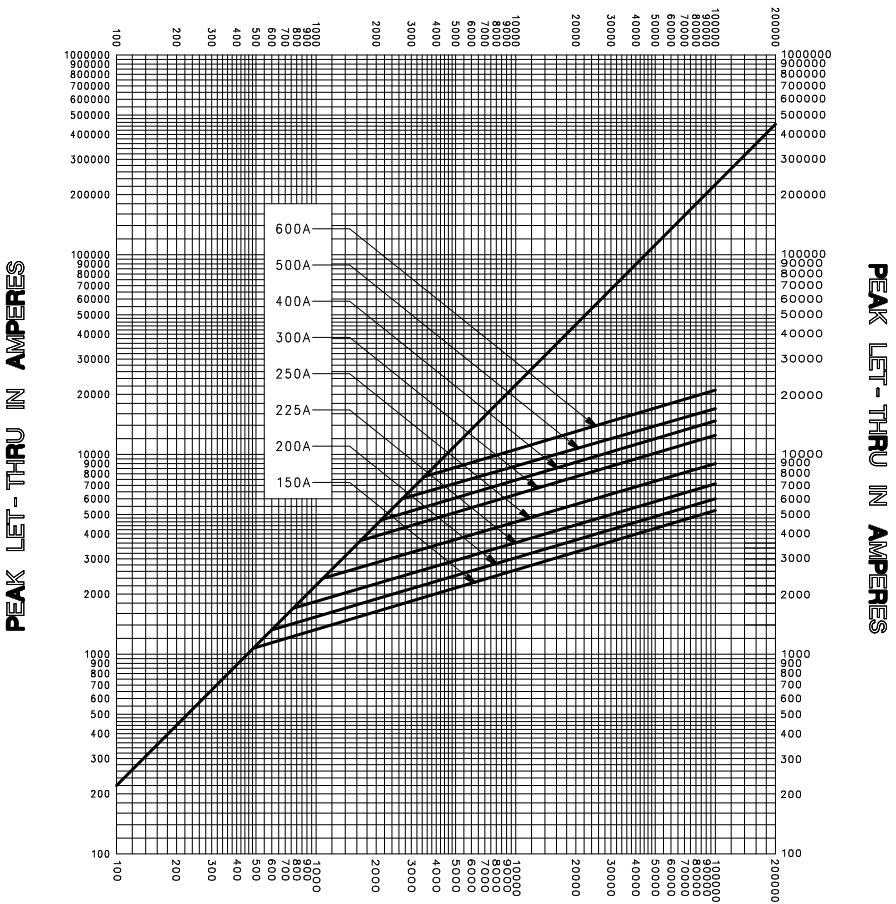

**AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L17T (150A - 600A)
BASIS FOR DATA _____		

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY LLL DATE 09/06/06 CHECKED BY MP
	DRAWING NO. A-FCC000000002

**PEAK LET-THRU CHARACTERISTIC CURVES**

- THIS DATA GENERATED ON CAD -

**UNCONTROLLED  
DOCUMENT**