


CURRENT IN AMPERES

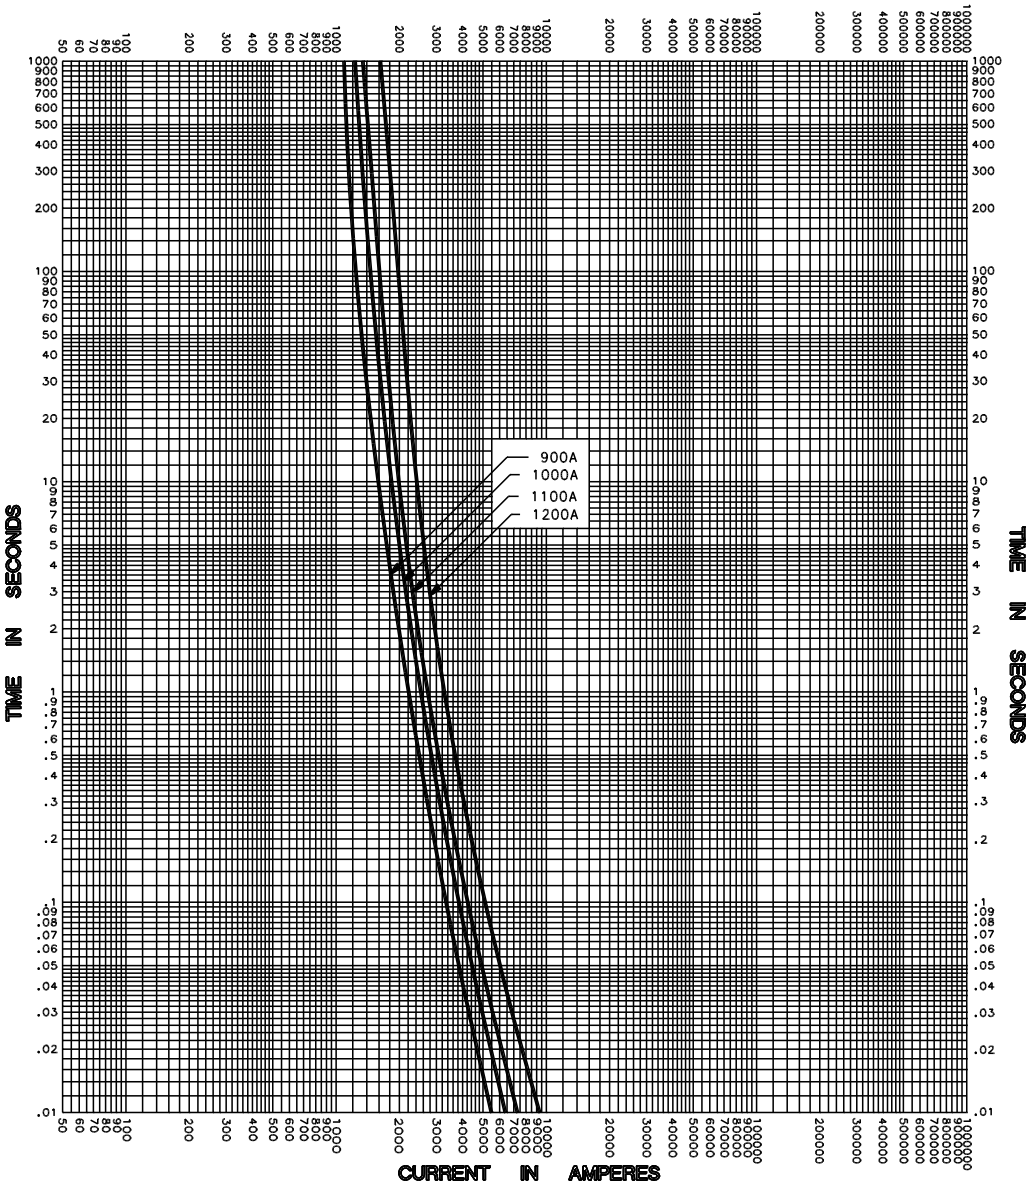

|                      |                                    |   |
|----------------------|------------------------------------|---|
| TEST VOLTAGE _____   | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER<br>L17TT (900A,1000A,1100A,1200A) |
| BASIS FOR DATA _____ |                                    |   |


|  |  |
|--|--|
| <br>DES PLAINES, ILLINOIS 60016 | DRAWN BY <u>BJJ</u><br>DATE <u>9/25/01</u><br>CHECKED BY _____ |
|--|--|

|   |                             |
|---|-----------------------------|
| <b>TIME CURRENT CHARACTERISTIC CURVES</b> | DRAWING NO. <u>A-FCC-01</u> |
|---|-----------------------------|

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

**CURRENT IN AMPERES**

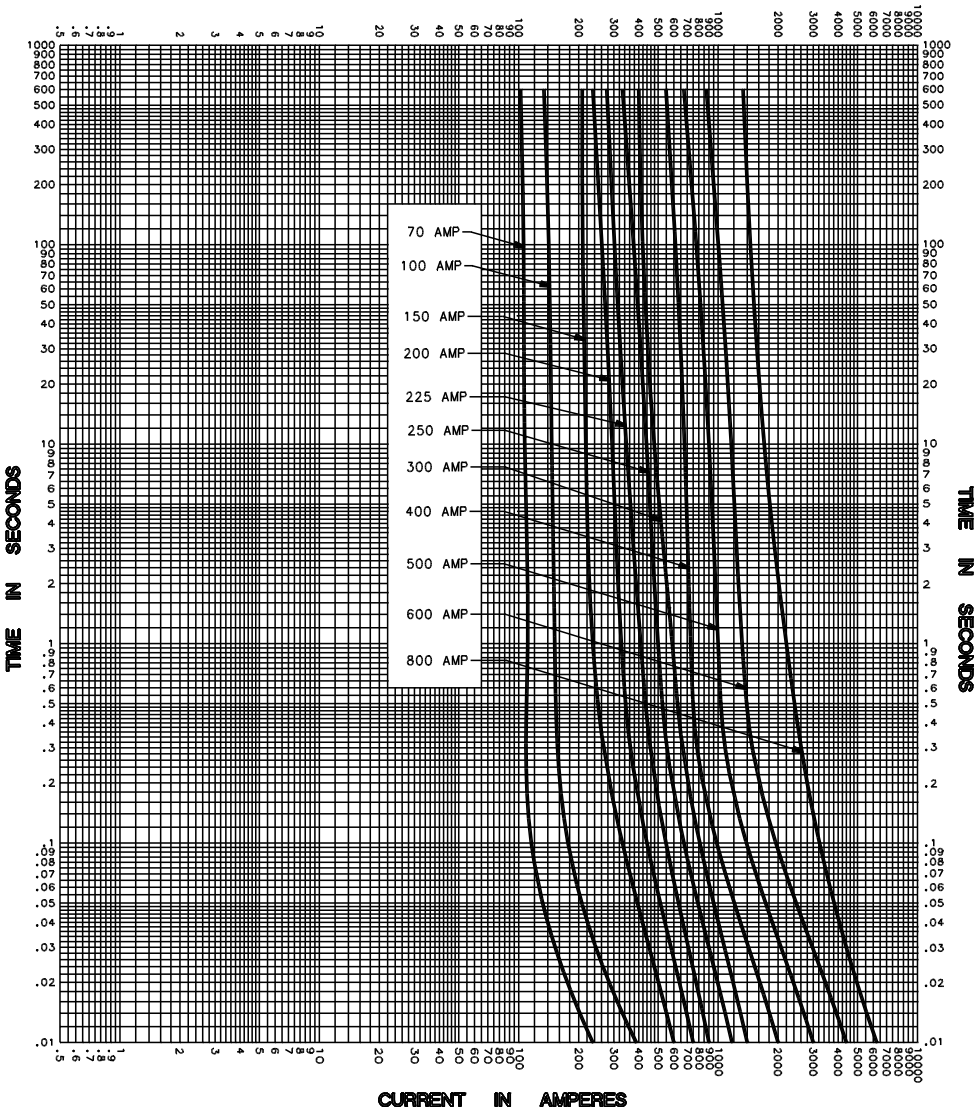

**CURRENT IN AMPERES**

|                      |                                    |                           |
|----------------------|------------------------------------|---------------------------|
| TEST VOLTAGE _____   | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER       |
| BASIS FOR DATA _____ |                                    | L17T SERIES (70A TO 800A) |

|  |                       |
|--|-----------------------|
| <b>LITTELFUSE, INC.</b><br>DES PLAINES, ILL. USA | DRAWN BY MRD          |
|  | DATE 02/19/03         |
|  | CHECKED BY TN         |
| <b>TIME CURRENT CHARACTERISTIC CURVES</b>        | DRAWING NO. A-FCC0002 |

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT