


# PGR-3100 MANUAL GROUND-FAULT INDICATION SYSTEM

Revision 6-A-060818

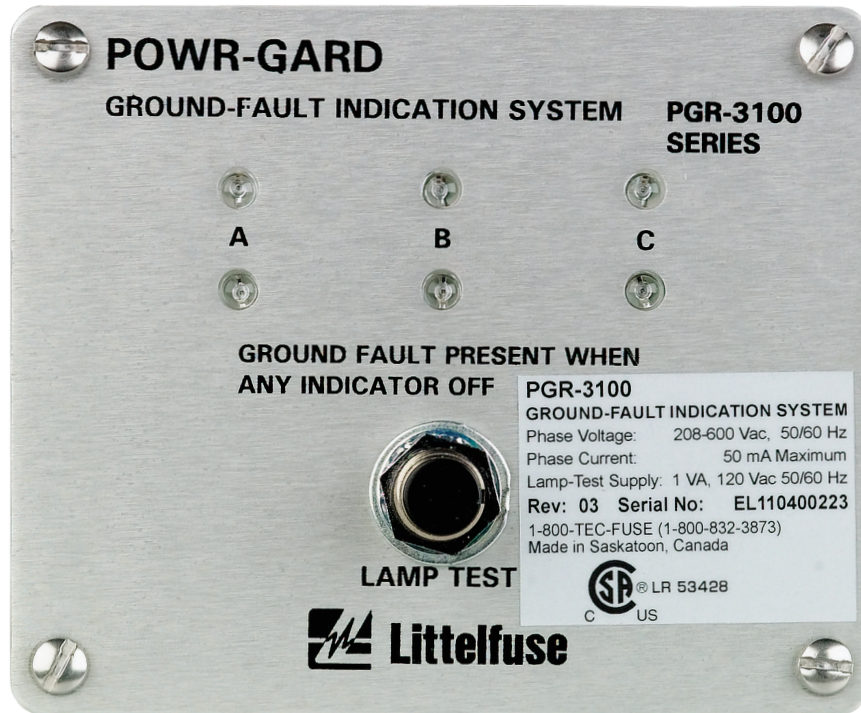

Copyright © 2018 Littelfuse  
All rights reserved.

**This page intentionally left blank.**

---

## TABLE OF CONTENTS

<b>1 FEATURES</b> .....	1
<b>2 DESCRIPTION</b> .....	1
<b>3 INSTALLATION</b> .....	1
<b>4 TECHNICAL SPECIFICATIONS</b> .....	4

## LIST OF FIGURES

1	<i>PGR-3100 Outline and Mounting Details</i> .....	1
2	<i>Connection Diagram for an Ungrounded 240- to 600-V System</i> .....	2
3	<i>Connection Diagram for Ungrounded Systems above 600 V</i> .....	2
4	<i>Connection Diagram for Resistance-Grounded System up to 600 V</i> .....	3
5	<i>Connection Diagram for a Resistance-Grounded System above 600 V</i> .....	3

## DISCLAIMER

Specifications are subject to change without notice.  
Littelfuse, Inc. is not liable for contingent or consequential damages, or for expenses sustained as a result of a malfunction, incorrect application, or incorrect adjustment.

---

**This page intentionally left blank.**

### 1. FEATURES

- Green LED's indicate presence of voltage to ground for each phase of a power system.
  - A ground fault (or phase loss) is indicated when a set of LED's is off.
  - LED's are on when phase-to-ground voltage exceeds 30 Vac.
  - Redundant LED's are used for reliability.
- Pressing LAMP TEST causes all LED's to light.

**NOTE:** The LAMP TEST feature requires an isolated 120 Vac supply.

- Direct connection for voltages up to 600 Vac line to line.
  - Potential transformers (PT's) are required for voltages greater than 600 Vac.
- Provides faulted-phase indication for resistance-grounded systems and ungrounded systems.

### 2. DESCRIPTION

The PGR-3100 is a self-powered ground-fault indication system. Presence of phase-to-ground

voltage is indicated by redundant LED's (two per phase). The respective phase LED's are off when phase-to-ground voltage is less than 30 Vac. The PGR-3100 meets the National Electrical Code requirements for ground detectors for ungrounded alternating-current systems as defined in NEC 250.21. It also meets the Canadian Electrical Code requirements for ungrounded alternating-current systems in accordance with CEC 10-106(2).

### 3. INSTALLATION

Outline and panel-mounting details are shown in Fig.1.

For 208- to 600-Vac systems, connect the PGR-3100 directly to the three-phase bus. For 208- or 240-volt installations, use terminals AL, BL, and CL. For systems above 240 V and up to 600 V use terminals AH, BH, and CH. See Figs. 2 and 4.

For systems above 600 V, install PT's as shown in Figs. 3 and 5.

Connect terminal G and chassis-bonding terminal (⊕) to ground.

For LAMP TEST connect 120 Vac supply to terminals L and G. Connection and use of LAMP TEST circuit is optional.

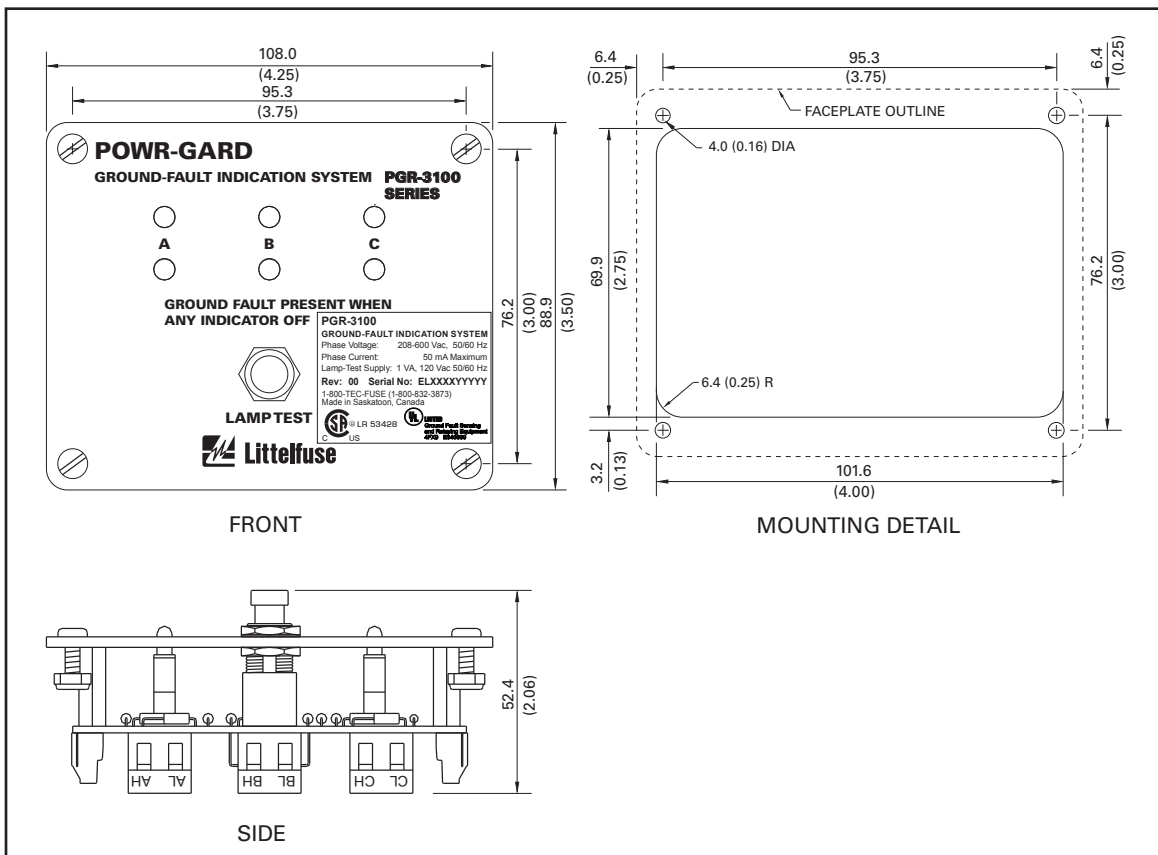


FIGURE 1. PGR-3100 Outline and Mounting Details.

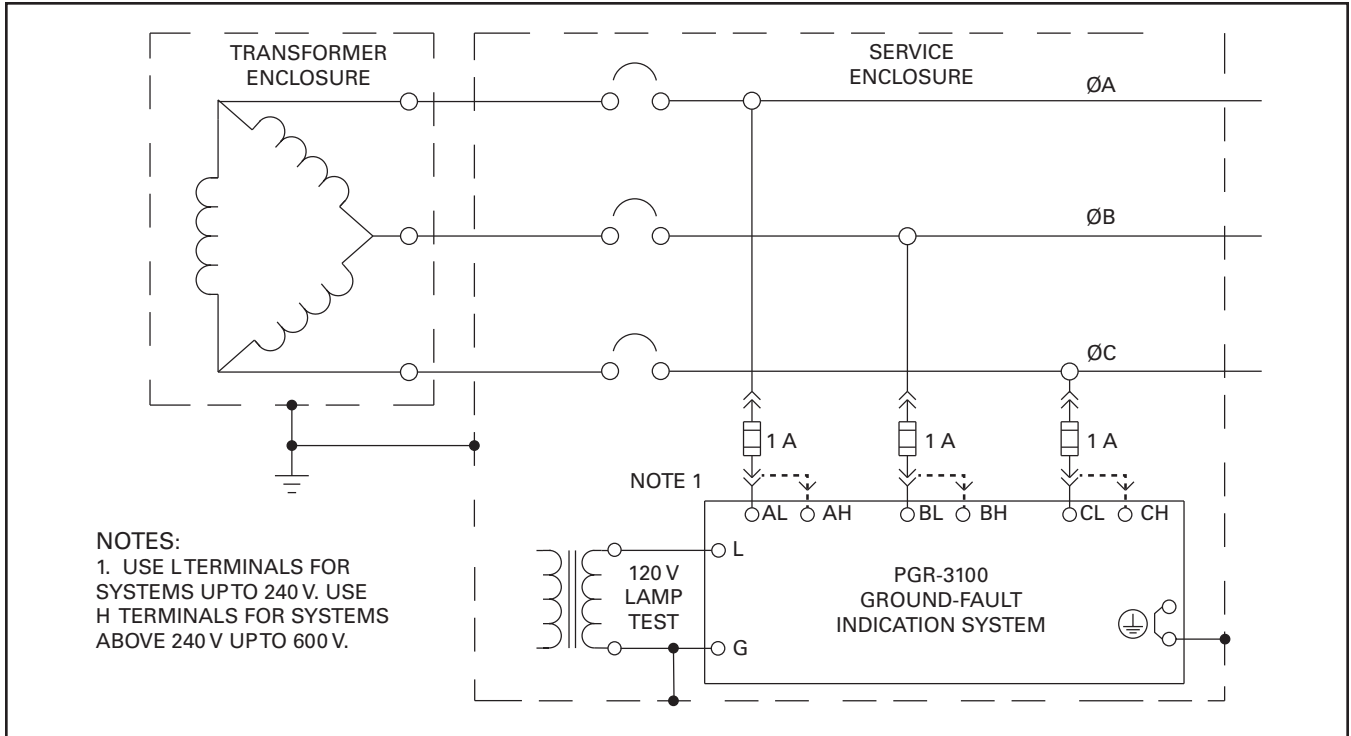


FIGURE 2. Connection Diagram for an Ungrounded 240- to 600-V System.

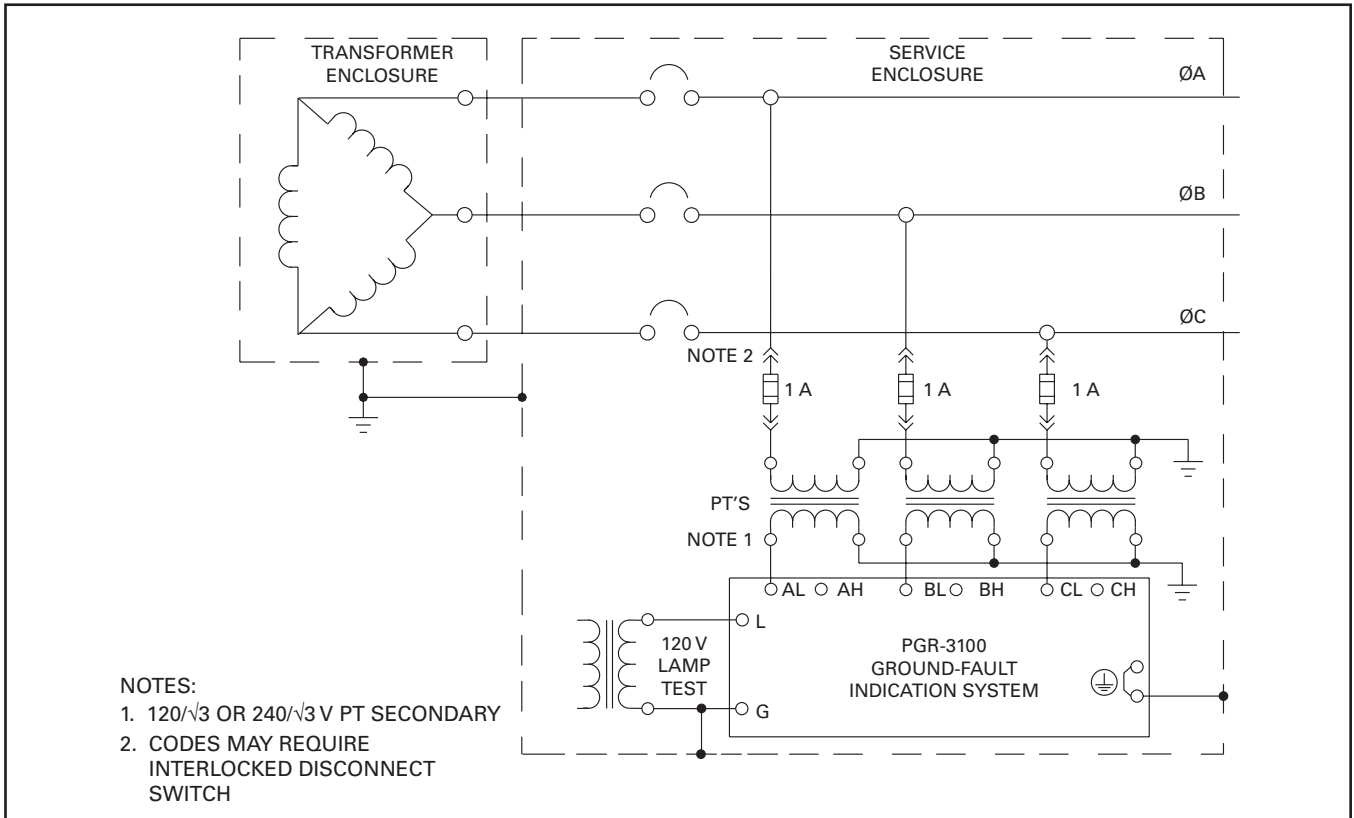


FIGURE 3. Connection Diagram for Ungrounded Systems above 600 V.

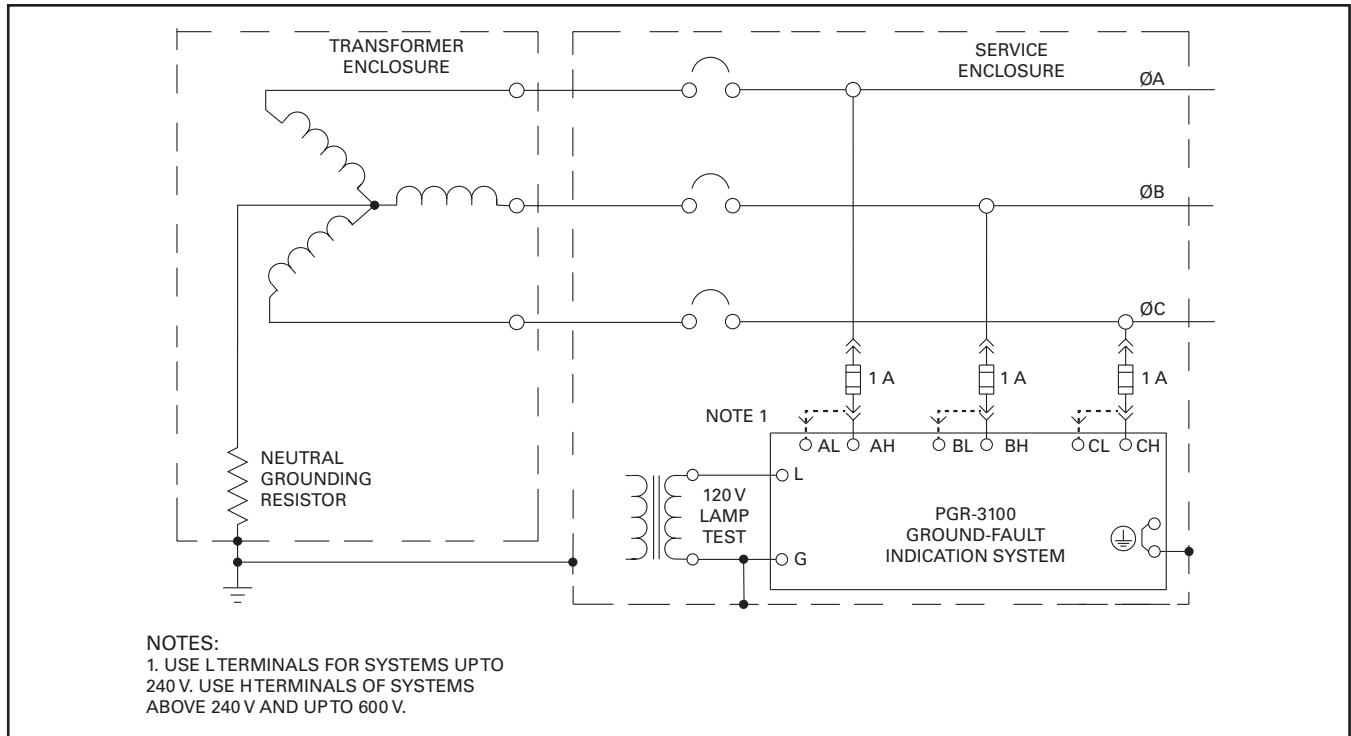


FIGURE 4. Connection Diagram for a Resistance-Grounded System up to 600 V.

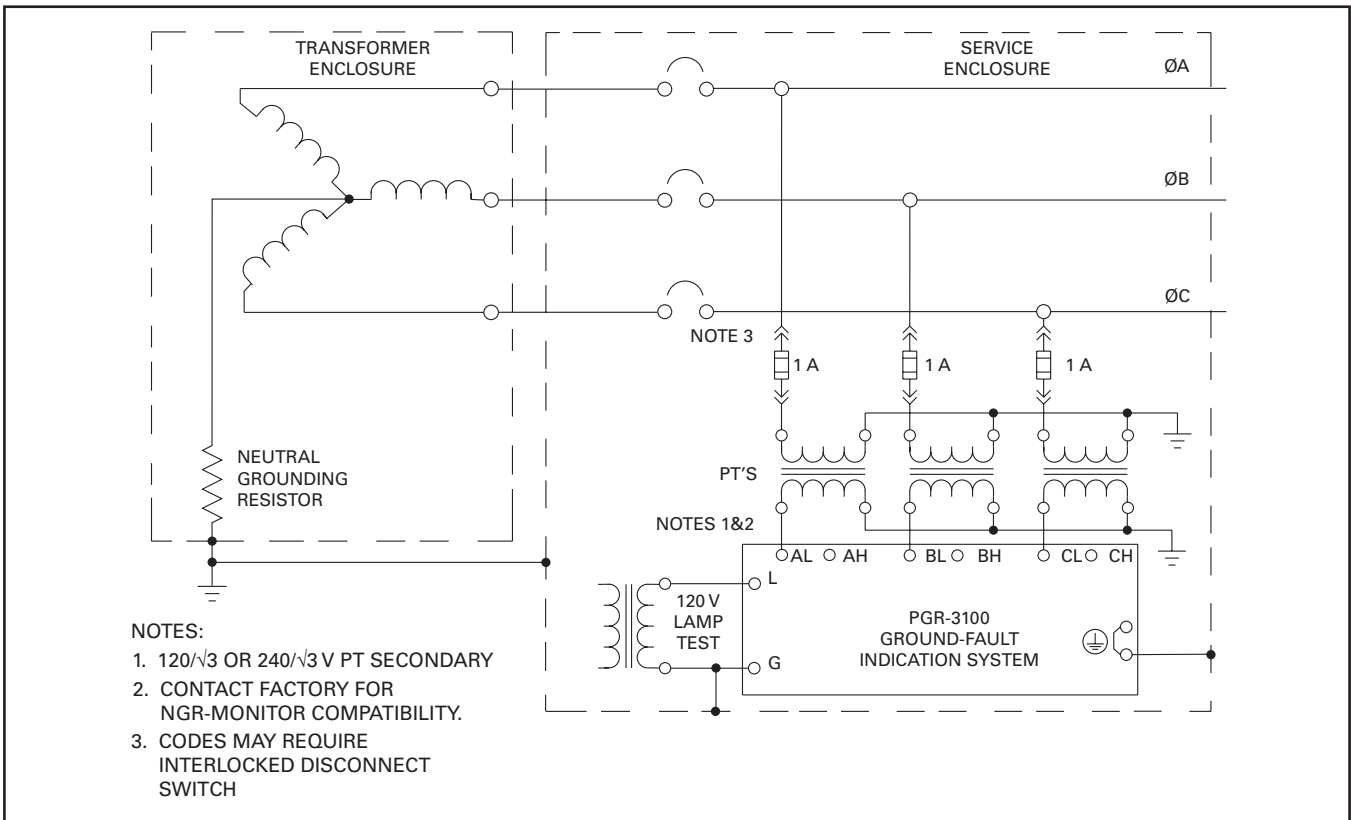


FIGURE 5. Connection Diagram for Resistance-Grounded Systems above 600 V.

**4. TECHNICAL SPECIFICATIONS**

Phase Voltage

Input L, maximums .....240 Vac to ground,  
3.5 mA  
Input H, maximums .....600 Vac to ground,  
4.5 mA

Lamp Test .....Isolated 120 Vac,  
1 VA maximum

LED Threshold .....30 Vac, minimum

Dielectric Strength .....2,200 Vac, 1 minute

Shipping Weight .....0.3 kg (0.8 lb.)

Dimensions:

Height.....108 mm (4.3")  
Weight.....88.9 mm (3.5")  
Depth.....54 mm (2.1")

Environment:

Operating Temperature .....-40 to 60°C  
Storage Temperature .....-55 to 80°C  
Humidity.....85% Non-Condensing  
Enclosure Rating .....IP40 (When installed  
on panel)

PWB Conformal Coating .....MIL-1-46058 qualified  
UL QMJU2 recognized

Certification.....CSA, USA and Canada



UL Listed





**APPENDIX A  
PGR-3100 REVISION HISTORY**

<b>MANUAL RELEASE DATE</b>	<b>MANUAL REVISION</b>	<b>PRODUCT REVISION (REVISION NUMBER ON PRODUCT LABEL)</b>
June 08, 2018	6-A-060818	03
March 09, 2012	6	

**MANUAL REVISION HISTORY  
REVISION 6-A-060818  
SECTION 1**

Format updated.

**PRODUCT REVISION HISTORY  
PRODUCT REVISION 03**